



Department of
Environmental
Protection

59-17 Junction Boulevard
Flushing, New York
11373-5108

Christopher O. Ward
Commissioner

Robert C. Avaltroni
Deputy Commissioner

Bureau of
Environmental
Compliance

Tel: (718) 595-4418
Fax: (718) 595-4422

To: Gerould J. McCoy
Agency Compliance Officer
Office of Environmental Health and Safety Compliance

From: Robert C. Avaltroni
Deputy Commissioner
Bureau of Environmental Compliance

Date: April 8, 2003


Subject: 66 John Street


This is a follow-up to the April 3, 2003 memorandum and its attachment.

TEM air sampling was performed at 66 John Street, on April 5, 2003. Twenty-two (22) samples were collected from representative locations on the 10th floor and portion of the 9th floor. The sample analysis disclosed all samples were below the AHERA clearance of 70 s/mm² and below the detection limit. A copy of the results is attached for your perusal.

Please feel free to contact me if you need any additional information.



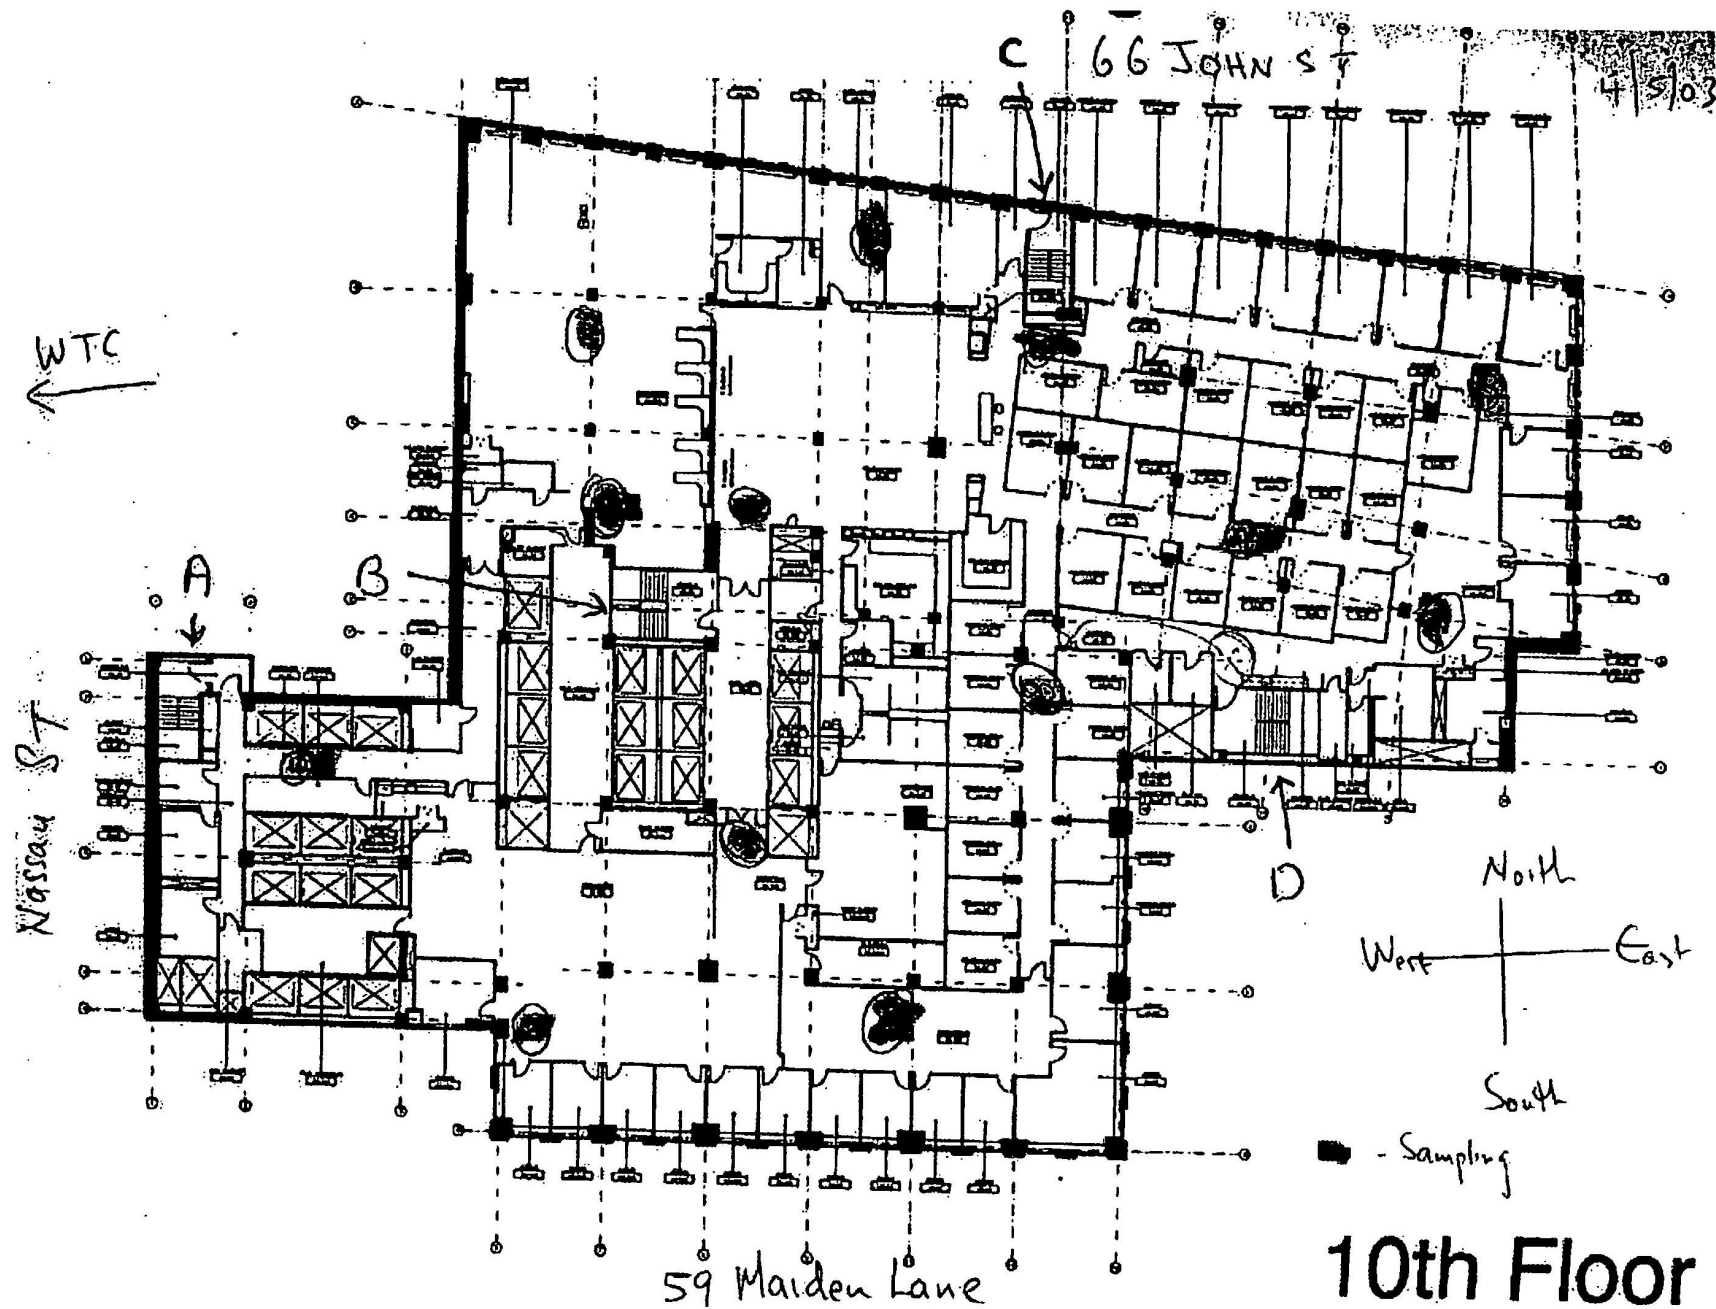

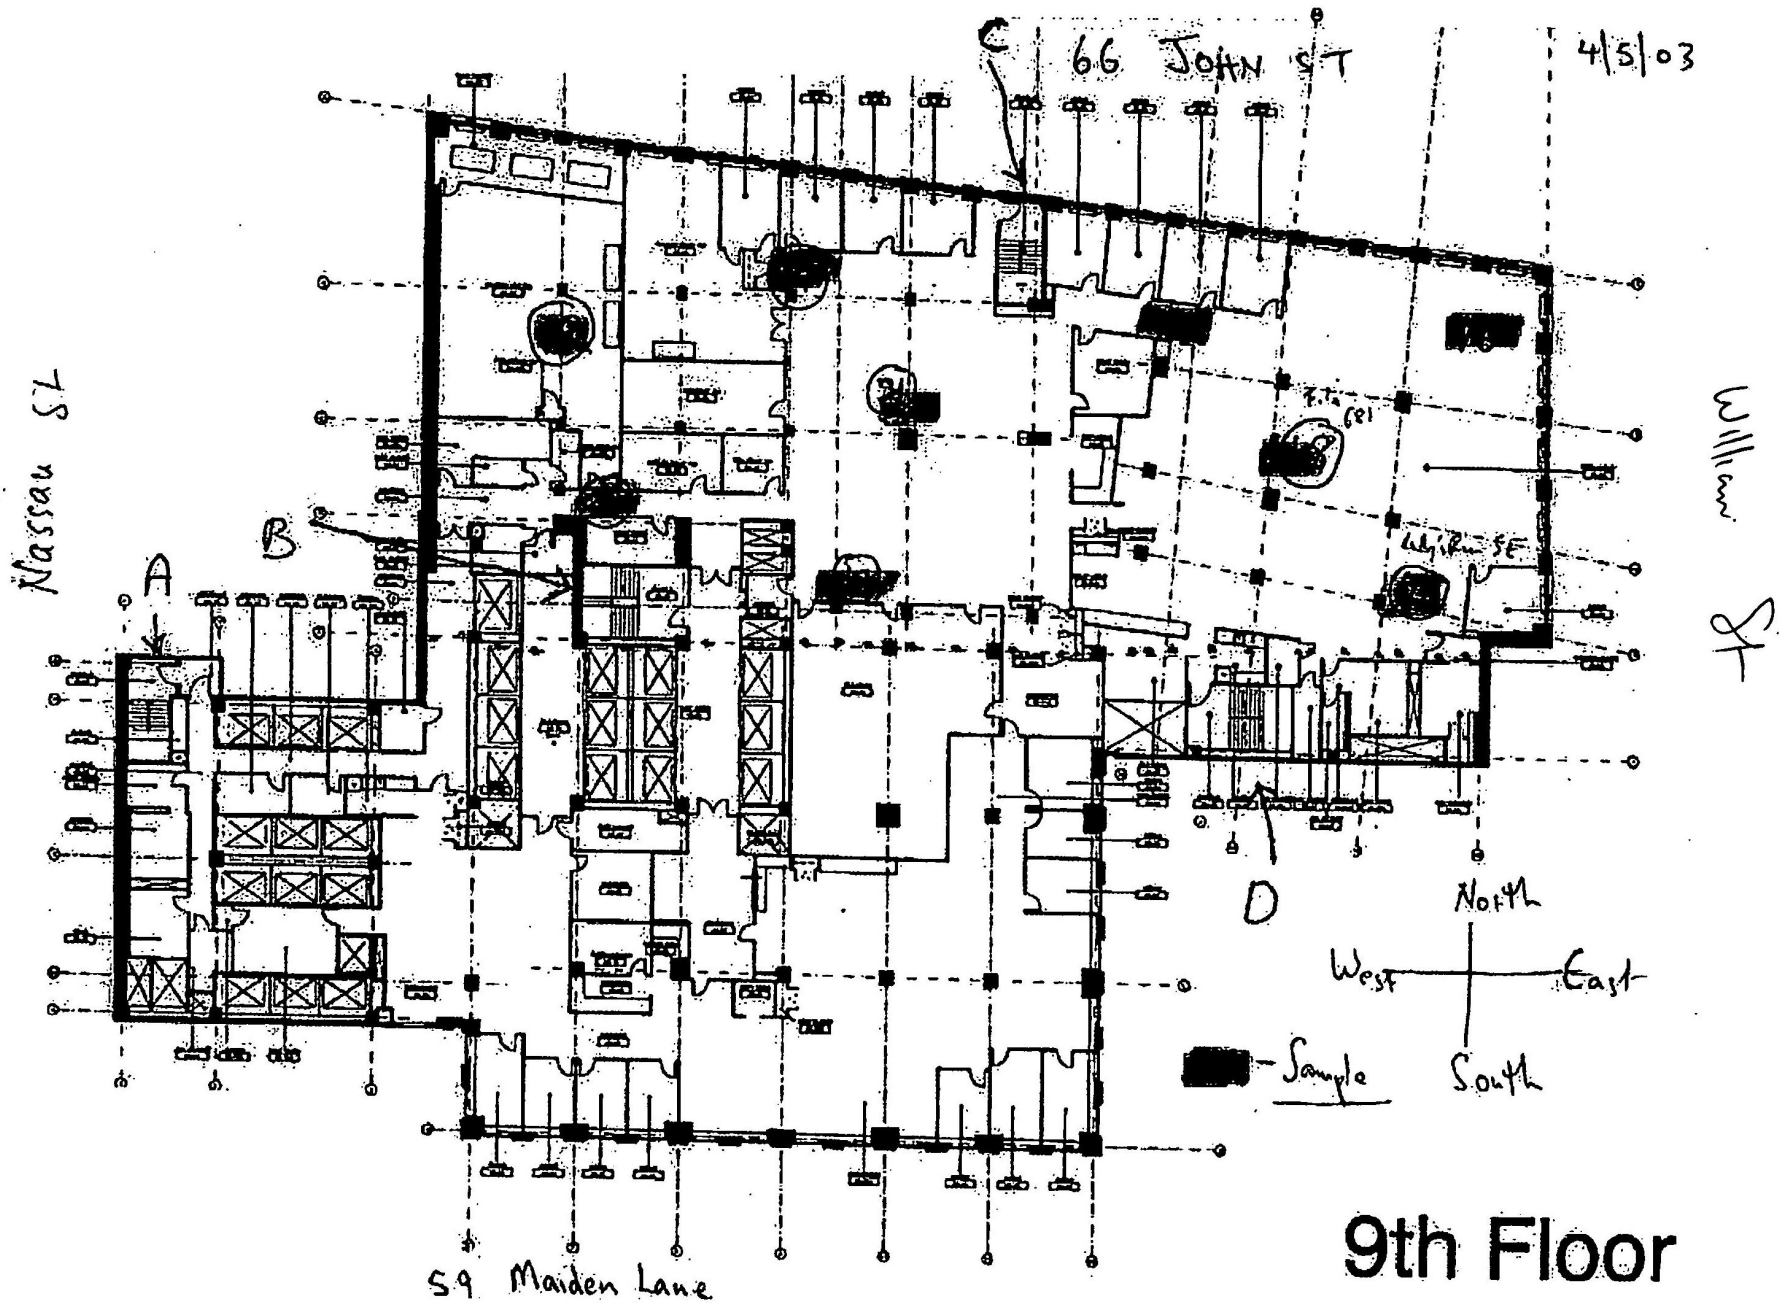

**AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM**

T03-04-006

(2)

03/07/2003 15:41 FAX

PROJECT INFORMATION

1. PROJECT NAME: <u>66 E 10th St 10F/002</u>		2. ADDRESS: <u>59 Maiden Lane 166 John St.</u>	3. BORO: <u>Manhattan</u>
4. DATE: <u>4-5-03</u>	5. AIR MONITOR: <u>Ahmad Soloki</u>		6. (a) Background: <u> </u> (b) OSHA: <u> </u> (c) Pre-Abate: <u> </u> (d) Post-Abate: <u> </u> (e) Abatement: <u> </u> (f) Ambient: <u> </u> (g) PCM(0.8µMCE) <u> </u> (h) TEM (0.45µMCE) <u>X</u>

AIR SAMPLING DATA

ROTOMETER No:			SAMPLING TIME		FLOW RATE OF PUMP (L/min)						Total Vol (L)	MSD
7. Sample ID	8. Pump No.	9. Sample Location	10. Start Time	11. End Time	12. Total Mins	13. Start Flow	14. End Flow	15. Avg Flow	16. Total Vol (L)	17. MSD		
302/001	2	WAITING ROOM entrance	11:05 AM	11:35 PM	150	10	10	10	1500	419.50		
302/002	1	WORKING AREA North	11:07 AM	11:37 PM	150	10	10	10	1500	419.50		
302/003	6	WAITING AREA John St SIDE EXIT North	11:10 AM	11:40 PM	150	10	10	10	1500	419.50		
302/004	5	IFO hearing Room #27	11:13 AM	11:43 PM	150	10	10	10	1500	419.50		
302/005	8	IFO hearing RM 645	11:15 AM	11:45 PM	150	10	10	10	1500	419.50		

CHAIN OF CUSTODY

Turnaround Time: 2hrs 4hrs 24hrs 48hrs 72hrs

18. Relinquished by	19. Received by	20. Date	21. Time	22. Analysis Requested
A. Soloki	L. ATTELONEY	4/05/03	2:00 PM	NIOSH 7400: <u> </u>
of Lee	X. Adhony			AIIRA: <u>X</u>
L. ATTELONEY	E. Spauter	4/5/03	4:00 PM	OWIR: <u> </u>
X. Adhony				

New York City Department of Environmental Protection
Bureau of Air, Noise & Hazardous Materials
Division of Emergency Response and Technical Assessment
96-05 Horace Harding Expressway
Corona, New York 11368

P.02

BANIM LABORATORY UNIT

APR-07-2003 17:39

AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM

T03-04-006

1

PROJECT INFORMATION

1. PROJECT NAME:		2. ADDRESS: 66 JOHN STREET		3. BORO: MN	
4. DATE: 4/5/03	5. AIR MONITOR: GEORGE ANAKHU			6. (a) Background: (b) OSHA: (c) Pre-Abate: (d) Post-Abate: (e) Abatement: (f) Ambient: (g) PCM(0.8µMCE) (h) TEM (0.45µMCE) X	

AIR SAMPLING DATA

ROTORMETER No:

SAMPLING TIME

FLOW RATE OF PUMP (L/min)

Sample ID	Pump No.	Sample Location	Start Time	End Time	Total Min	Start Flow	End Flow	Avg. Flow	Total Vol (L)	ASB-STR
LA03/006	6	10 th FL ENTRANCE MARDEN LANE SIDE	11:10	11:10	150	10	11	10.5	1500	219.50
007	7	10 th FL SOUTH OF ROOM 35	11:20	11:20	150	10	10	10.0	1500	219.50
008	8	10 th FL PANTRY STAIR CASE	11:30	11:30	150	10	10	10.0	1500	219.50
Field Blank										
Field Blank										
Sealed Blank										

CHAIN OF CUSTODY

Turnaround Time: 2hrs 6hrs 24hrs 48hrs 72hrs

Relinquished by	Received by	Date	Time	Analysis Requested
GEORGE ANAKHU	L. ATTORNEY	04/05/03	2:10 PM	NIOSH 7400: AHRA: OTHER:
George Anaku	A. Adalany	4/5/03	4:00 PM	
L. ATTORNEY	E. S. S. S.			
L. Adalany				

New York City Department of Environmental Protection
Bureau of Air, Noise & Hazardous Materials
Division of Emergency Response and Technical Assessment
96-05 Horace Harding Expressway
Corona, New York 11368

PII

LEONARD ATTORNEY

FAX #

(718) 595-6307

P.03

BANHM LABORATORY UNIT

APR-07-2003 17:40

**AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM**

T03-04-006

04/07/2003 15:42 FAX

PROJECT INFORMATION

1. PROJECT NAME: 66 Jones St 10th Floor ADDRESS: 66 Jones St CITY: NY

DATE: 4/5/03 AIR MONITOR: Emmanuel Brutus

(a) Background: ___ (b) OSMA: ___ (c) Pre-Abate: ___ (d) Post-Abate: ___
 (e) Abatement: ___ (f) Ambient: ___ (g) PCM(0.8µMCE) ___ (h) TEM (0.45µMCE) X

AIR SAMPLING DATA

Sample ID	Pump No.	Sample Location	SAMPLING TIME		FLOW RATE OF PUMP (L/min)					
			Start Time	End Time	Total Mins	Start Flow	End Flow	Avg Flow	Total Vol (L)	AsB-578
307/009	9	South West Corner Hudson Ln & Nassau St	11:12	01:48	256	10	10	10	1560	219.50
307/010	10	Pantry Area	11:15	01:51	156	10	10	10	1560	219.50
307/011	11	Corridor between Electrical Closet & Storage	11:18	01:53	155	10	10	10	1550	219.50
307/012	12	John St Side by curb 32-10 th	11:22	01:55	159	10	10.0	10	1590	219.50
307/013	13	Annex Room 22 & 23, NE Corner John St & William St	11:25	01:57	152	10	10	10	1520	219.50

CHAIN OF CUSTODY

Turnaround Time: 2hr

CHAIN OF CUSTODY

Turnaround Time: 2hrs ___ 8hrs ___ 24hrs ___ 48hrs ___ 72hrs ___

Relinquished by	Received by	Date	Time	Analysis Requested
E. Brutus	L. ATTALONE	04/05/03	2:01 PM	NIOSH 7400: ___ AHERA: <u>X</u> OTHER: ___
E. Brutus	A. Attalony			
L. ATTALONE	E. S. [Signature]	4/5/03	4:00 PM	
A. Attalony				

New York City Department of Environmental Protection
 Bureau of Air, Noise & Hazardous Materials
 Division of Emergency Response and Technical Assessment
 96-05 Horace Harding Expressway
 Corona, New York 11368

P.04

BANIM LABORATORY UNIT

APR-07-2003 17:41

**ATHENICA**

ENVIRONMENTAL SERVICES INC.

Tel (718) 784-7490

Fax (718) 784-4085

AIRBORNE ASBESTOS ANALYSIS BY TRANSMISSION ELECTRON MICROSCOPY

CLIENT: NYC DEP

LABORATORY ID #: T03-04-006

ANALYT. METHODOLOGY: AHERA

FILTER TYPE: M.C.E.

AVERAGE G.O. AREA (mm²): 0.012820

PROJECT: 66 John Street.

DATE OF REPORT: 04/07/03

DATE OF ANALYSIS: 04/05/03

EFFECTIVE FILTER AREA (mm²): 385**LABORATORY RESULTS**

CLIENT #	LAB. ID #	LOCATION	VOLUME (l)	G.O.'s ANALYZED	AREA ANALYZED (mm ²)	ANALYT. SENSITIVITY (struct./cm ²)	TOTAL ASBESTOS AIR CONC. (struct./cm ³)	TOTAL ASBESTOS FILTER CONC. (str./mm ²)	AIR CONC. FOR STRUCT. 0.5 ≤ S ≤ 5 μm	AIR CONC. FOR STRUCT. S ≥ 5.0 μm	ASBEST. TYPE CHRYS.	AMPHIB. ASBEST. TYPE SPECIFY
Lab3 006	T03-04-006-638	10 th floor entrance Maiden Lane side	1550	4	0.0513	0.0048	<0.0048	<19.50	NA	NA	NA	NA
Lab3 007	T03-04-006-639	10 th floor south of room 35	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
Lab3 008	T03-04-006-640	10 th floor pantry stair case	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/001	T03-04-006-641	Waiting room entrance	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/002	T03-04-006-642	Working area north	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA

ANALYST
E. Sioukri

LABORATORY DIRECTOR
Spiro Dongaris**LABORATORY CERTIFICATION NUMBERS: NVLAP 101958, ELAP 10955**

- Athenica Environmental Services Inc. (AES), is responsible only for information pertaining to samples taken by its employees.
- Air sampling cassettes will be stored for sixty (60) days. AES Inc., should be notified within this time frame for a true duplicate analysis.
- If AES Inc., did not conduct the sampling, the reported airborne concentration was derived based on information provided by the client. Under these circumstances, the air concentration data is supplied solely for the convenience of the client.
- The report relates only to items tested. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. Test reports may not be reproduced except in full and with prior approval of AES Inc.
- The liability of Athenica Environmental Services Inc. with respect to the services charged, shall in no event exceed the amount of the invoice.

P. 06

BAMM LABORATORY UNIT

APR-07-2003 17:42

04/07/2003 13:42 PM

0100

**ATHENICA**

ENVIRONMENTAL SERVICES INC.
Tel (718) 784-7490
Fax (718) 784-4085

AIRBORNE ASBESTOS ANALYSIS BY TRANSMISSION ELECTRON MICROSCOPY

CLIENT: NYC DEP
LABORATORY ID #: T03-04-006
ANALYT. METHODOLOGY: AHERA
FILTER TYPE: M.C.E.
AVERAGE C.O. AREA (mm^2): 0.012820

PROJECT: 66 John Street
DATE OF REPORT: 04/07/03
DATE OF ANALYSIS: 04/05/03
EFFECTIVE FILTER AREA (mm^2): 385

LABORATORY RESULTS

CLIENT #	LAB. ID #	LOCATION	VOLUME (l)	G.O.'s ANALYZED	AREA ANALYZED (cm^2)	ANALYT. SENSITIV. (struct./ cm^2)	TOTAL ASBESTOS AIR CONC. (struct./ cm^3)	TOTAL ASBESTOS FILTER CONC. (str./ mm^2)	AIR CONC. FOR STRUCT. 0.55-5 μm	AIR CONC. FOR STRUCT. >5.0 μm	ASBEST. TYPE CHRYS.	AMPHIB. ASBEST TYPE SPECIFY
302/003	T03-04-006-643	Waiting area John St. side exit north	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/004	T03-04-006-644	I/O hearing room #27	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/005	T03-04-006-645	I/O hearing room #45	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
307/009	T03-04-006-646	South west corner Maiden Lane & Nassau St.	1560	4	0.0513	0.0048	<0.0048	<19.50	NA	NA	NA	NA
307/010	T03-04-006-647	Pantry Area	1560	4	0.0513	0.0048	<0.0048	<19.50	NA	NA	NA	NA

ANALYST
E. Sioukri

LABORATORY DIRECTOR
Spiro Dongaris

LABORATORY CERTIFICATION NUMBERS: NVLAP 101958, ELAP 10955

- Athenica Environmental Services Inc. (AES), is responsible only for information pertaining to samples taken by its employees.
- Air sampling cassettes will be stored for sixty (60) days. AES Inc., should be notified within this time frame for a true duplicate analysis.
- If AES Inc., did not conduct the sampling, the reported airborne concentration was derived based on information provided by the client. Under these circumstances, the air concentration data is supplied solely for the convenience of the client.
- The report relates only to items tested. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. Test reports may not be reproduced except in full and with prior approval of AES Inc.
- The liability of Athenica Environmental Services Inc. with respect to the services charged, shall in no event exceed the amount of the invoice.

P.07

**ATHENICA**

ENVIRONMENTAL SERVICES INC.

Tel (718) 784-7490

Fax (718) 784-4085

AIRBORNE ASBESTOS ANALYSIS BY TRANSMISSION ELECTRON MICROSCOPY

CLIENT: NYC DEP

LABORATORY ID #: T03-04-006

ANALYT. METHODOLOGY: AHERA

FILTER TYPE: M.C.E.

AVERAGE G.O. AREA (mm²): 0.012820

PROJECT: 66 John Street

DATE OF REPORT: 04/07/03

DATE OF ANALYSIS: 04/05/03

EFFECTIVE FILTER AREA (mm²): 385**LABORATORY RESULTS**

CLIENT #	LAB. ID #	LOCATION	VOLUME (l)	G.O.'s ANALYZED	AREA ANALYZED (mm ²)	ANALYT. SENSITIV. (struct./cm ²)	TOTAL ASBESTOS AIR CONC. (true/cm ³)	TOTAL ASBESTOS FILTER CONC. (str./mm ²)	AIR CONC. FOR STRUCT. 0.5 ≤ S < 5 μm	AIR CONC. FOR STRUCT. S ≥ 5.0 μm	ASBEST. TYPE CHRYS.	AMPHIB. ASBEST. TYPE SPECIFY
307/011	T03-04-006-648	Corridor between electrical closet & file storage 10C	1550	4	0.0513	0.0048	<0.0048	<19.50	NA	NA	NA	NA
307/012	T03-04-006-649	John Street by cubicle 32-10 th	1530	4	0.0513	0.0049	<0.0049	<19.50	NA	NA	NA	NA
307/013	T03-04-006-650	Area of room 22&23 corner John St. & William St.	1520	4	0.0513	0.0049	<0.0049	<19.50	NA	NA	NA	NA

ANALYST
E. Sioukri

LABORATORY DIRECTOR
Spiro Dongaris

LABORATORY CERTIFICATION NUMBERS: NVLAP 101958, ELAP 10955

- Athenica Environmental Services Inc. (AES), is responsible only for information pertaining to samples taken by its employees.
- Air sampling cassettes will be stored for sixty (60) days. AES Inc., should be notified within this time frame for a true duplicate analysis.
- If AES Inc., did not conduct the sampling, the reported airborne concentration was derived based on information provided by the client. Under these circumstances, the air concentration data is supplied solely for the convenience of the client.
- The report relates only to items tested. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. Test reports may not be reproduced except in full and with prior approval of AES Inc.
- The liability of Athenica Environmental Services Inc. with respect to the services charged, shall in no event exceed the amount of the invoice.

APR-07-2003 17:43

BAINM LABORATORY UNIT

**AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM**

PROJECT INFORMATION

1. PROJECT NAME: Manhattan ECB 9 Fl. 2. ADDRESS: 59 Madison Ave / John St 9 Fl. 3. BORO: Man

4. DATE: 4-5-03 5. AIR MONITOR: Ahmad Solaki

6. (a) Background: (b) OSHA: (c) Pre-Abate: (d) Post-Abate:
 (e) Abatement: (f) Ambient: (g) PCM (0.8µMCE) (h) TEM (0.45µMCE)

AIR SAMPLING DATA

7. Sample ID	8. Pump No.	9. Sample Location	10. SAMPLING TIME			11. FLOW RATE OF PUMP (L/min)					12. Total Vol (L)	13. Wet Weight (g)	14. Dry Weight (g)
			Start Time	End Time	Total Mins	Start Flow	End Flow	Avg. Flow					
302/014	6	North side / John st. side - Nassau	2:30 PM	5:00	150	10	10	10	4500	2003	119		
302/015	2	North side / John st. side	2:35 PM	5:05	150	10	10	10	4500	2003	119		
302/016	1	North side / John st. side - William	2:37 PM	5:07	150	10	10	10	4500	2003	119		
		Blank											
		Blank											

CHAIN OF CUSTODYTurnaround Time: 2hrs 6hrs 24hrs 48hrs 72hrs

15. Relinquished by	16. Received by	17. Date	18. Time	19. Analysis Requested
A. Solaki				NIOSH 7400: <u> </u>
do				MIRA: <u> </u>
	E. S. S. S. S.	4/5/03	7:10 PM	OTHER: <u> </u>
				<u> </u>
				<u> </u>
				<u> </u>

New York City Department of Environmental Protection
 Bureau of Air, Noise & Hazardous Materials
 Division of Emergency Response and Technical Assessment
 96-05 Horace Harding Expressway
 Corona, New York 11368

APR-08-2003 15:39

BRUNN LABORATORY UNIT

P.02/06

APR-07-2003 17:04

59%

P.02

**AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM**

T03-04-007

PROJECT INFORMATION

1 PROJECT NAME:		2 ADDRESS: 66 JOHN STREET	3 HORO: MW
4 DATE: 4/5/03	5 AIR MONITOR: GEORGE ANAKHU		6 (a) Background: — (b) OSHA: — (c) Pre-Absorb: — (d) Post-Absorb: — (e) Absorbent: — (f) Ambient: — (g) PCM(0.8µMCE) — (h) TEM (0.45µMCE) —

AIR SAMPLING DATA

ROTORMETER No:

SAMPLING TIME

FLOW RATE OF PUMP (L/min)

1 Sample ID	2 Pump No.	3 Sample Location	4 Start Time	5 End Time	6 Total Mins	7 Start Flow	8 End Flow	9 Avg. Flow	10 Total Vol (L)	11 Air Str. CF
LAD3/017	17	9 th FL DOF/CENTRAL FILE (OUTSIDE OF)	2:40	5:10	150	10	10	10	1500	<0.050
018	18	9 th FL FILE 681 (OUTSIDE OF)	2:55	5:25	150	10	10	10	1500	<0.050
022	22	9 th FL LADIES ROOM (OUTSIDE OF)	3:00	5:30	150	10	10	10	1500	<0.050

CHAIN OF CUSTODY

Turnaround Time: 2hrs — 8hrs — 24hrs — 48hrs — 72hrs —

12 Relinquished by	13 Received by	14 Date	15 Time	16 Analysis Requested
GEORGE ANAKHU	A-Solokci	04/05/03	6:30 PM	NIOSH 2400: ☒ OTHER: ☒
George Anakhu	D. Lo			
	E. S. [Signature]	4/5/03	7:10 PM	

New York City Department of Environmental Protection
Bureau of Air, Noise & Hazardous Materials
Division of Emergency Response and Technical Assessment
96-05 Horace Harding Expressway
Corona, New York 11368

APR-08-2003 15:39

BAMM LABORATORY UNIT

P.03/06

(3)

**AIR MONITORING DATA SHEET
&
CHAIN OF CUSTODY FORM**

PROJECT INFORMATION

703-04-007

1. PROJECT NAME: ECB, Manhattan **2. ADDRESS:** 66 John St **3. BORO:** Manh

4. DATE: 4/5/03 **5. AIR MONITOR:** Emmanuel Brutus

6. (a) Background: **(b) OSMA:** **(c) Pre-Abate:** **(d) Post-Abate:**
(e) Abatement: **(f) Ambient:** **(g) PCM(0.8µMCE):** **(h) TEM (0.45µMCE):**

AIR SAMPLING DATAROTORMETER No: **SAMPLING TIME****FLOW RATE OF PUMP (L/min)**

7. Sample ID	8. Pump No.	9. Sample Location	10. Start Time	11. End Time	12. Total Mins	13. Start Flow	14. End Flow	15. Avg. Flow	16. Total Vol (L)	17. Avg. Temp (°C)	18. Humidity (%)
307/019		Next to 'DOF Imaging' Room	2:25	4:55	150	10	10	10	1500	1.045	41
307/020		Next to 'Central File' Room	2:27	4:37	150	10	9.5	9.75	1462.50	1.044	41
307/021		At the center front of vehicle #28 Floral Block	2:40	5:10	150	10	10	10	1500	1.044	41

CHAIN OF CUSTODYTurnaround Time: 2hrs 6hrs 24hrs 48hrs 72hrs

19. Relinquished by	20. Received by	21. Date	22. Time	23. Analysis Requested
E. Brutus	A. G. G. G.	04/05/03	5:30 PM	NIOSH 7400: <u> </u>
E. R.	J. R.			NIHRA: <u> </u>
	E. S. J. J.	4/5/03	7:10 PM	OTHER: <u> </u>

New York City Department of Environmental Protection
 Bureau of Air, Noise & Hazardous Materials
 Division of Emergency Response and Technical Assessment
 96-05 Horace Harding Expressway
 Corona, New York 11368

APR-08-2003 15:40

BAMM LABORATORY UNIT

P. 04/06

APR-07-2003 17:05

97%

P. 04

**ATHENICA**

ENVIRONMENTAL SERVICES INC.

Tel (718) 784-7490

Fax (718) 784-4085

AIRBORNE ASBESTOS ANALYSIS BY TRANSMISSION ELECTRON MICROSCOPY

CLIENT: NYC DEP

LABORATORY ID #: T03-04-007

ANALYT. METHODOLOGY: AHERA

FILTER TYPE: M.C.E.

AVERAGE G.O. AREA (mm²): 0.012820

PROJECT: 59 Maiden Lane & 66 John Street.

DATE OF REPORT: 04/07/03

DATE OF ANALYSIS: 04/05/03

EFFECTIVE FILTER AREA (mm²): 385**LABORATORY RESULTS**

CLIENT #	CAS. ID #	LOCATION	VOLUME (ft ³)	G.O. ANALYZED	AREA ANALYZED (mm ²)	ANALYT. SENSITIV. (struct./cm ²)	TOTAL ASBESTOS AIR CONC. (struct./cm ³)	TOTAL ASBESTOS FILTER CONC. (ft ³ /mm ²)	AIR CONC. FOR STRUCT. 0.5-5.0 μm	AIR CONC. FOR STRUCT. 5-20 μm	ASBEST. TYPE CHRVS.	AMPHIB. ASBEST. TYPE SPECIFY
Lab3/022	T03-04-007-656	9 th floor ladies room (outside of)	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
307/019	T03-04-007-657	Next to DOF imaging room	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
307/020	T03-04-007-658	Next to Central file room	1462.50	5	0.0641	0.0041	<0.0041	<15.60	NA	NA	NA	NA
307/021	T03-04-007-659	At the center in front of cubicle #28	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA

ANALYST
E. Sioukri

LABORATORY DIRECTOR
Spiro Dongaris**LABORATORY CERTIFICATION NUMBERS: NVLAP 101958, ELAP 10955**

- Athenica Environmental Services Inc. (AES), is responsible only for information pertaining to samples taken by its employees.
- Air sampling cassettes will be stored for sixty (60) days. AES Inc., should be notified within this time frame for a true duplicate analysis.
- If AES Inc., did not conduct the sampling, the reported airborne concentration was derived based on information provided by the client. Under these circumstances, the air concentration data is supplied solely for the convenience of the client.
- The report relates only to items tested. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. Test reports may not be reproduced except in full and with prior approval of AES Inc.
- The liability of Athenica Environmental Services Inc. with respect to the services charged, shall in no event exceed the amount of the invoice.

**ATHENICA**

ENVIRONMENTAL SERVICES INC.

Tel (718) 784-7490

Fax (718) 784-4085

AIRBORNE ASBESTOS ANALYSIS BY TRANSMISSION ELECTRON MICROSCOPY

CLIENT: NYC DEP

LABORATORY ID #: T03-04-007

ANALYT. METHODOLOGY: AHERA

FILTER TYPE: M.C.E.

AVERAGE G.O. AREA (mm²): 0.012820

PROJECT: 59 Maiden Lane & 66 John Street.

DATE OF REPORT: 04/07/03

DATE OF ANALYSIS: 04/05/03

EFFECTIVE FILTER AREA (mm²): 385**LABORATORY RESULTS**

CLIENT #	LAD. ID #	LOCATION	VOLUME (L)	G.O.'s ANALYZED	AREA ANALYZED (mm ²)	ANALYT. SENSITIV. (struc./cm ³)	TOTAL ASBESTOS AIR CONC. (struc./cm ³)	TOTAL ASBESTOS FILTER CONC. (struc./cm ³)	AIR CONC. FOR STRUCT. 0.5<S<5µm	AIR CONC. FOR STRUCT. S≥5.0µm	ASBEST. TYPE CHRYS.	AMPHIB. ASBEST. TYPE SPECIFY
302/014	T03-04-007-651	North side/John St. side - Nassau	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/015	T03-04-007-652	North side/John St. side	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
302/016	T03-04-007-653	North side/John St. side - William	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
Lab3/017	T03-04-007-654	9 th floor DOP/central file (outside of)	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA
Lab3/018	T03-04-007-655	9 th floor file 681 (outside of)	1500	4	0.0513	0.0050	<0.0050	<19.50	NA	NA	NA	NA

ANALYST
E. Sioukri

LABORATORY DIRECTOR
Spiro Dongaris**LABORATORY CERTIFICATION NUMBERS: NVLAP 101958, ELAP 10955**

- Athenica Environmental Services Inc. (AES), is responsible only for information pertaining to samples taken by its employees.
- Air sampling cassettes will be stored for sixty (60) days. AES Inc., should be notified within this time frame for a true duplicate analysis.
- If AES Inc., did not conduct the sampling, the reported airborne concentration was derived based on information provided by the client. Under these circumstances, the air concentration data is supplied solely for the convenience of the client.
- The report relates only to items tested. This report must not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. Test reports may not be reproduced except in full and with prior approval of AES Inc.
- The liability of Athenica Environmental Services Inc. with respect to the services charged, shall in no event exceed the amount of the invoice.

TOTAL P.06

Nassau St

66 JOHN ST

4/5/03

William St

A

B

D

North

West

East

South

Sample

59 Maiden Lane

9th Floor

