

ATC Associates

104 East 25 Street, New York, NY 10010

Phone: (212) 353-8280 Fax: (212) 353-8306



Attn: Mr. Fabio Pedone
 Warren & Panzer Engineers, P.C.
 228 E. 45th Street
 New York NY 10017
 Fax: (212) 922-0630 Phone: (212) 922-0077

Received: 7/1/02 3:00:00 PM
 ATC Group #: 8368
 Analysis Date: 7/1/02

Project: NYC-DEP W & P File #: 1079.01.02
 30 West Broadway

**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM) Performed
 by EPA 40 CFR Part 763 Final Rule (AHERA)**

Sample	Volume	Area Analyzed	Non Ash	Asbestos Type(s)	# Structures 0.5µ-5 µ	Analytical Sensitivity (S/cc)	Asbestos Concentration (S/mm ²)	(S/cc)	Notes
01 8368 -1	1800.00	0.0450	0	None Detected	0	0	0.0048	<22.24	<0.0048
02 8368 -2	1800.00	0.0450	0	None Detected	0	0	0.0048	<22.24	<0.0048
03 8368 -3	1800.00	0.0450	0	None Detected	0	0	0.0048	<22.24	<0.0048
04 8368 -4	1800.00	0.0450	0	None Detected	0	0	0.0048	<22.24	<0.0048
05 8368 -5	1800.00	0.0450	0	None Detected	0	0	0.0048	<22.24	<0.0048

ROMAN PEYSAKHOV

Analyzed by:

MICHAEL A. GORYCKI, Ph.D.

Approved by:

Disclaimer: The laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This lab is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by ATC Associates Inc. This report may not be used to claim product endorsement by NVLAP or any other agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysis accuracy and precision) is available upon request.

Accredited for NVLAP PLM/TEM #101187-0, NY State ELAP #10879

Page 1 of 1

228 East 45th Street
New York, NY 10017
(212) 922-0077
Fax (212) 922-0830

8368

WARREN & PANZER ENGINEERS, P. C.

AIR MONITORING LOG SHEET/CHAIN-OF-CUSTODY FORM

24 hr⁺/a 12 hr⁺/a 6 hr⁺/a 3 hr⁺/a Immediate ⁺/a

W&P FILE #: 1079-01-02

CONTACT:

LABORATORY: ATC

CLIENT: NYC DEP

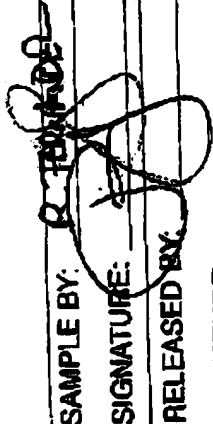
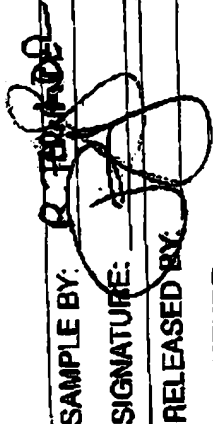
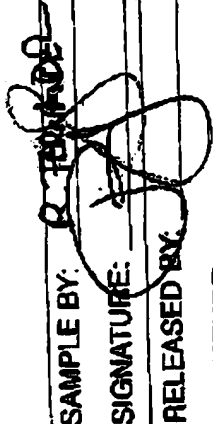
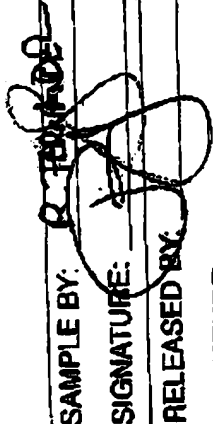
PROJECT: 30 W BROWNY
ANALYSIS METHOD: PCM (TEM) TEM
circle one 7400 AHERA EPA LEVEL II

LOCATION: ROOF # 2 (ENT)

TECHNICIAN: R. FERNANDEZ

SAMPLE NUMBER	SAMPLE DESCRIPTION/LOCATION	SAMPLE TYPE	PUMP #	FLOWRATE START	STOP	ON	TIME OFF	TOTAL TIME	VOLUME (liters)	CONCENTR (lb./cc.)
01	ENTRANCE TO ROOF	3		5.0	5.0	0720	1320	360	1800	
02	DECON	3		5.0	5.0	0722	1322	1	1	
03	STAIRWELL (A)	3		5.0	5.0	0724	1324	1	1	
04	IWA EAST SIDE ROOF	3		5.0	5.0	0726	1328			
05	IWA WEST "	3		5.0	5.0	0730	1330	360	1800	
06	TB	1				NA				
07	TB	1				NA				

COMMENTS:

SAMPLE BY: R. FERNANDEZ
SIGNATURE: 
RELEASED BY: 
SIGNATURE: 
RECEIVED BY: ATC
SIGNATURE: 
DATE: 7-1-02
DATE: 7/1/02
DATE: 7/1/02
DATE: 7/1/02

SAMPLE TYPE CODES

1 - Blank	5 - Final Clearance (inside)
2 - Pre-Abatement	6 - Final Clearance (outside)
3 - During Abatement	7 - Personal
4 - During Glove Bag Removal	8 - Background

SEE REVERSE SIDE FOR ANALYSIS INFORMATION



ATC Associates Inc.

104 East 25 Street
New York, NY 10010

TEL: (212) 353-8280 FAX: (212) 353-8306

FACSIMILE TELECOPY TRANSMISSION

To: Mr. Fabio Pedone
Warren & Panzer Engineers, P.C.

From: ROMAN PEYSAKHOV

Fax #: (212) 922-0630

ATC Group #: 8368

Date: Monday, July 01, 2002

Client Project: NYC-DEP W & P File #: 1079.01.02
30 West Broadway

Time: 11:19:18 PM

Number of Pages: 3
(including cover page)

Comments:

7