


Asbestos Sampling Location

Location #	Sampling Date	PCM (ppb)
1	9/13	0.039
2	9/13	0.039
3	9/13-9/14	<0.005-0.005
4	9/13	<0.005
5	9/13	0.039
6	9/13	0.039
7	9/13	0.039
8	9/13	0.039
9	9/13	0.039
10	9/13	0.039
11	9/13	0.039
12	9/13	0.039
13	9/13	0.039
14	9/13	0.039
15	9/13	0.039
16	9/13	0.039
17	9/13	0.039
18	9/13	0.039
19	9/13	0.039
20	9/13	0.039
21	9/13	0.039
22	9/13	0.039
23	9/13	0.039
24	9/13	0.039
25	9/13	0.039
26	9/13	0.039
27	9/13	0.039
28	9/13	0.039
29	9/13	0.039
30	9/13	0.039
31	9/13	0.039
32	9/13	0.039
33	9/13	0.039
34	9/13	0.039
35	9/13	0.039
36	9/13	0.039
37	9/13	0.039
38	9/13	0.039
39	9/13	0.039
40	9/13	0.039
41	9/13	0.039
42	9/13	0.039
43	9/13	0.039
44	9/13	0.039
45	9/13	0.039
46	9/13	0.039
47	9/13	0.039
48	9/13	0.039
49	9/13	0.039
50	9/13	0.039
51	9/13	0.039
52	9/13	0.039
53	9/13	0.039
54	9/13	0.039
55	9/13	0.039
56	9/13	0.039
57	9/13	0.039
58	9/13	0.039
59	9/13	0.039
60	9/13	0.039
61	9/13	0.039
62	9/13	0.039
63	9/13	0.039
64	9/13	0.039
65	9/13	0.039
66	9/13	0.039
67	9/13	0.039
68	9/13	0.039
69	9/13	0.039
70	9/13	0.039
71	9/13	0.039
72	9/13	0.039
73	9/13	0.039
74	9/13	0.039
75	9/13	0.039
76	9/13	0.039
77	9/13	0.039
78	9/13	0.039
79	9/13	0.039
80	9/13	0.039
81	9/13	0.039
82	9/13	0.039
83	9/13	0.039
84	9/13	0.039
85	9/13	0.039
86	9/13	0.039
87	9/13	0.039
88	9/13	0.039
89	9/13	0.039
90	9/13	0.039
91	9/13	0.039
92	9/13	0.039
93	9/13	0.039
94	9/13	0.039
95	9/13	0.039
96	9/13	0.039
97	9/13	0.039
98	9/13	0.039
99	9/13	0.039
100	9/13	0.039

LOQ = Limit of Quantification
Revised 9/26/01 - 2:00 PM

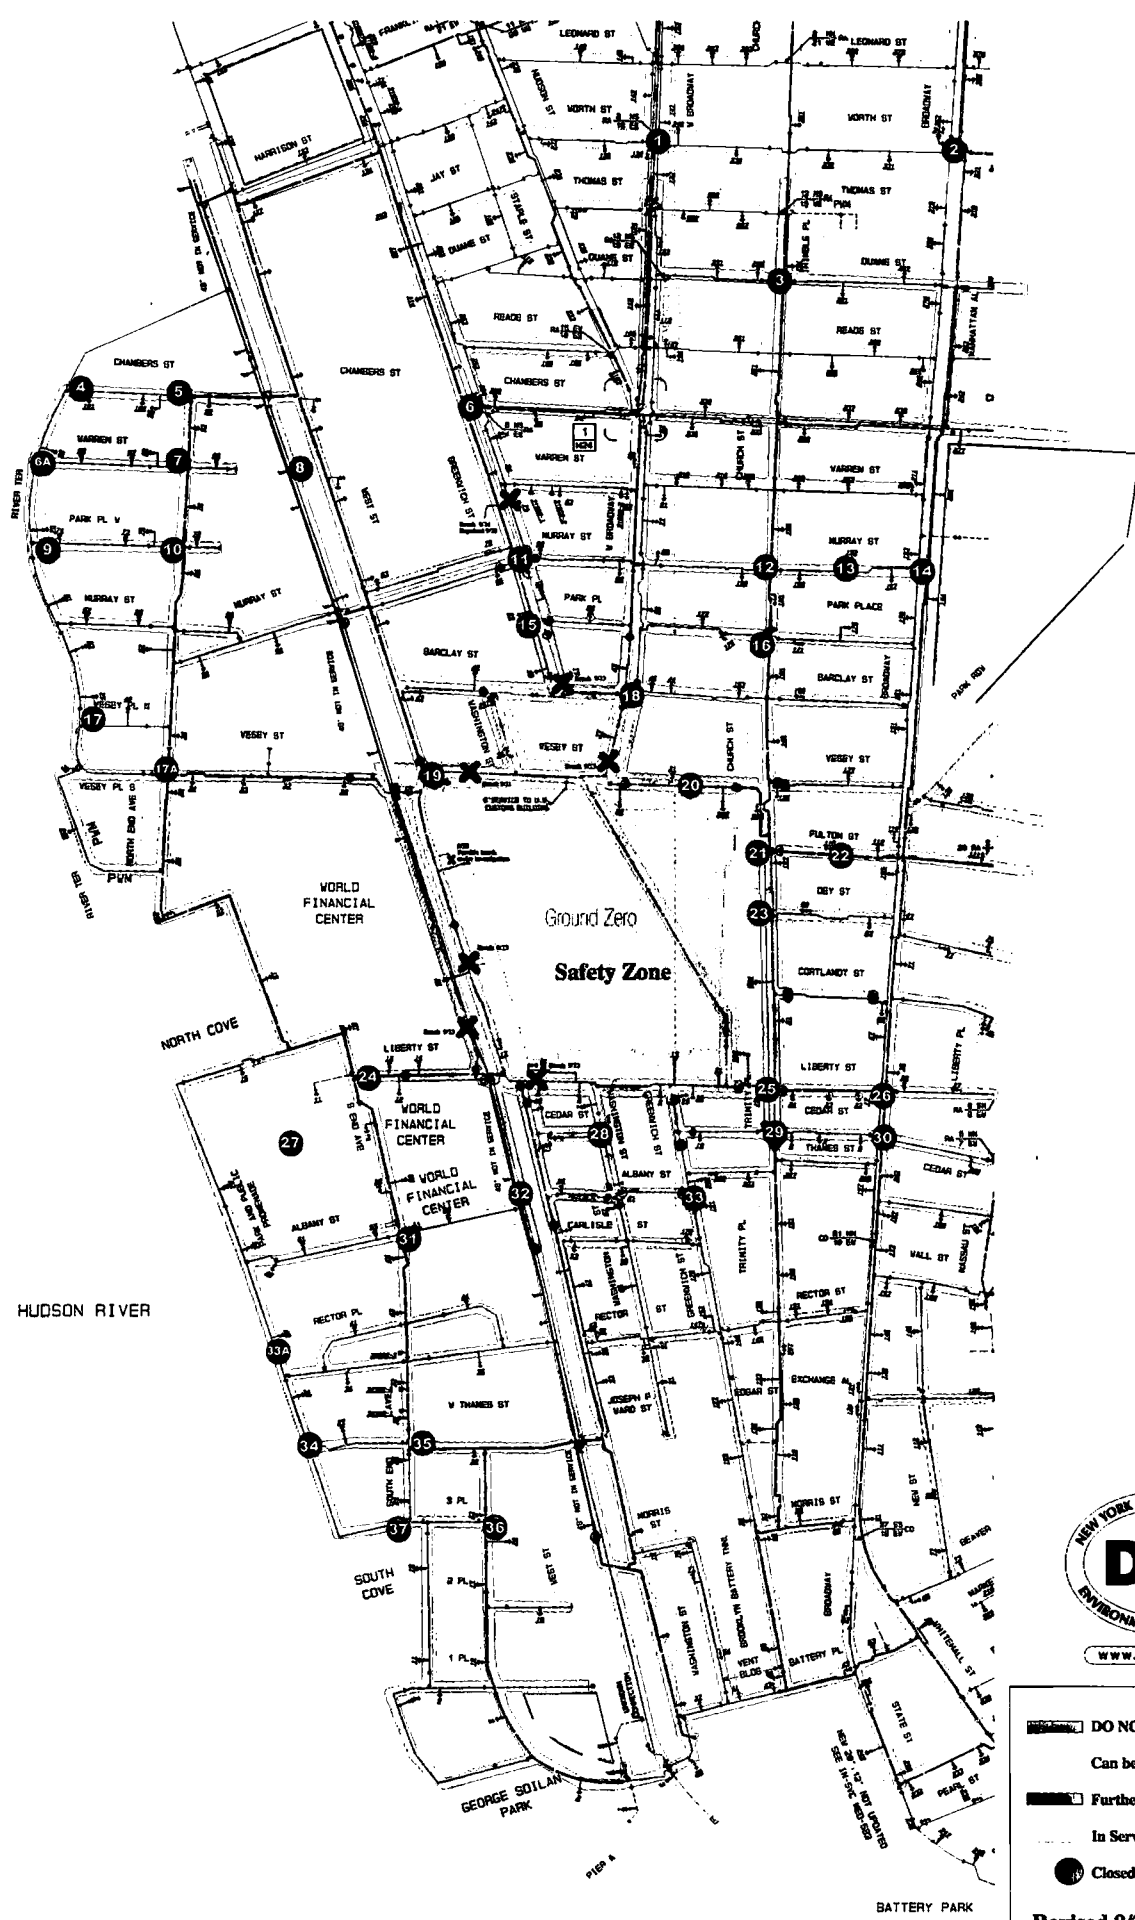

DO NOT Restore at This Time

Can be Restored

Further Investigation Necessary

In Service

Closed Valve

Revised 9/26/01 - 8:00 AM


Safety Zone

Asbestos Sampling Location

Location #	Sampling Date	PCB (ppb)
1	9/12	0.002
2	9/12	0.002
3	9/12-9/14	<0.002-0.003
4	9/12	0.002
5	9/12	0.002
6	9/12	0.002
7	9/12	0.002
8	9/12	0.002
9	9/12	0.002
10	9/12	0.002
11	9/12	0.002
12	9/12	0.002
13	9/12	0.002
14	9/12	0.002
15	9/12	0.002
16	9/12	0.002
17	9/12	0.002
18	9/12	0.002
19	9/12	0.002
20	9/12	0.002
21	9/12	0.002
22	9/12	0.002
23	9/12	0.002
24	9/12	0.002
25	9/12	0.002
26	9/12	0.002
27	9/12	0.002
28	9/12	0.002
29	9/12	0.002
30	9/12	0.002
31	9/12	0.002
32	9/12	0.002
33	9/12	0.002
34	9/12	0.002
35	9/12	0.002
36	9/12	0.002
37	9/12	0.002
38	9/12	0.002
39	9/12	0.002
40	9/12	0.002
41	9/12	0.002
42	9/12	0.002
43	9/12	0.002
44	9/12	0.002
45	9/12	0.002
46	9/12	0.002
47	9/12	0.002
48	9/12	0.002
49	9/12	0.002
50	9/12	0.002
51	9/12	0.002
52	9/12	0.002
53	9/12	0.002
54	9/12	0.002
55	9/12	0.002
56	9/12	0.002
57	9/12	0.002
58	9/12	0.002
59	9/12	0.002
60	9/12	0.002
61	9/12	0.002
62	9/12	0.002
63	9/12	0.002
64	9/12	0.002
65	9/12	0.002
66	9/12	0.002
67	9/12	0.002
68	9/12	0.002
69	9/12	0.002
70	9/12	0.002
71	9/12	0.002
72	9/12	0.002
73	9/12	0.002
74	9/12	0.002
75	9/12	0.002
76	9/12	0.002
77	9/12	0.002
78	9/12	0.002
79	9/12	0.002
80	9/12	0.002
81	9/12	0.002
82	9/12	0.002
83	9/12	0.002
84	9/12	0.002
85	9/12	0.002
86	9/12	0.002
87	9/12	0.002
88	9/12	0.002
89	9/12	0.002
90	9/12	0.002
91	9/12	0.002
92	9/12	0.002
93	9/12	0.002
94	9/12	0.002
95	9/12	0.002
96	9/12	0.002
97	9/12	0.002
98	9/12	0.002
99	9/12	0.002
100	9/12	0.002

LOQ = Limit of Quantification

Revised 9/26/01 - 2:00 PM

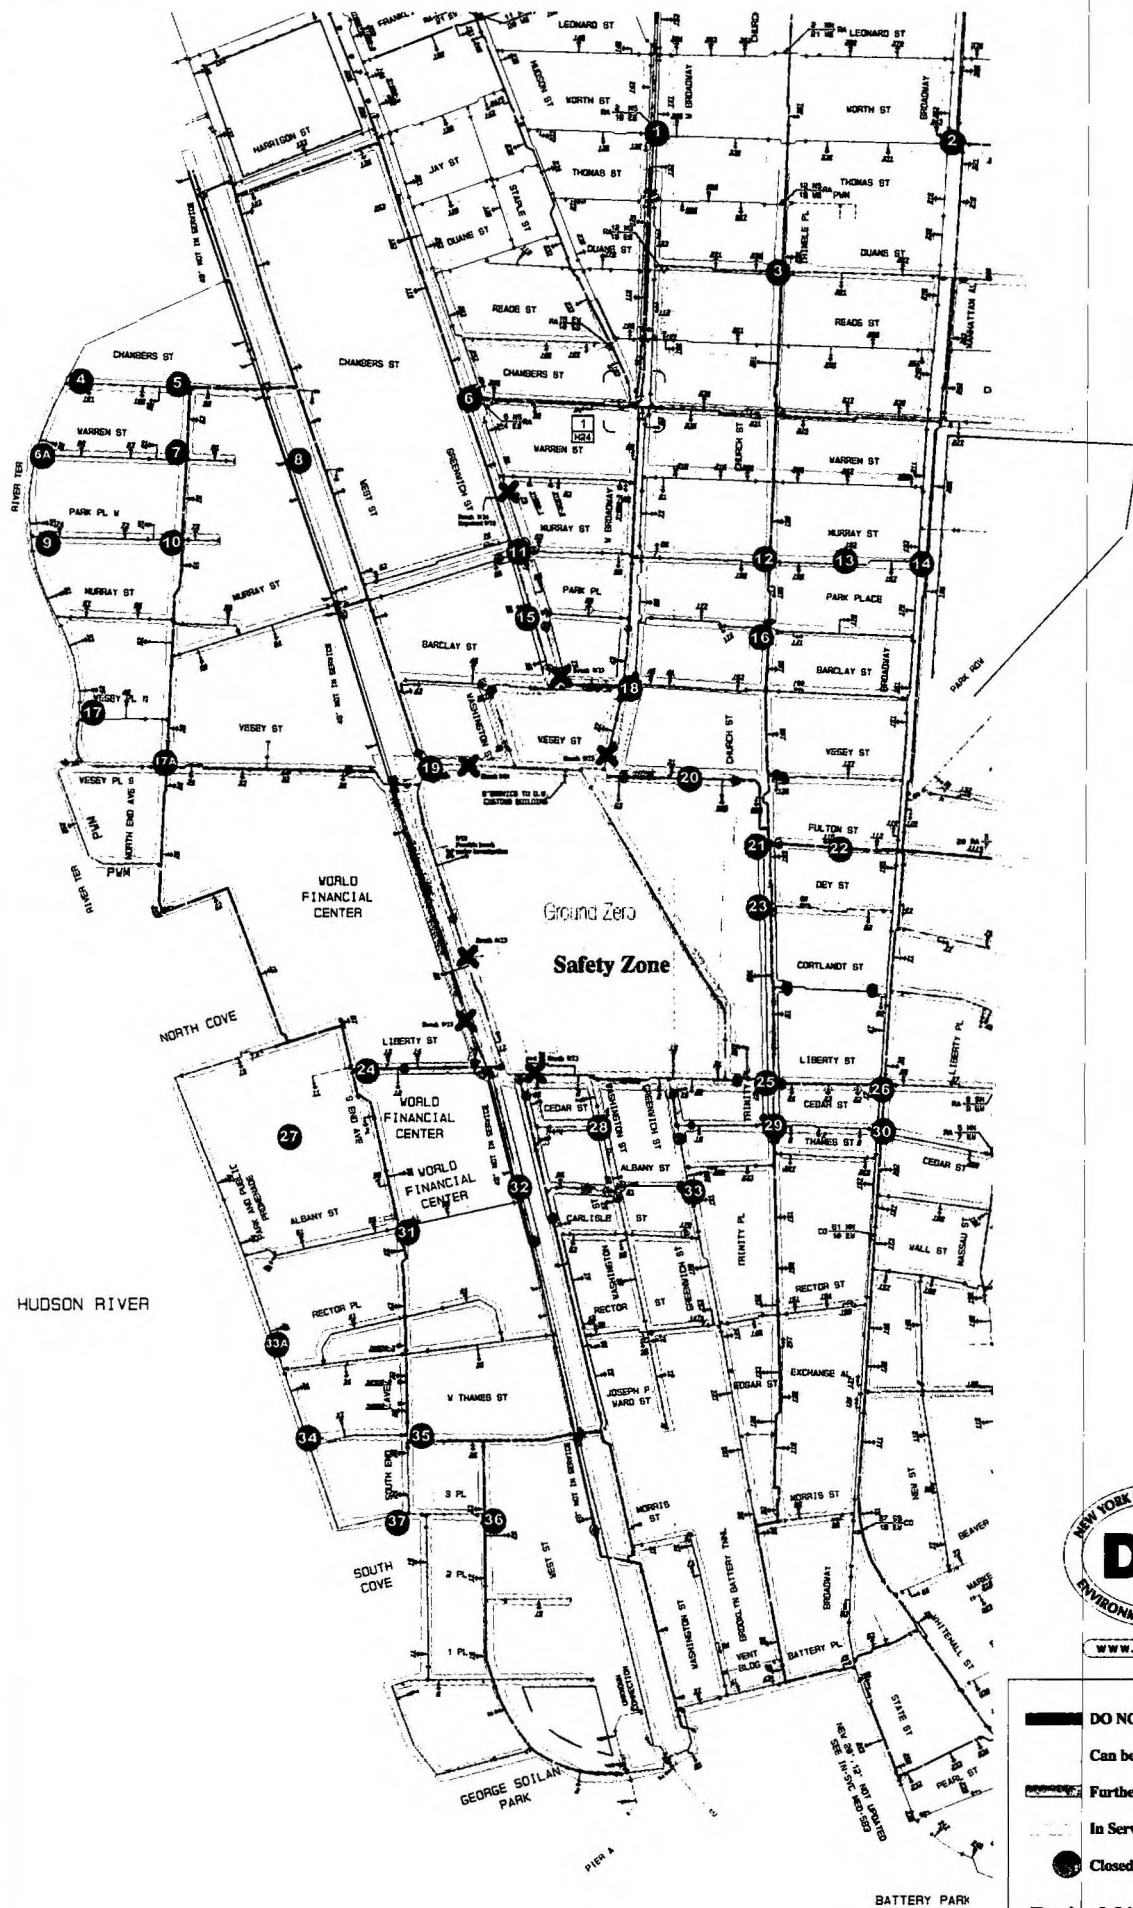

DO NOT Restore at This Time

Can be Restored

Further Investigation Necessary


In Service

Closed Valve


Revised 9/26/01 - 8:00 AM

Safety Zone

New York City — Lower Manhattan



Lower
Manhat-
tan

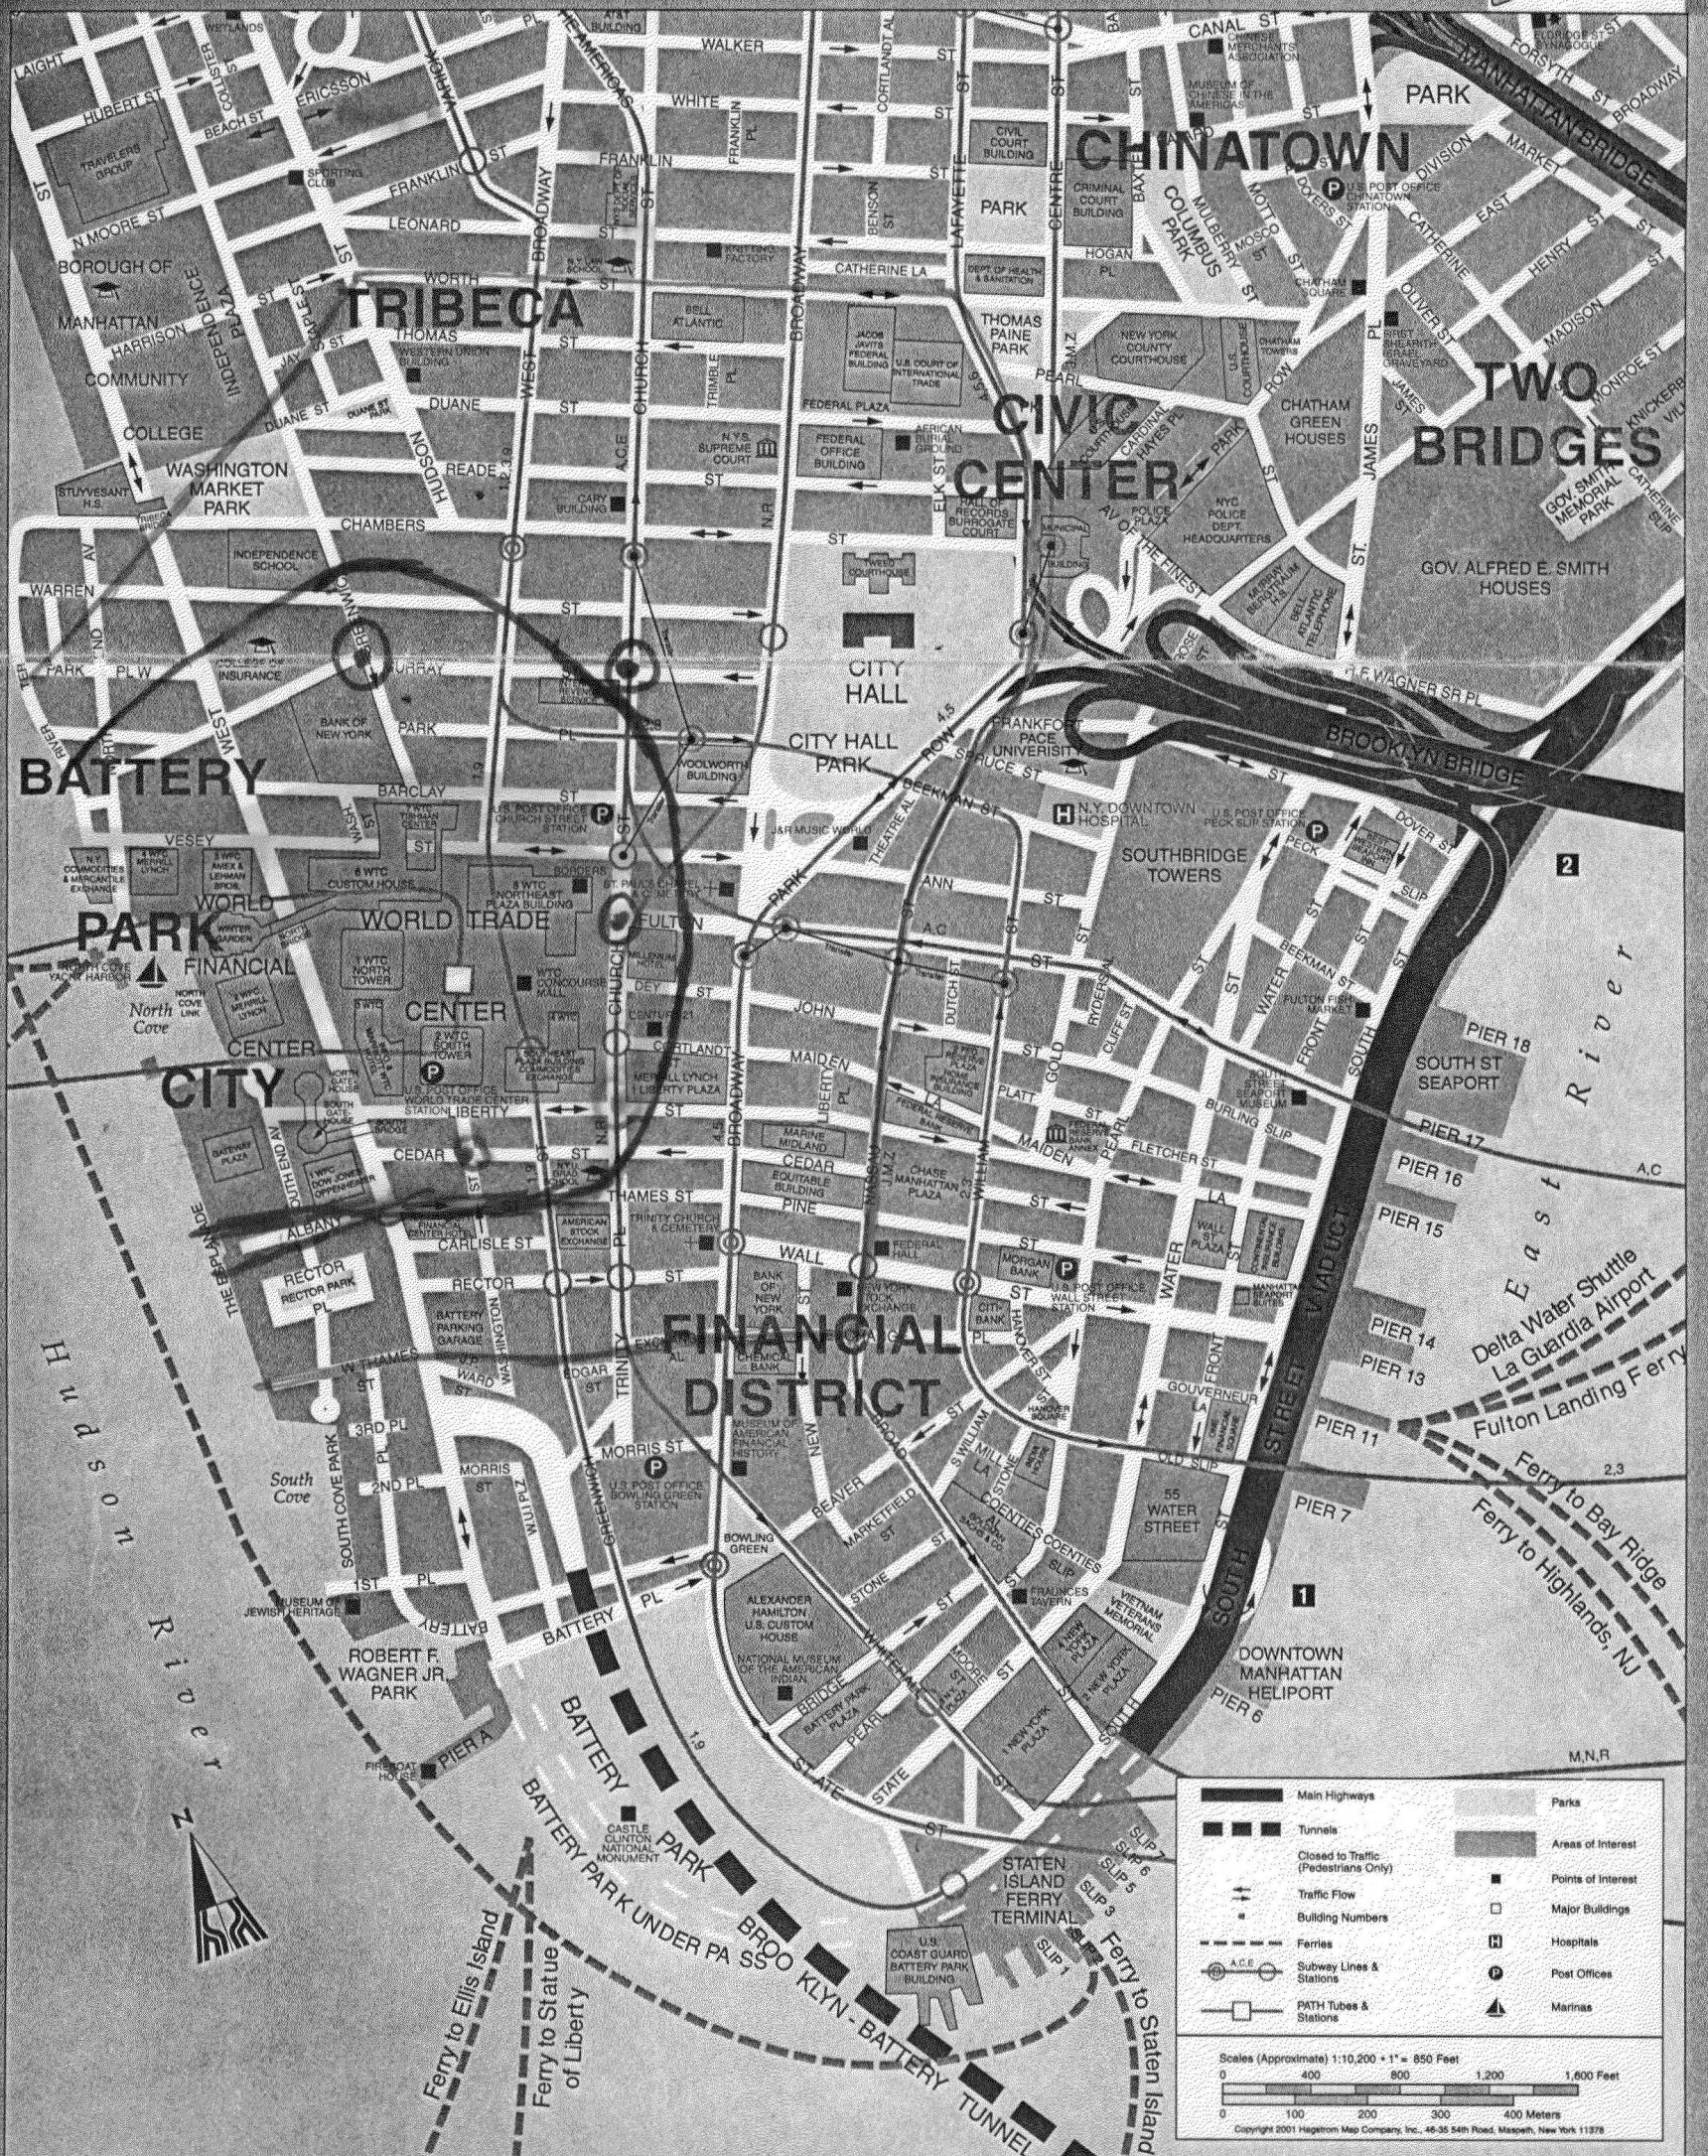



DEF


Feb 17 1998 535-3557


Sep 27 2001 12:33

P.01

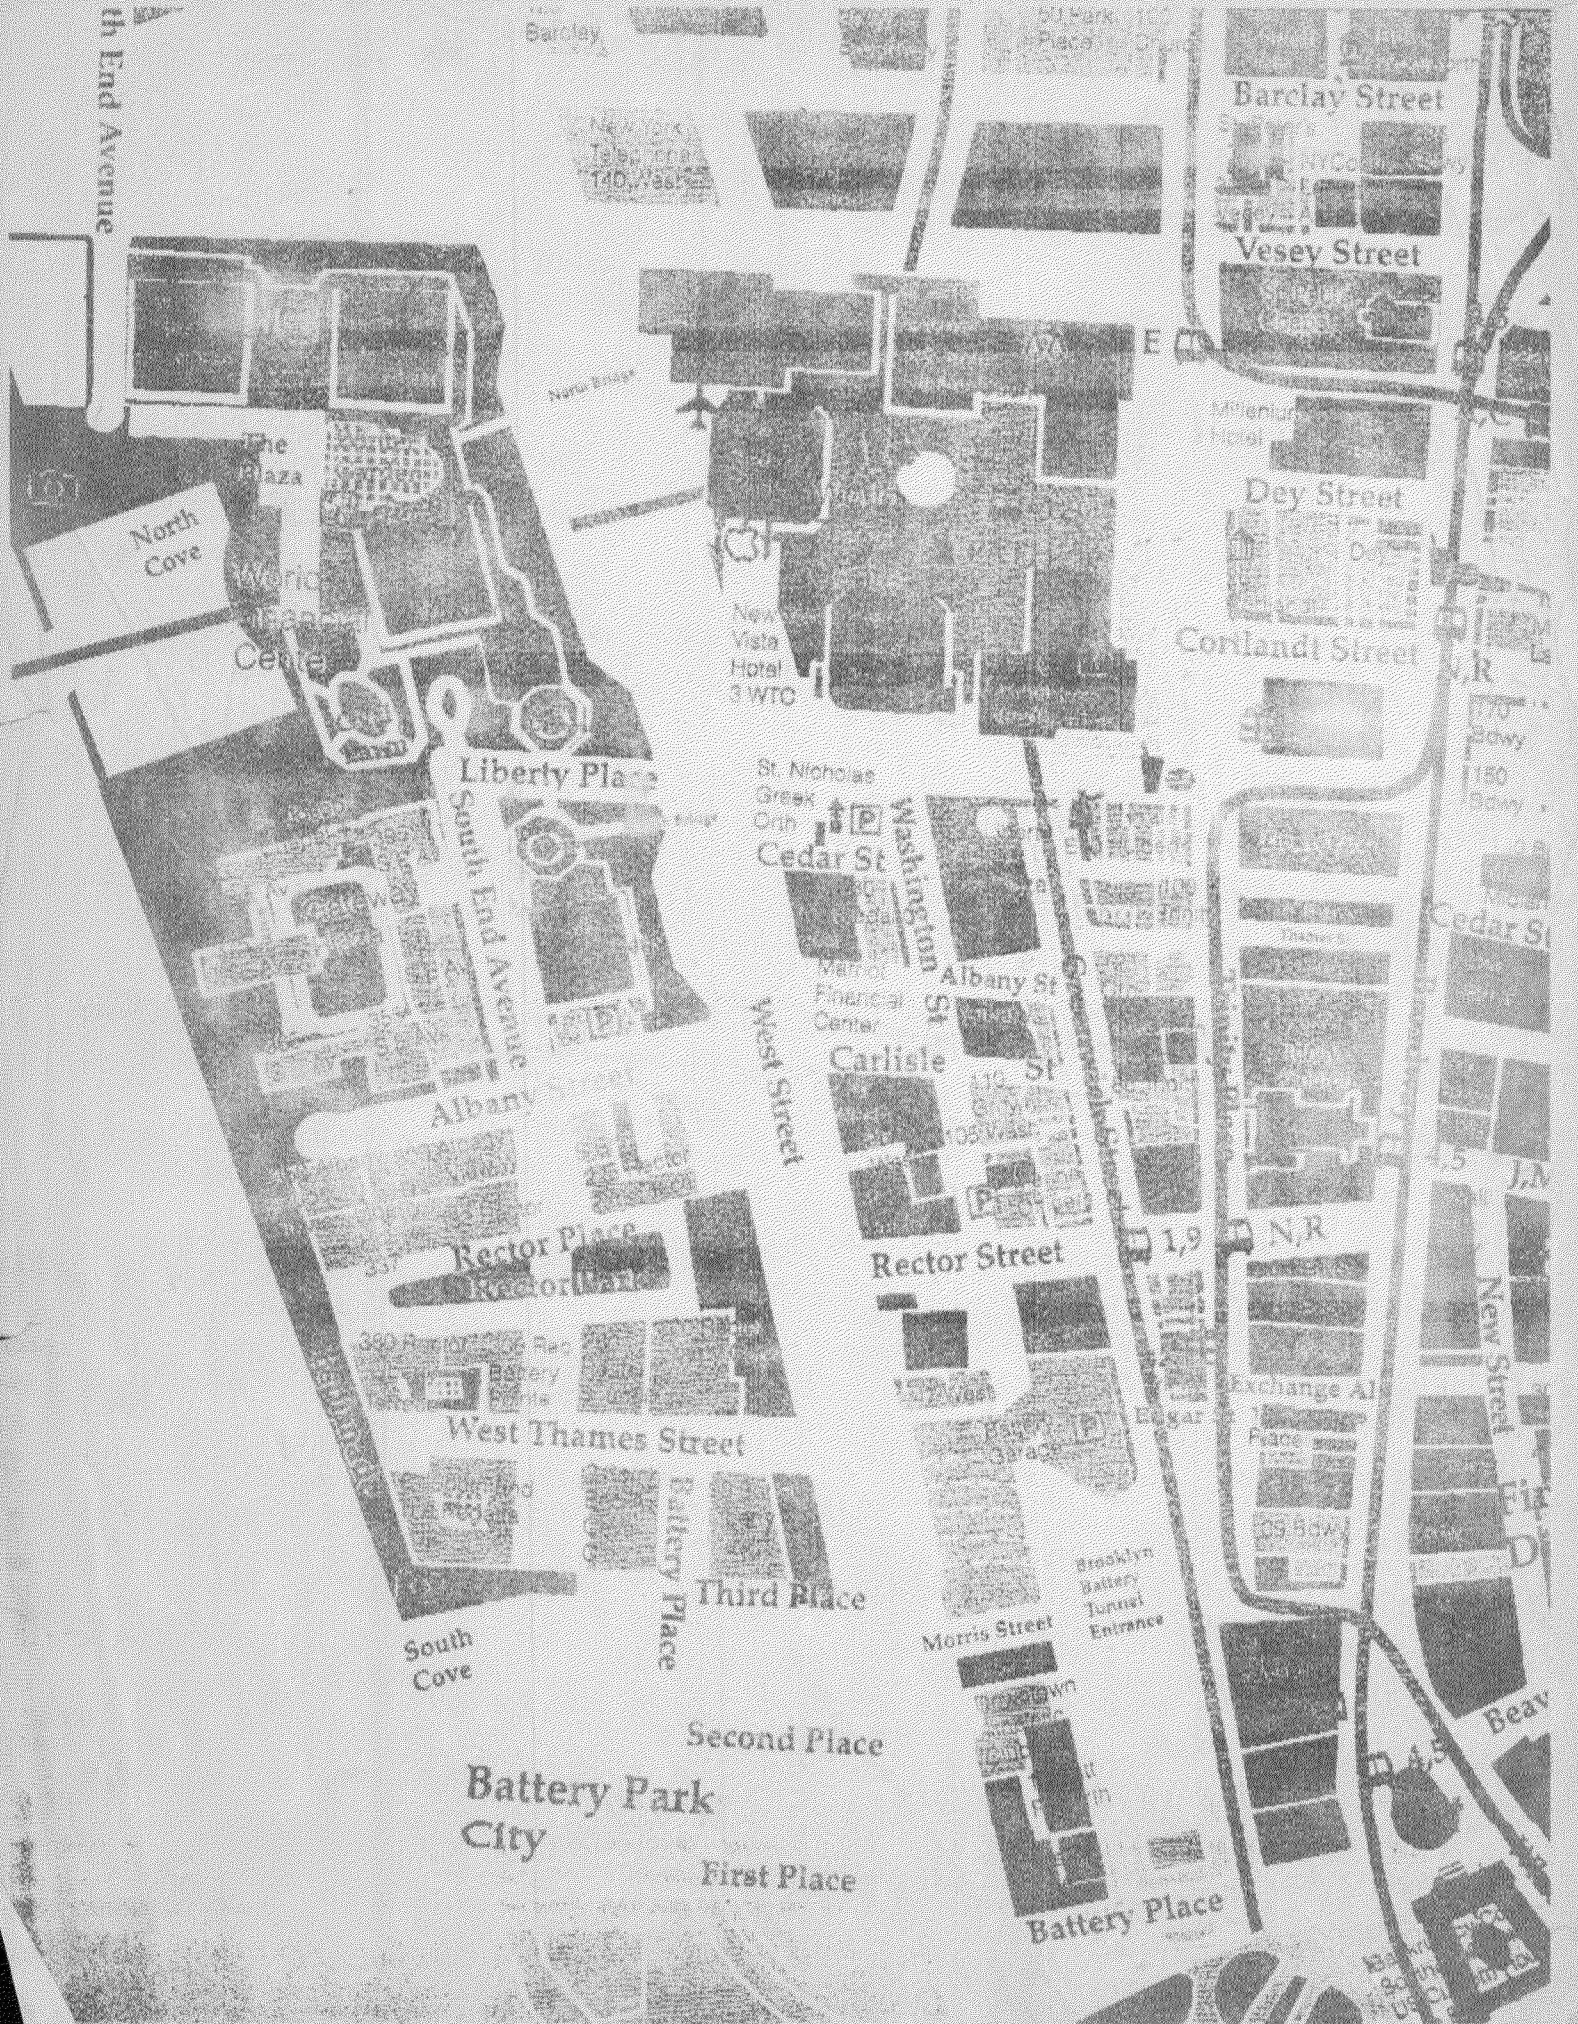

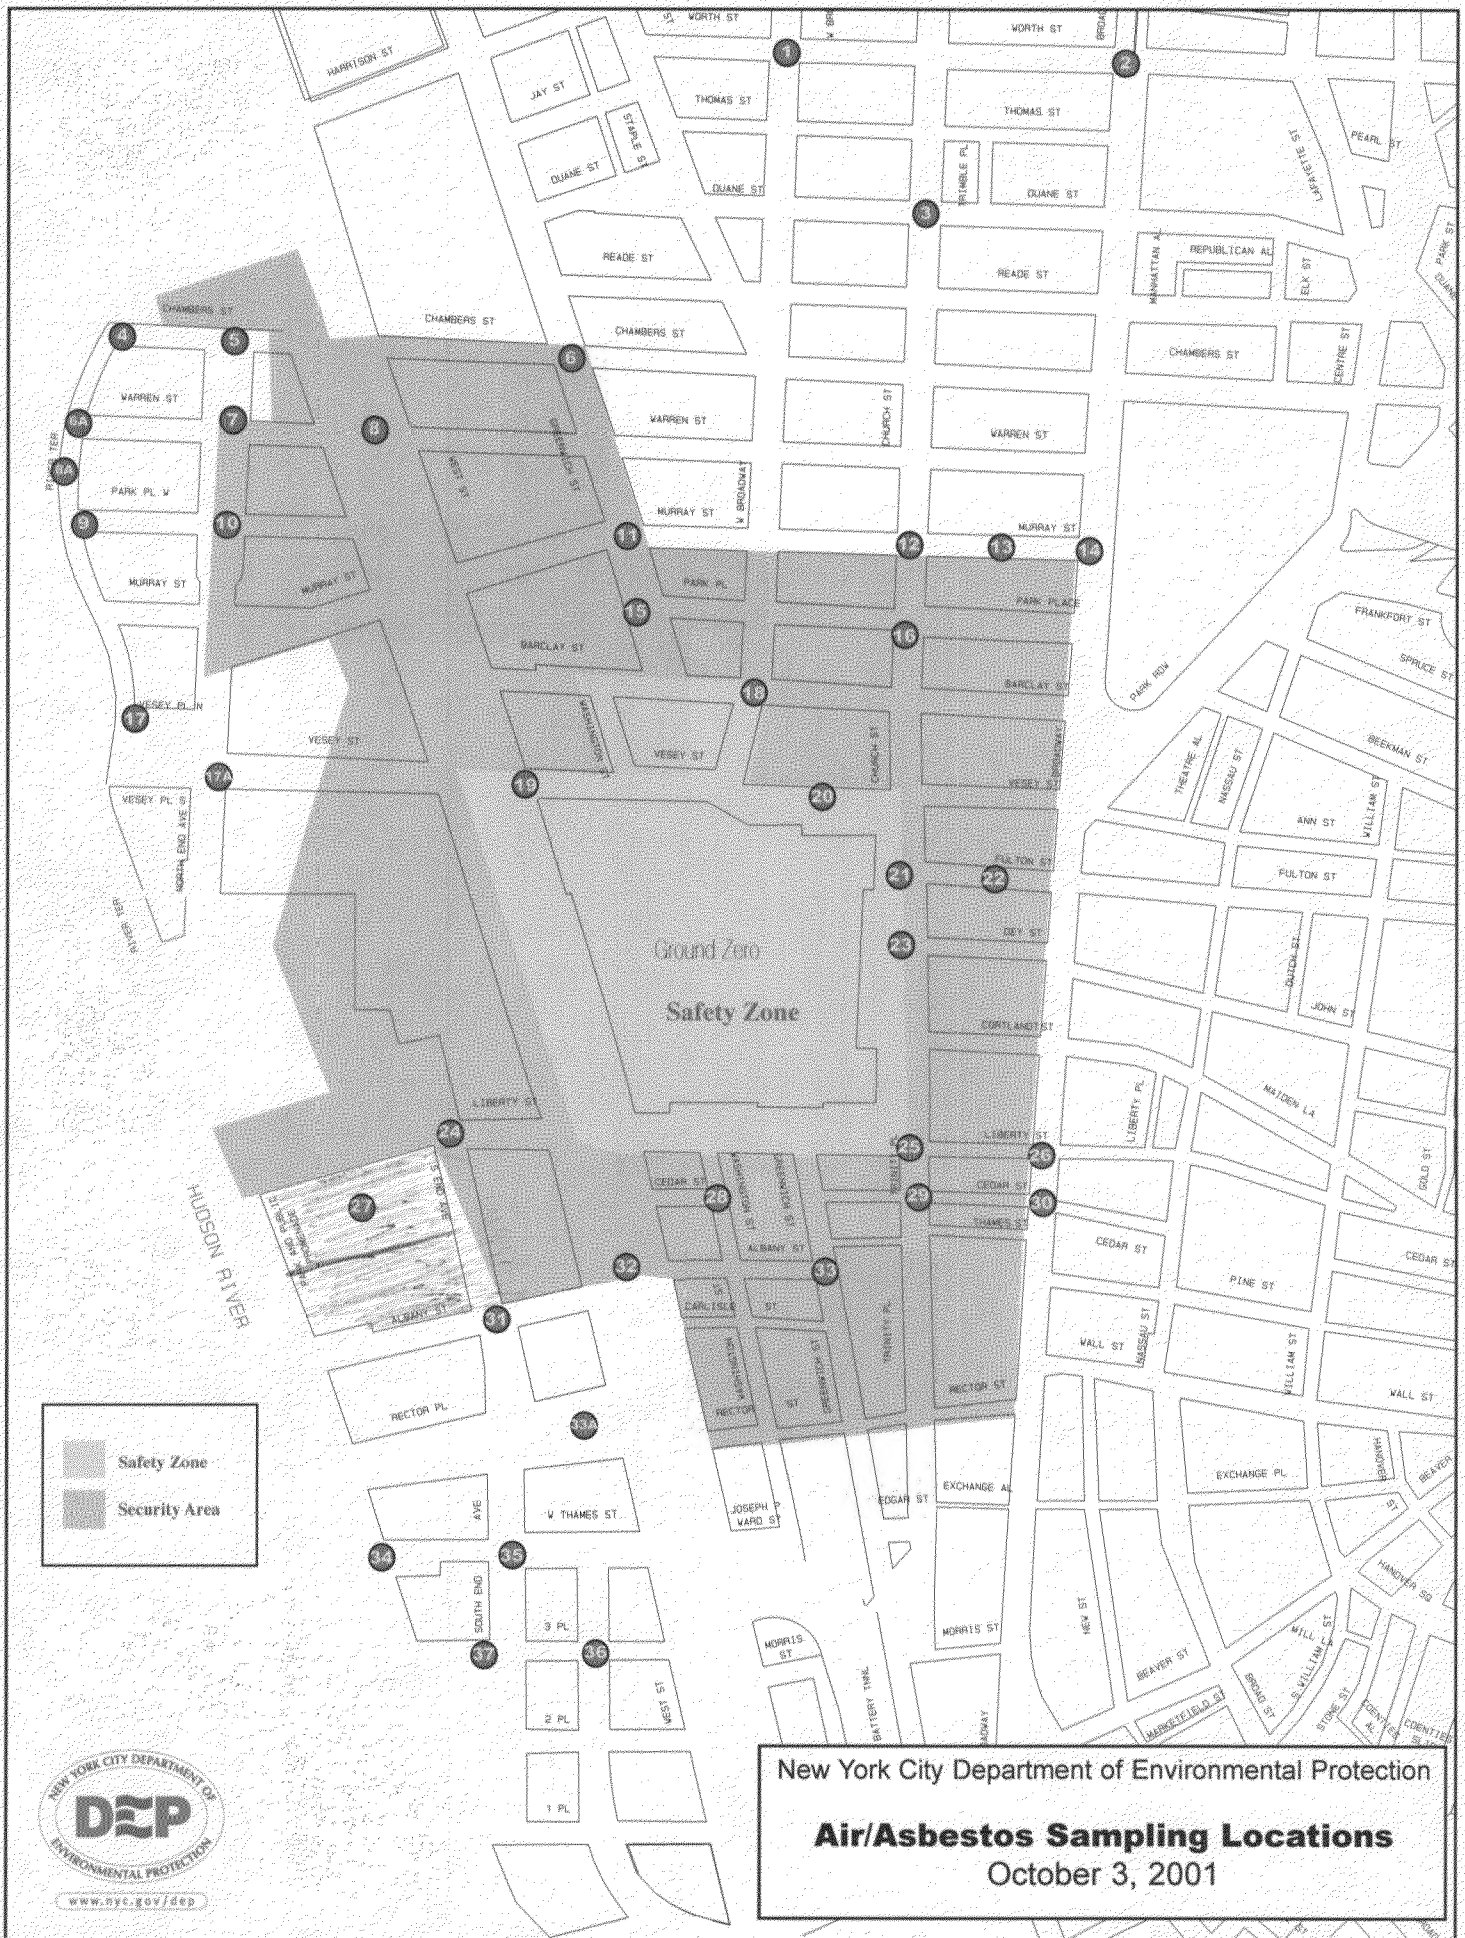

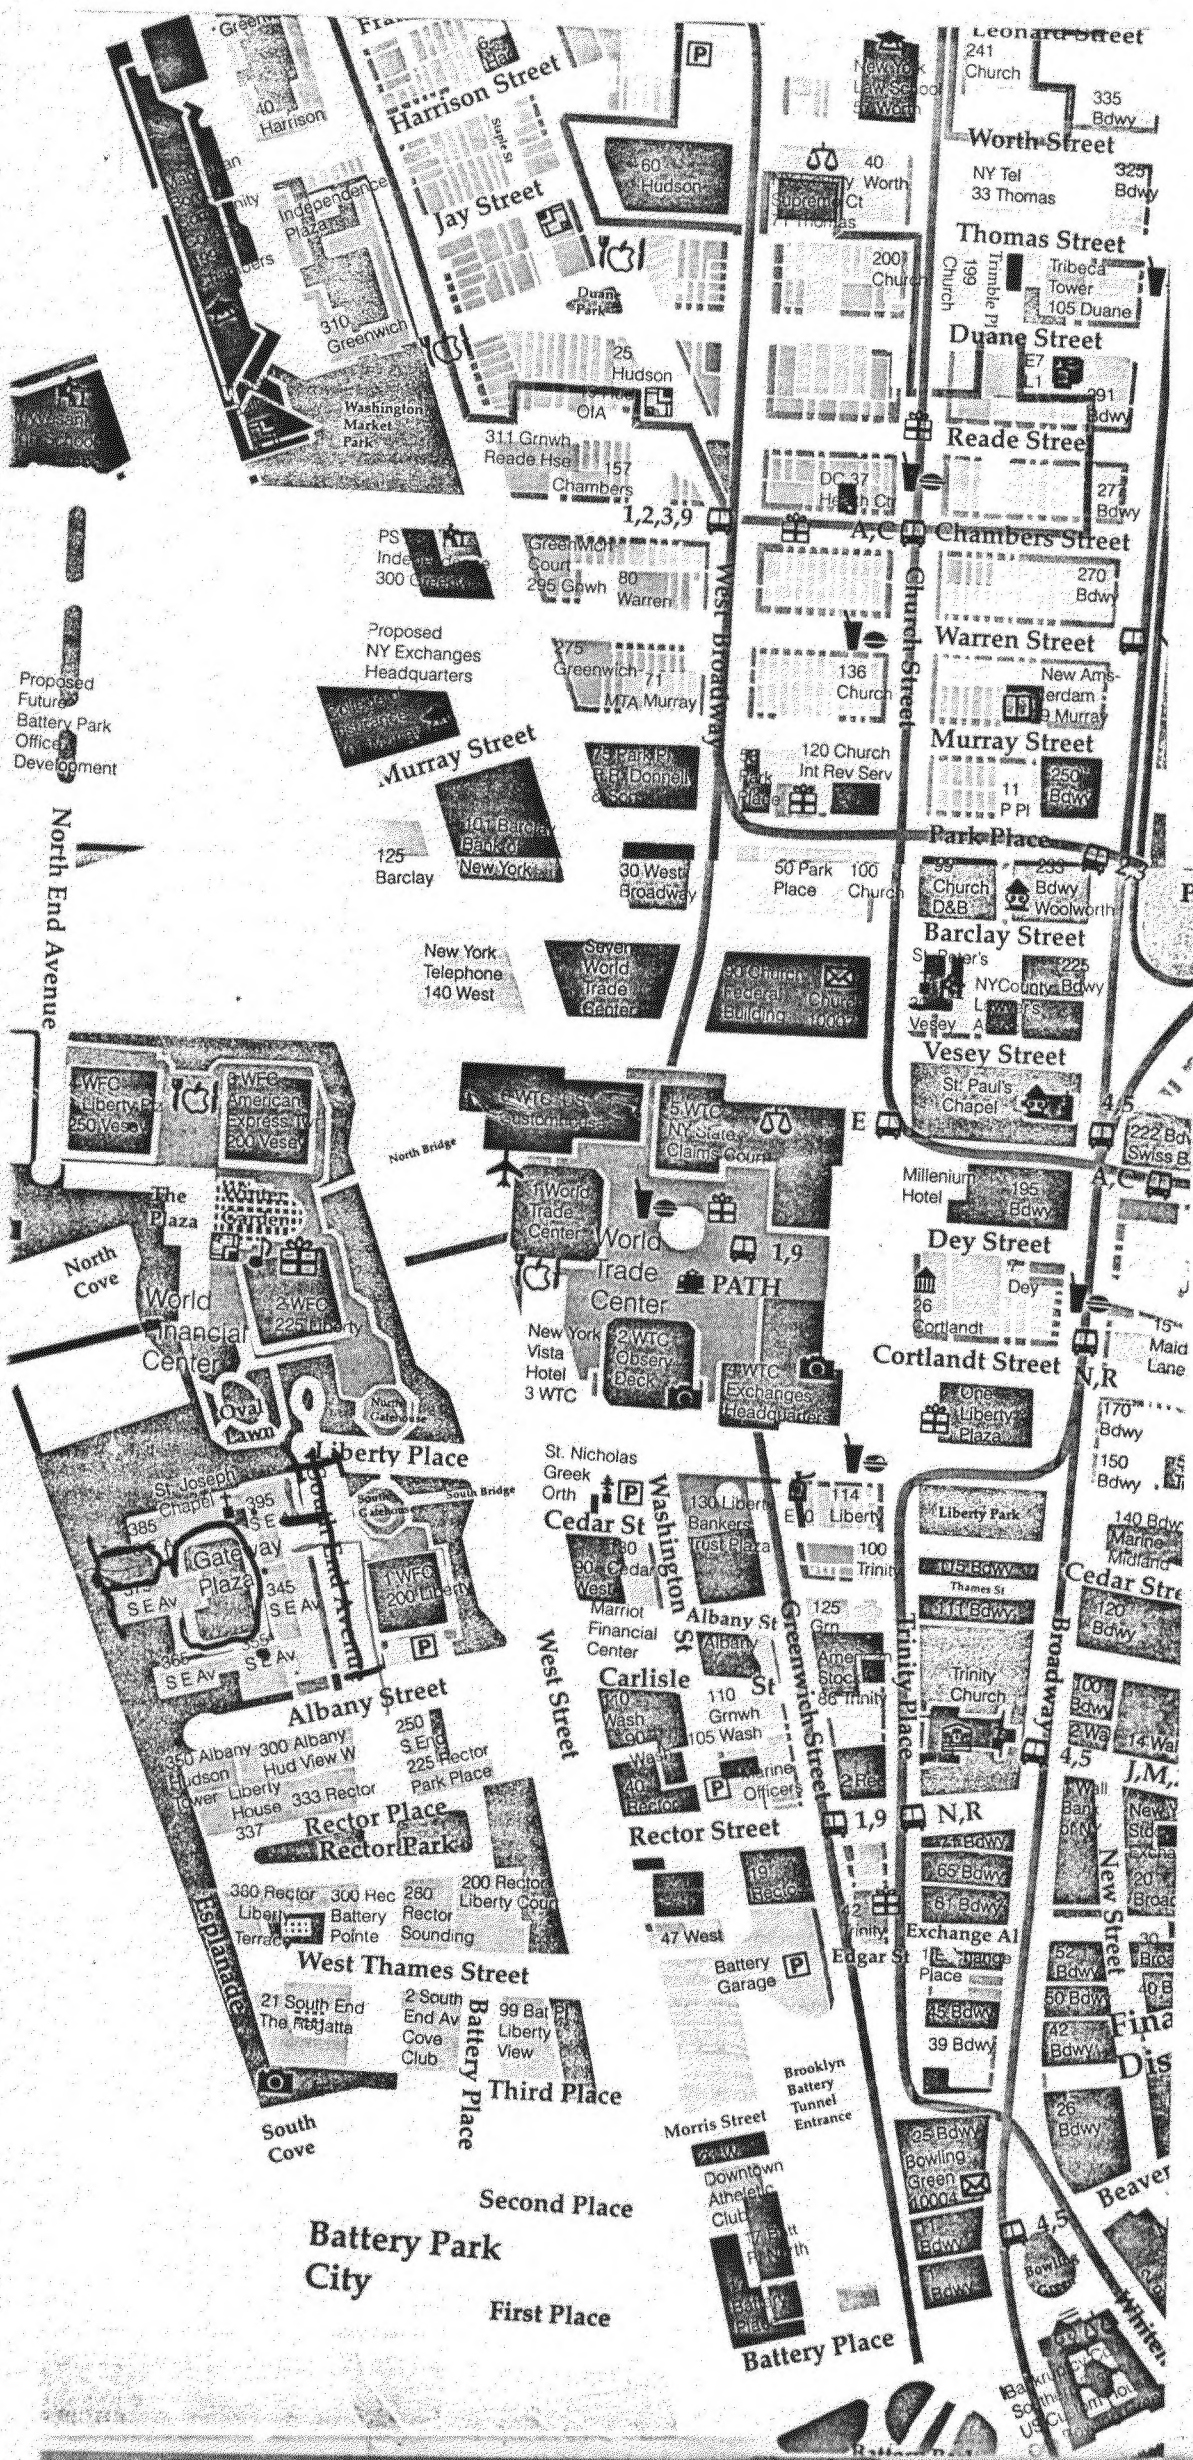

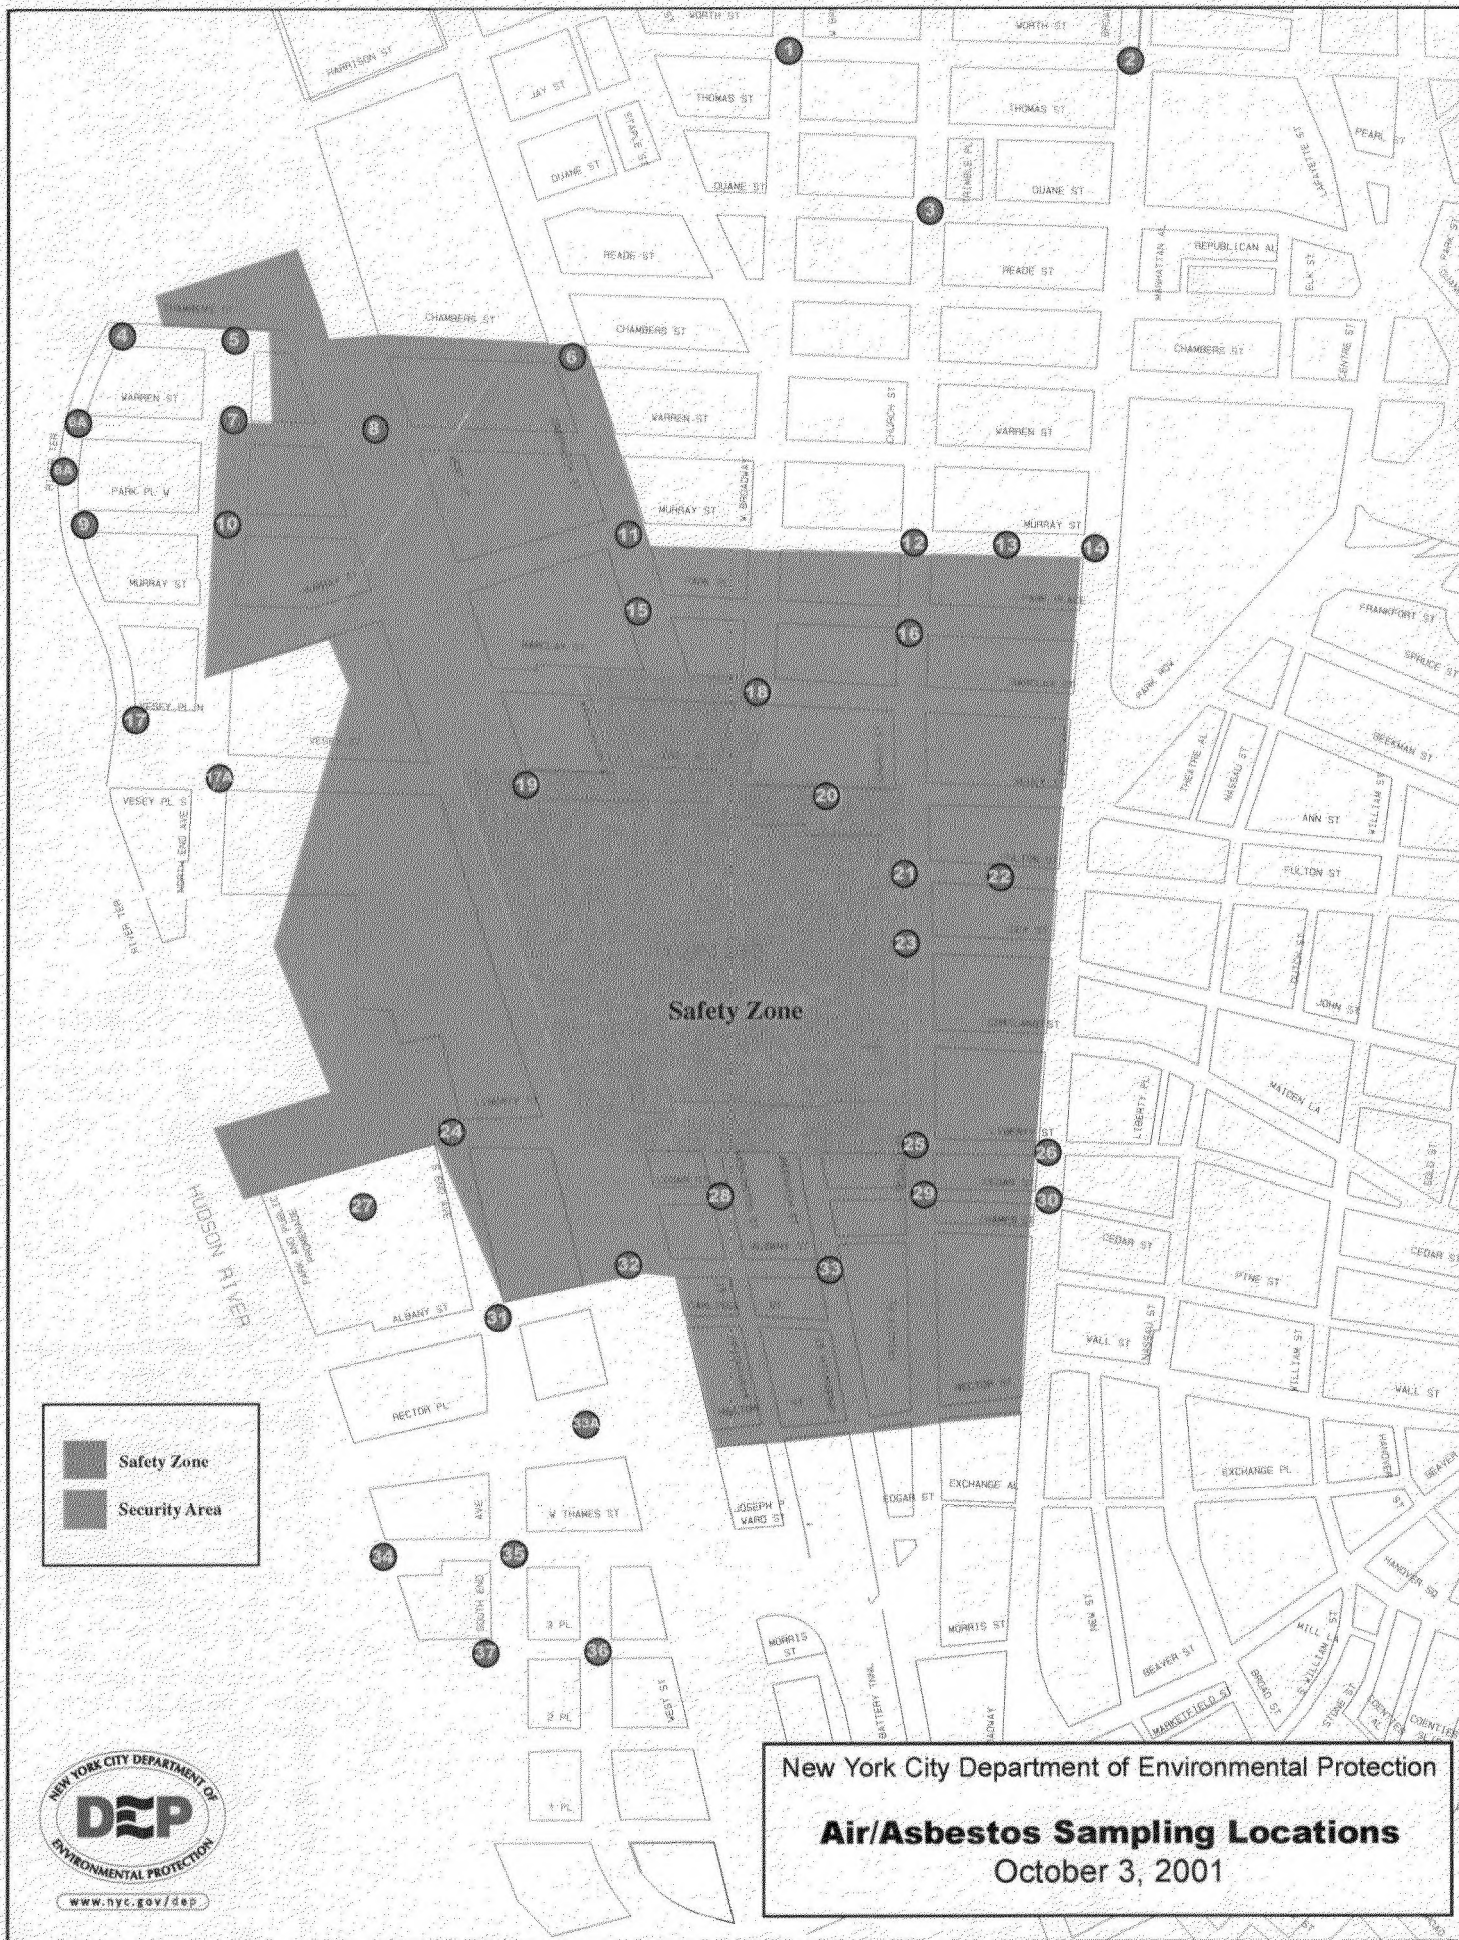

Air/Asbestos sampling data (10/2/01)

Location # Date PCM (f/cc)

1	9/12	0.01
2	9/12	0.01
3	9/15-9/16	<0.043-0.0089
4	9/19	0.012
	9/20	<LOQ
	9/21	<LOQ
	9/22	0.009
	9/23	<LOQ
	9/24	0.008
	9/25	0.007
	9/26	0.017
	9/27	0.014
	9/29	0.007
	9/30	<LOQ
	10/1	0.007
	10/2	0.007
5	9/21	<LOQ
6	9/12	0.08
6A	9/17	0.007
	9/25	0.007
	10/1	0.007
	10/2	0.007
7	9/18	0.008
	9/19	<LOQ
	9/20	<LOQ
	9/21	<LOQ
	9/22	0.009
	9/23	<LOQ
	9/24	<LOQ
	9/25	0.008
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.009
	9/30	<LOQ
	10/1	0.007
	10/2	0.009
8	9/19	0.03
	9/21	0.01
	9/22	<0.01
	9/23	<LOQ
	9/24	0.009
	9/25	0.012
	9/26	<LOQ
	9/27	0.009
	9/29	0.008
	9/30	<LOQ
	10/1	0.009
	10/2	0.009
8A	9/23	<LOQ
	9/27	<LOQ
	9/30	<LOQ
9	9/19	<LOQ
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
	9/25	0.008
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.007
	9/30	<LOQ
	10/1	0.008
	10/2	0.007
10	9/19	0.05
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.012
	9/25	0.008
	9/27	<LOQ
	10/1	0.007
	10/2	0.009

Location # Date PCM (f/cc)

11	9/13	<LOQ
	9/14	<LOQ
	9/15	0.031
	9/16	0.013
11	9/17	0.012
	9/18	0.011
	9/19	<LOQ
	9/20	<LOQ
	9/21	<LOQ
	9/22	<0.01
	9/23	<LOQ
	9/24	0.009
	9/25	0.007
	9/26	0.008
	9/27	<LOQ
	9/28	<0.009
	9/29	0.009
	9/30	<LOQ
	10/1	0.009
	10/2	0.008
12	9/13	0.22
	9/14	<LOQ
	9/15	0.022
	9/16	0.03
	9/17	0.013
	9/18	0.018
	9/19	0.014
	9/20	<LOQ
	9/21	<LOQ
	9/22	0.01
	9/23	<LOQ
	9/24	0.017
	9/25	0.007
	9/26	0.01
	9/27	0.016
	9/28	<0.009
	9/29	0.041
	9/30	0.042
	10/1	0.009
	10/2	0.007
13	9/14	0.002
	9/15	0.024
	9/16	0.05
	9/17	0.002
14	9/15	0.045
	9/16	0.045
15	9/14	0.009
	9/15	0.076
	9/23	0.014
	9/24	0.012
	9/25	0.009
	9/26	0.011
	9/27	0.014
	9/28	<0.009
	9/29	0.009
	9/30	0.009
	10/1	0.009
	10/2	0.008
16	9/23	0.01
	9/24	0.007
	9/25	0.009
	9/26	0.008
	9/27	0.05
	9/28	<0.009
	9/29	0.009
	9/30	0.024
	10/1	0.009
	10/2	0.007
17	9/19	0.012
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	<0.007
	9/25	0.008
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.007
	9/30	<LOQ
	10/1	0.009
	10/2	0.009
17A	9/19	0.01

Location # Date PCM (f/cc)

18	9/15	<0.0046
19	9/15	0.0085
	9/18	0.034
	9/27	0.018
	9/27	0.016
20	9/16	0.035
	9/17	0.024
21	9/13	0.1
	9/14	0.007
	9/15	0.034
	9/16	0.03
	9/17	0.017
	9/18	0.027
	9/19	0.02
	9/20	<LOQ
	9/21	0.008
	9/22	0.008
	9/23	0.026
	9/25	0.008
	9/26	0.078
	9/27	0.01
	9/29	0.015
	9/30	0.011
	10/1	0.035
	10/2	0.019
22	9/14	<LOQ
	9/15	0.035
	9/16	0.03
23	9/15	0.007
24	9/15	0.019Z
	9/14	0.02
	9/18	0.021
	9/15	0.008
26	9/16	0.01
	9/17	0.062
27	9/20	<LOQ
	9/21	0.014
	9/22	0.01
	9/23	<LOQ
	9/24	<0.011
	9/25	0.008
	9/26	0.023
	9/27	<LOQ
	9/29	0.02
	9/30	<LOQ
	10/1	0.009
	10/2	0.009
28	9/13	<LOQ
29	9/14	0.027
	9/20	<LOQ
	9/25	0.008
	9/27	<LOQ
	9/29	0.058
	9/30	0.076
	10/1	0.015
	10/2	0.016
30	9/15	0.033
	9/16	0.03
31	9/19	0.013
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.01
	9/25	0.007
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.02
	9/30	0.031
	10/1	0.009
	10/2	0.008
32	9/21	0.011
	9/22	0.01
	9/23	<LOQ
	9/24	0.01
	9/25	0.008
	9/26	0.014
	9/27	<LOQ
	9/29	0.08
	9/30	0.022
	10/1	0.012
	10/2	0.009

Location # Date PCM (f/cc)

33	9/15	0.0043
33A	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	0.029
	9/24	0.039
	9/25	0.007
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.009
	9/30	0.02
	10/1	0.009
	10/2	0.008
34	9/19	<LOQ
	9/21	<LOQ
34	9/22	<0.008
	9/23	<LOQ
	9/24	<0.008
	9/25	0.007
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.013
	9/30	0.009
	10/1	0.009
	10/2	0.009
35	9/20	0.01
	9/29	0.008
36	9/19	<LOQ
	9/20	<LOQ
	9/21	0.009
37	9/23	<LOQ
	9/24	<0.008
	9/25	0.007
	9/26	<LOQ
	9/27	<LOQ
	9/29	0.015
	9/30	0.015
	10/1	0.008


The U.S. and NYC standard for asbestos in community and residential buildings is 0.01 fibers/cubic centimeter (f/cc) in indoor air. DEP is augmenting asbestos sampling being done by USEPA and other state and city agencies. *

Results indicate that, as expected, asbestos is present in some of the debris at the site and in areas very close to the site. As of September 28, 2001, most air sampling results outside the security zone were below the standards for asbestos in indoor air.


As testing continues, there may be the possibility of occasional short-term increases in levels of asbestos in the air above the residential standard of 0.01 fibers per cubic centimeter of air. When the measured level for the outdoor ambient air is above .01 f/cc, the samples are being further analyzed to determine how many of the fibers are actually asbestos fibers.


LOQ= Limit of Quantification


NYC-WTC 000150737

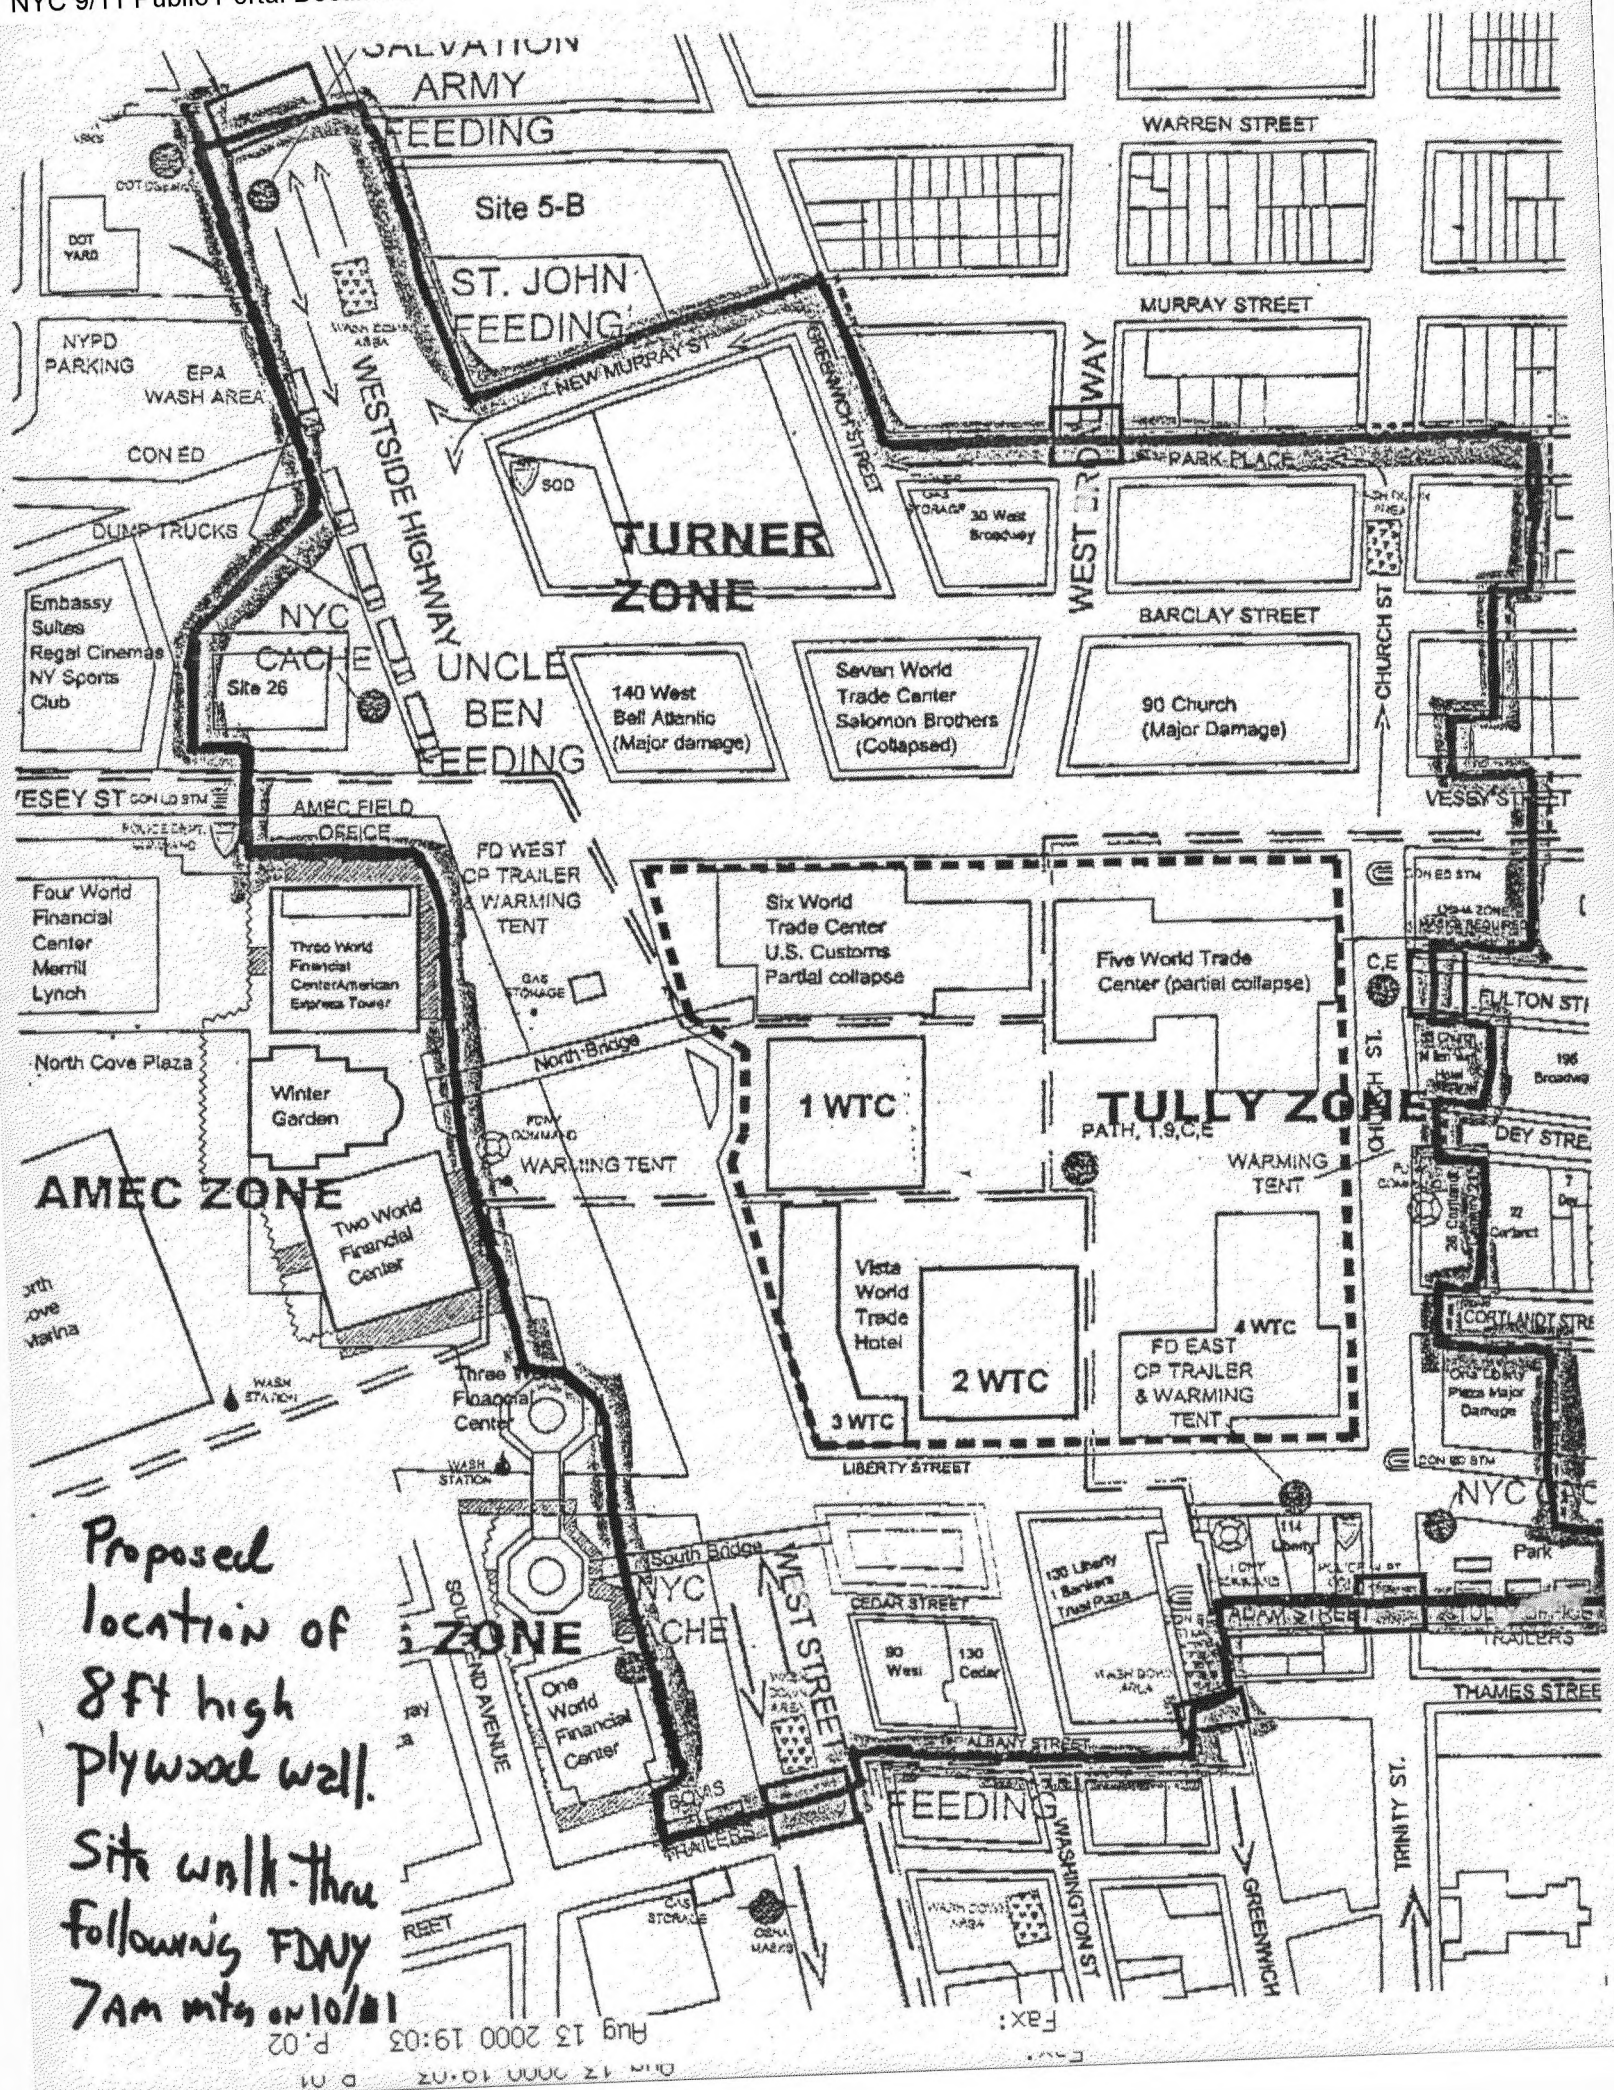


New York State Air Monitoring Stations

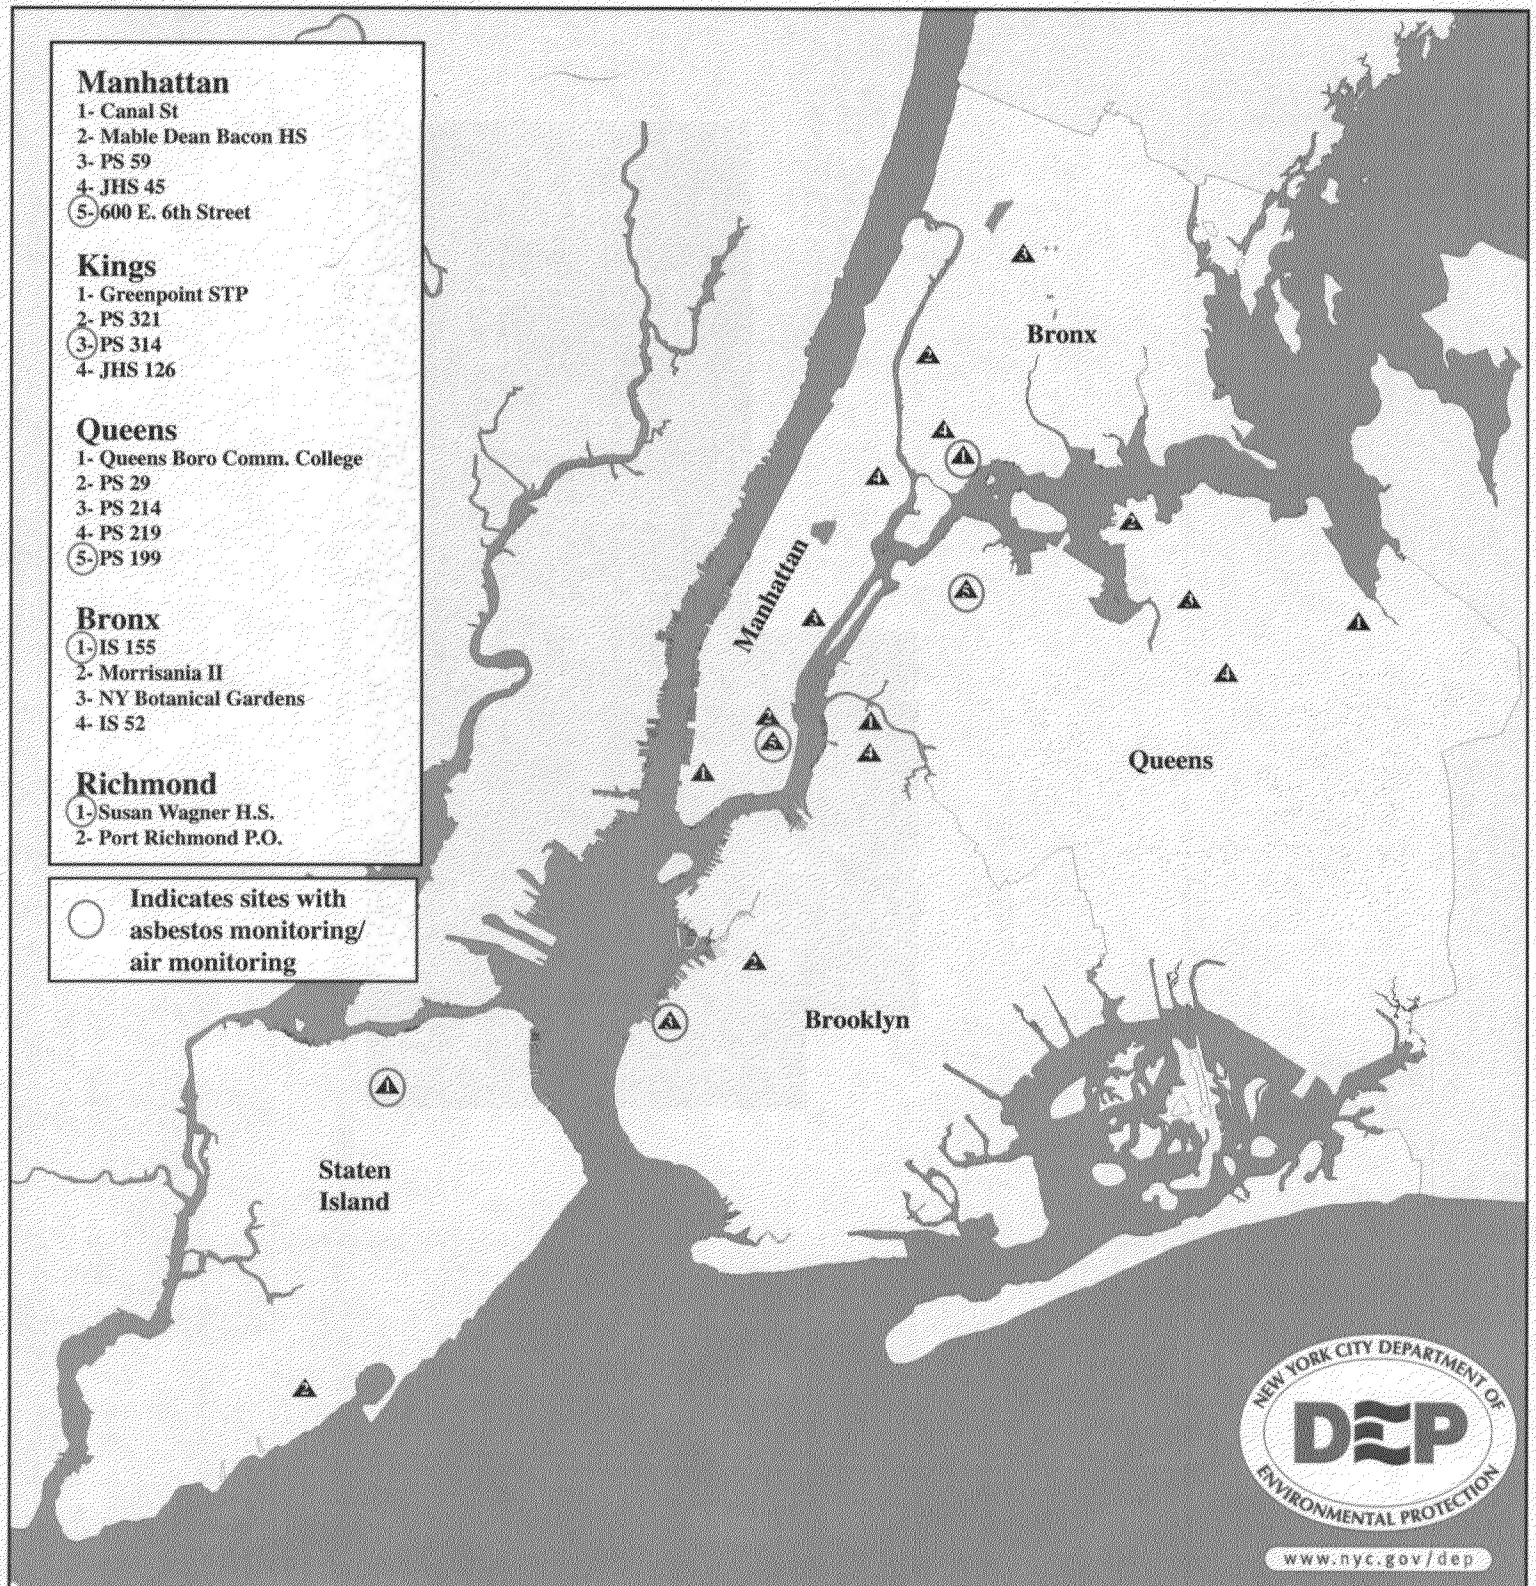

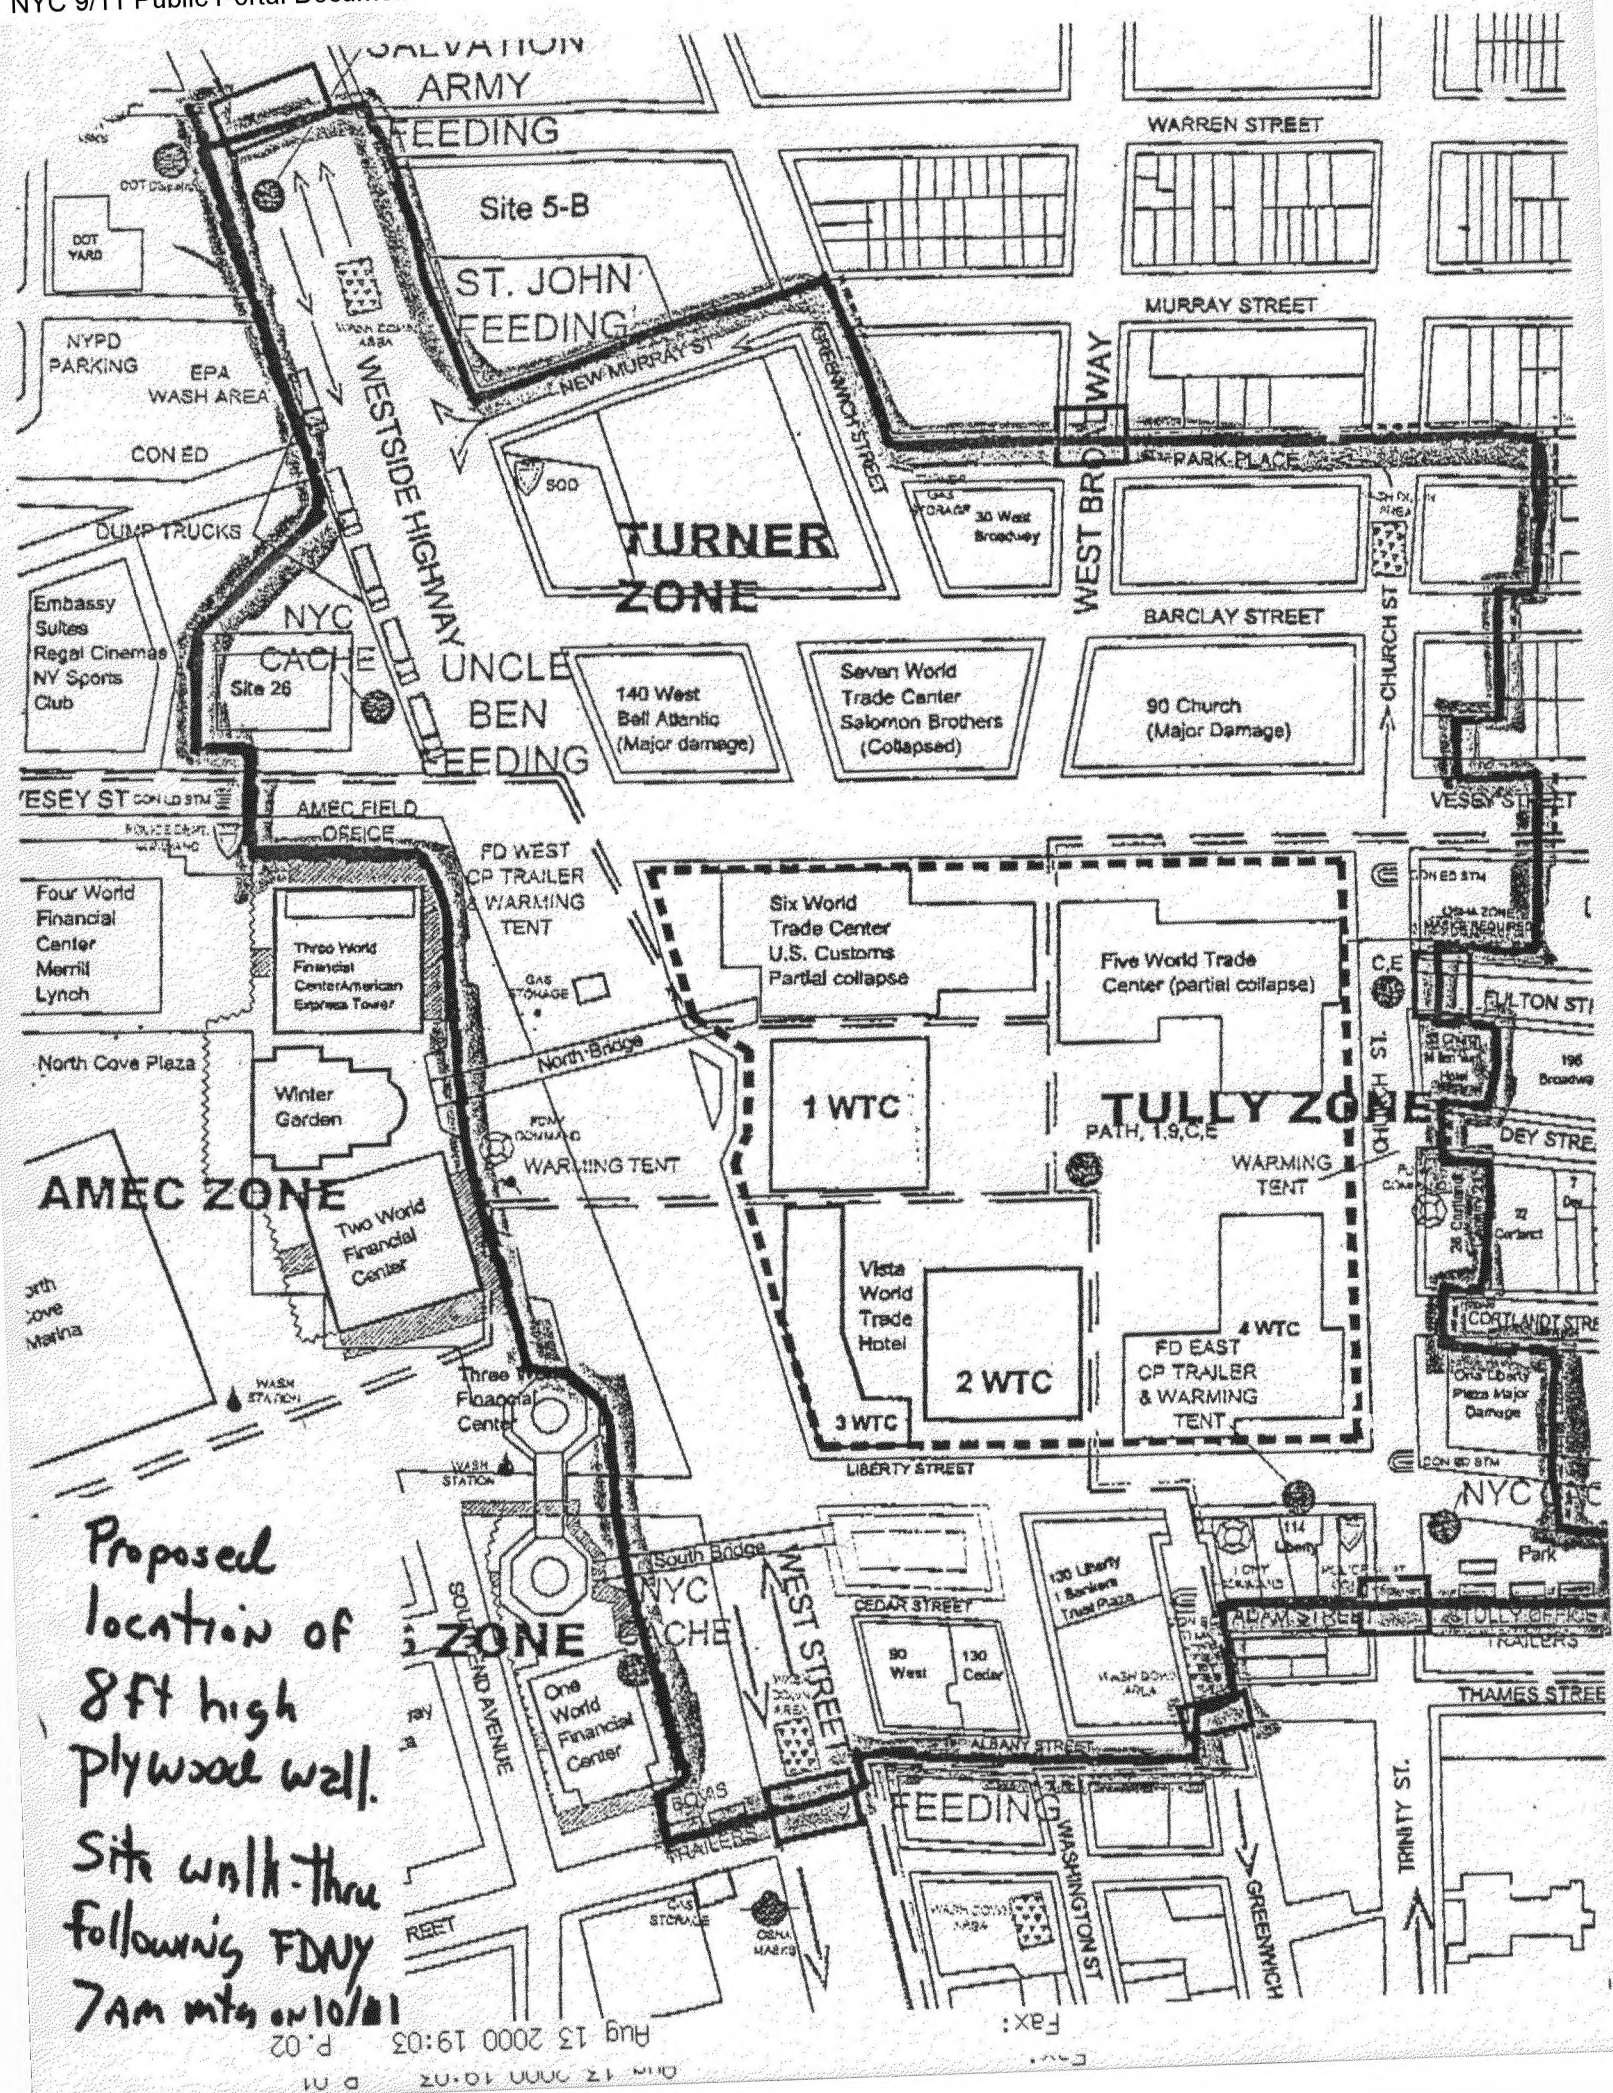


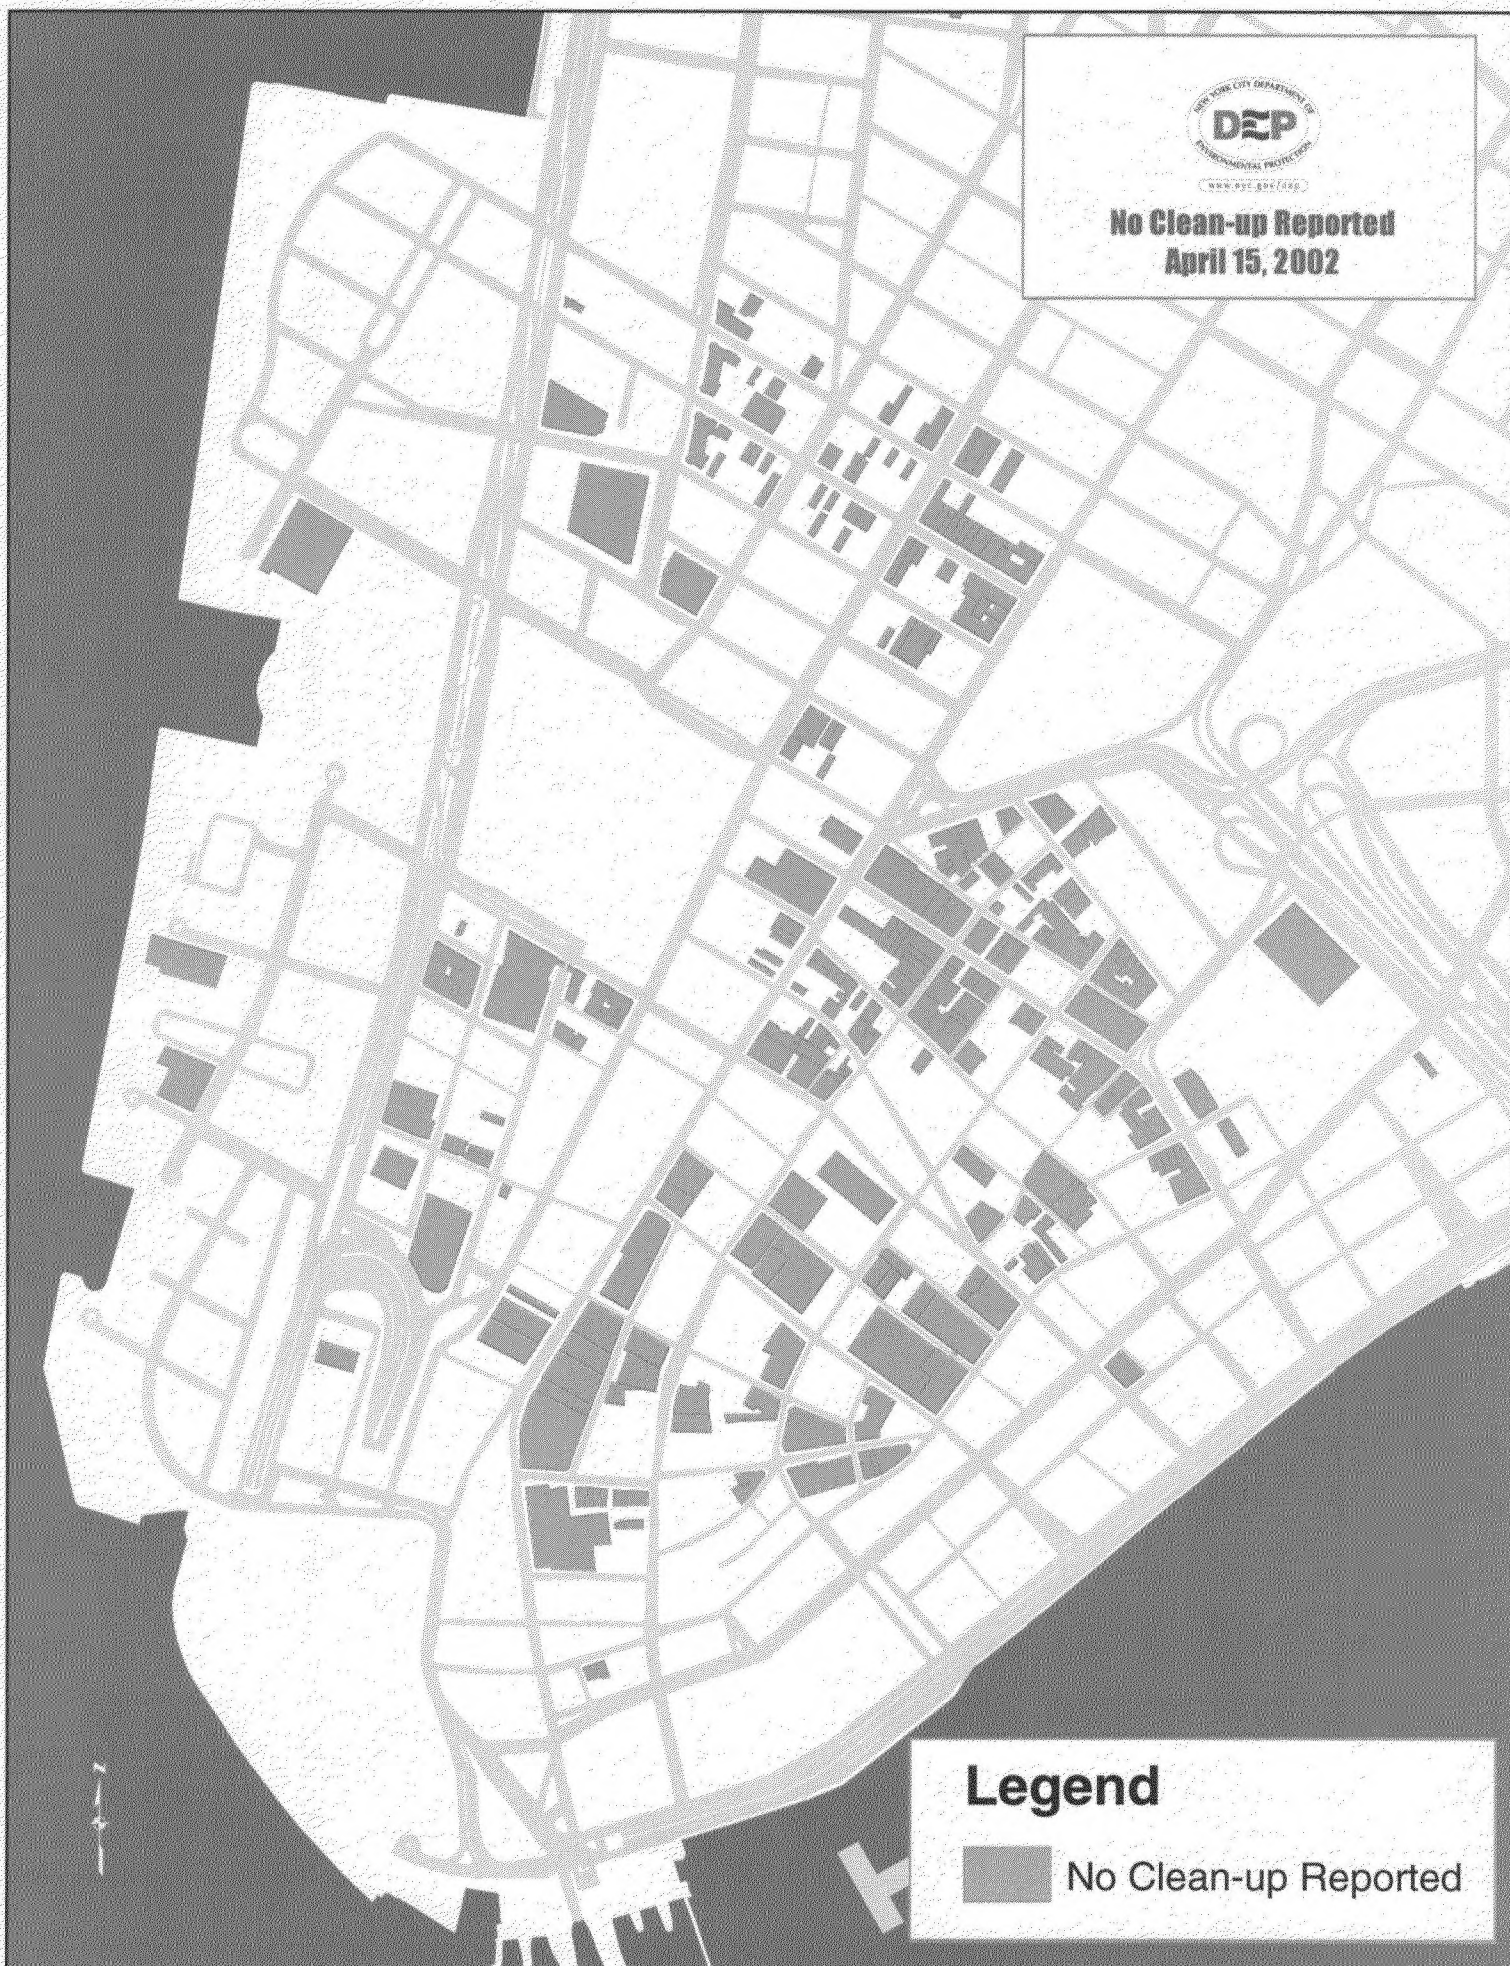

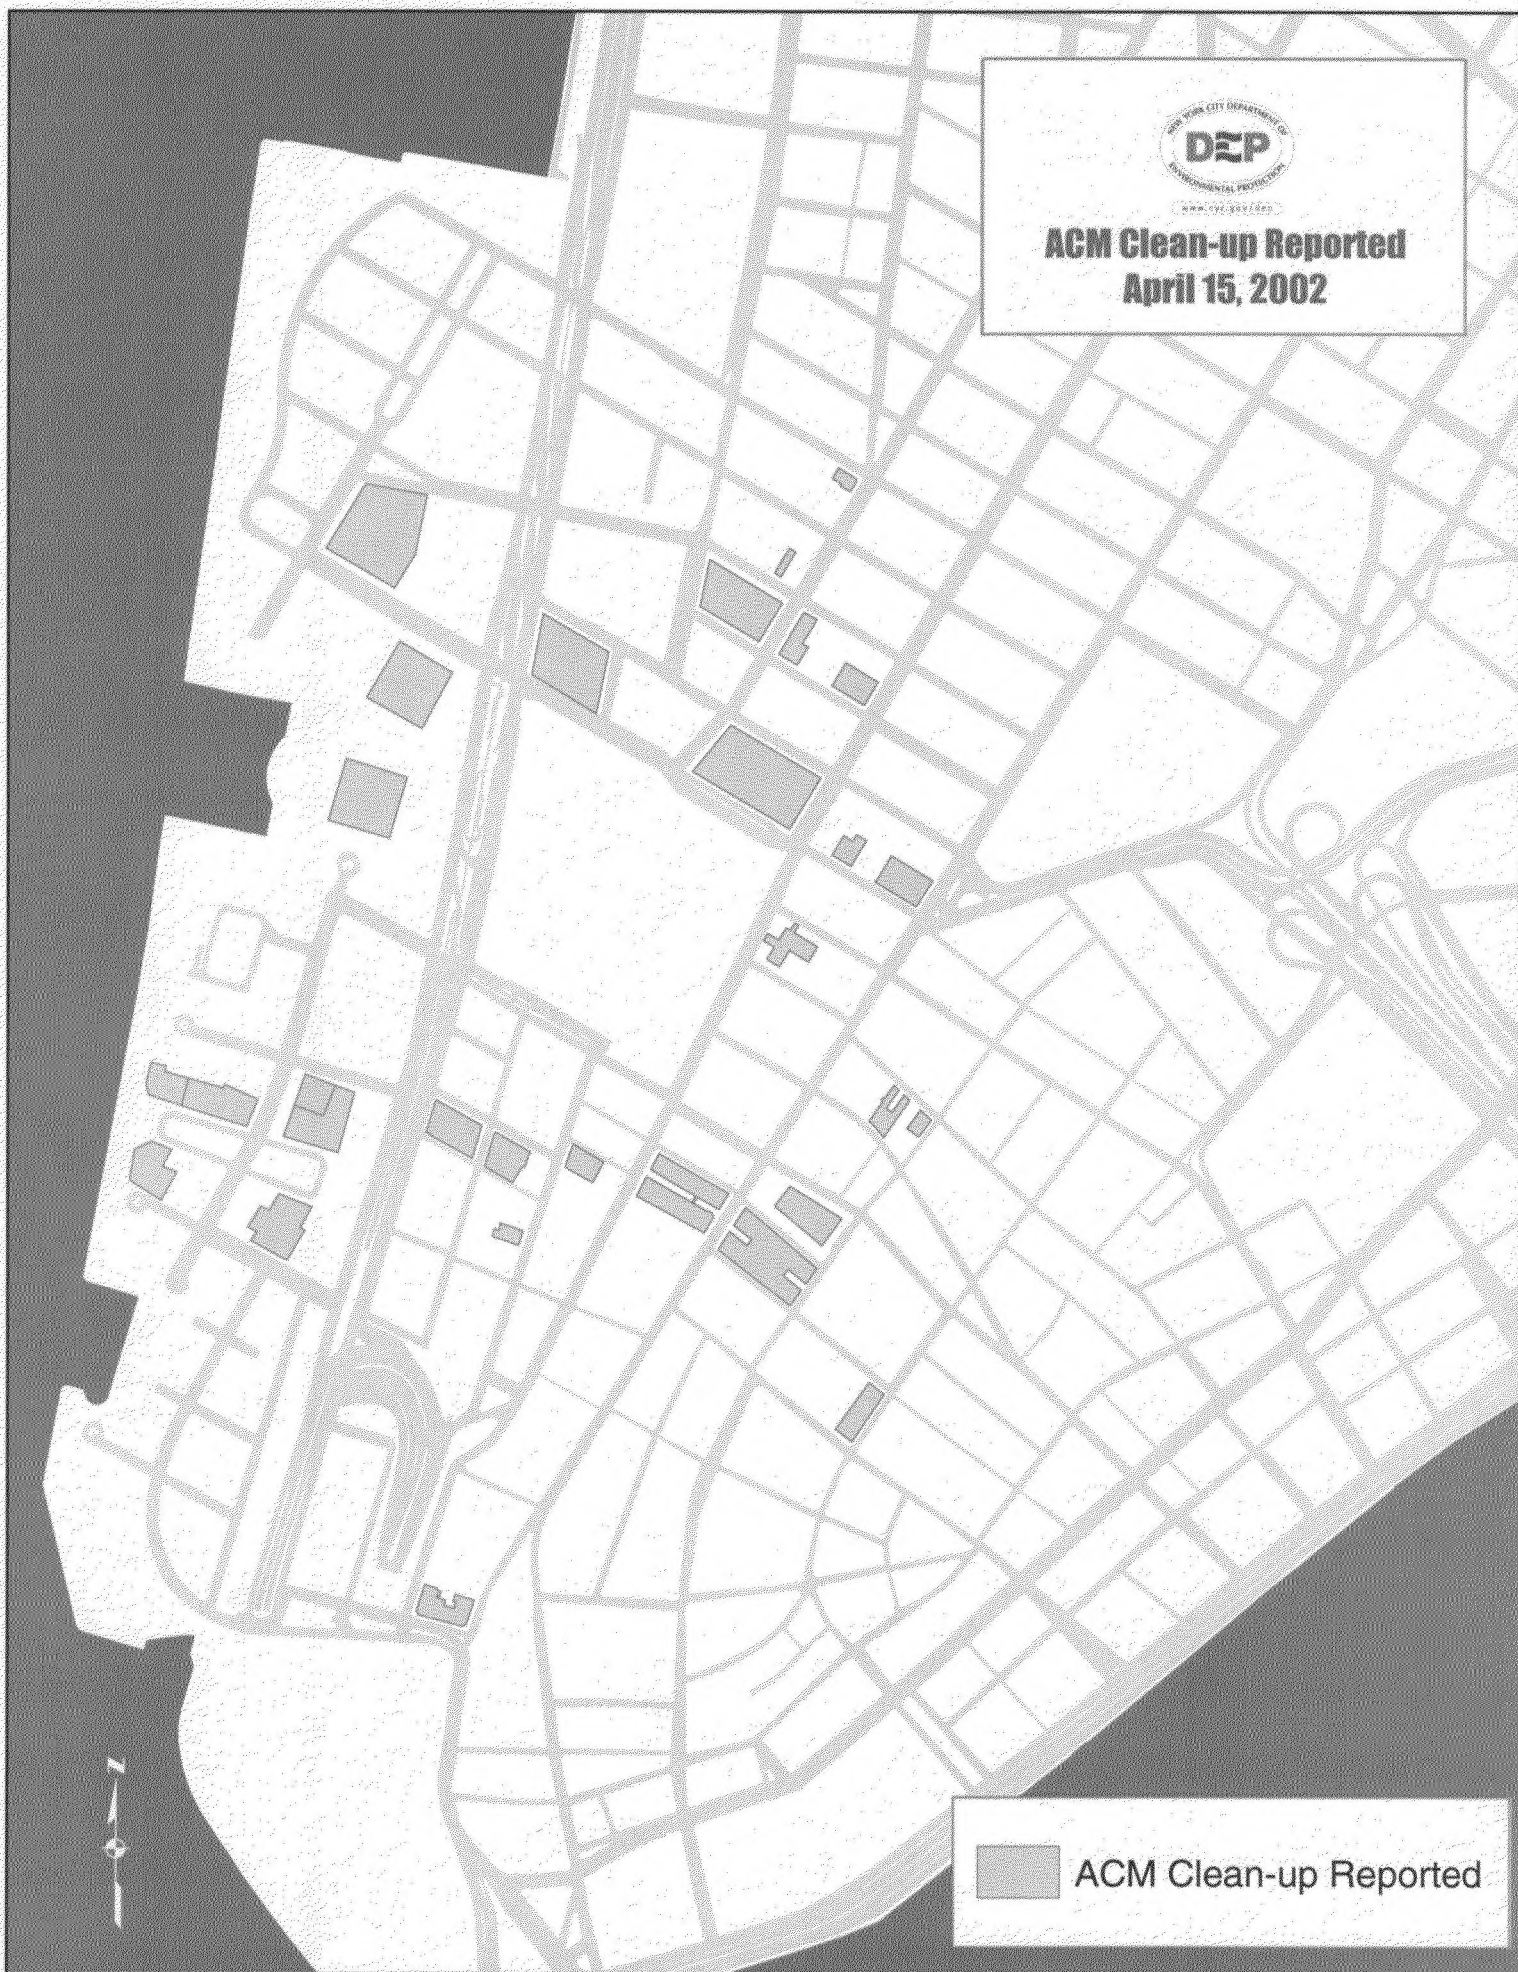





Exterior Clean-up Required
April 15, 2002

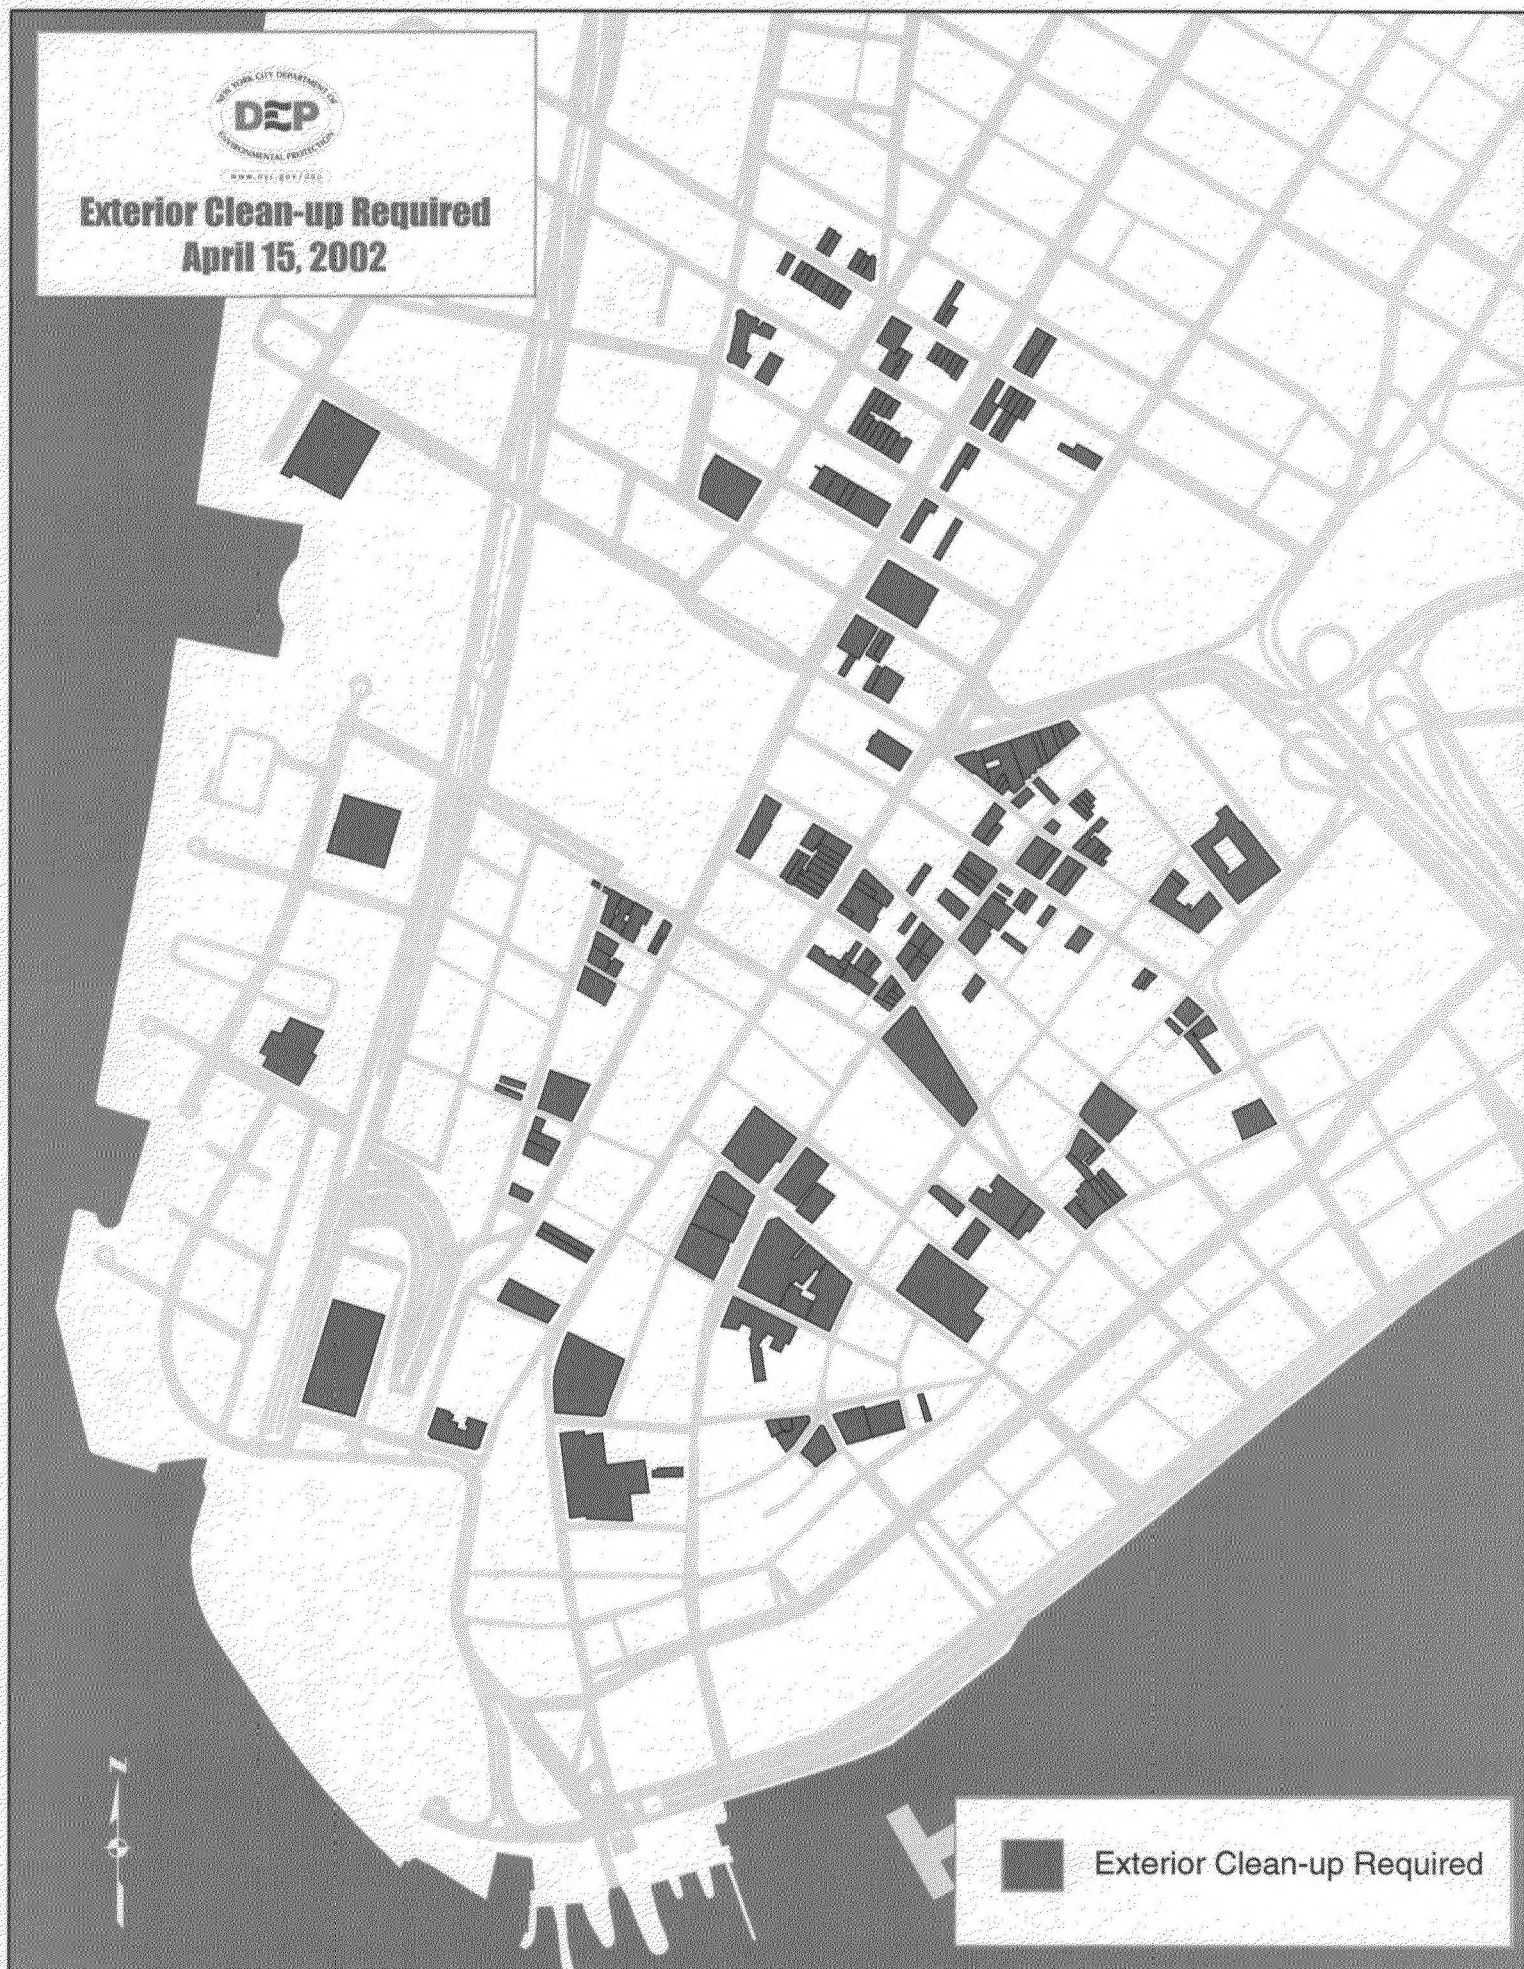

 Exterior Clean-up Required

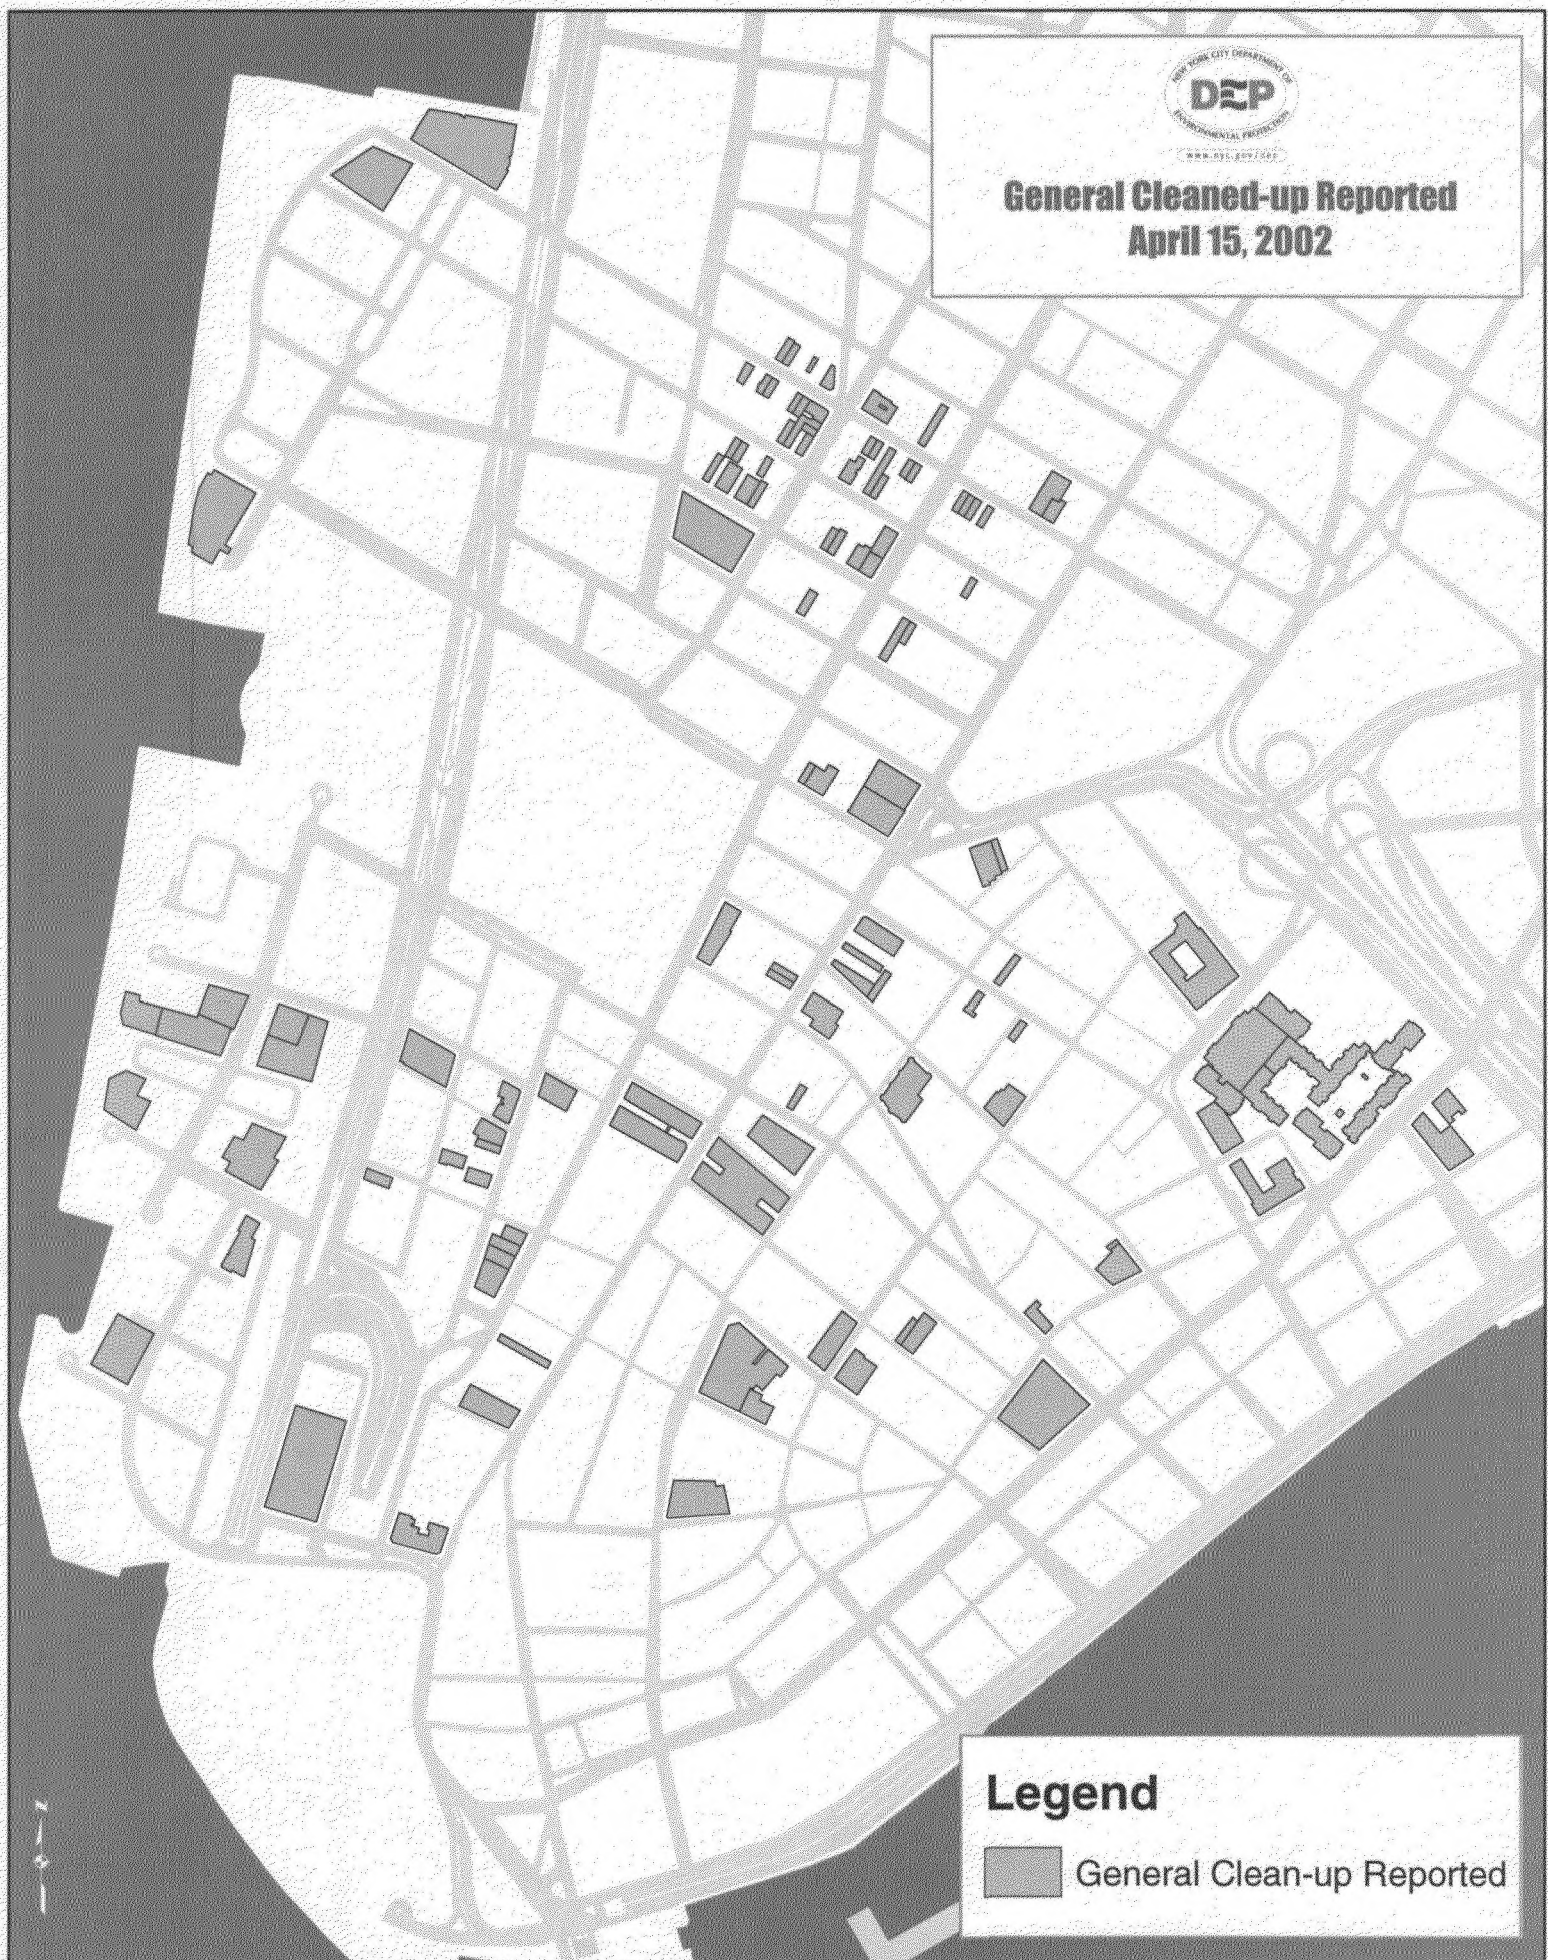

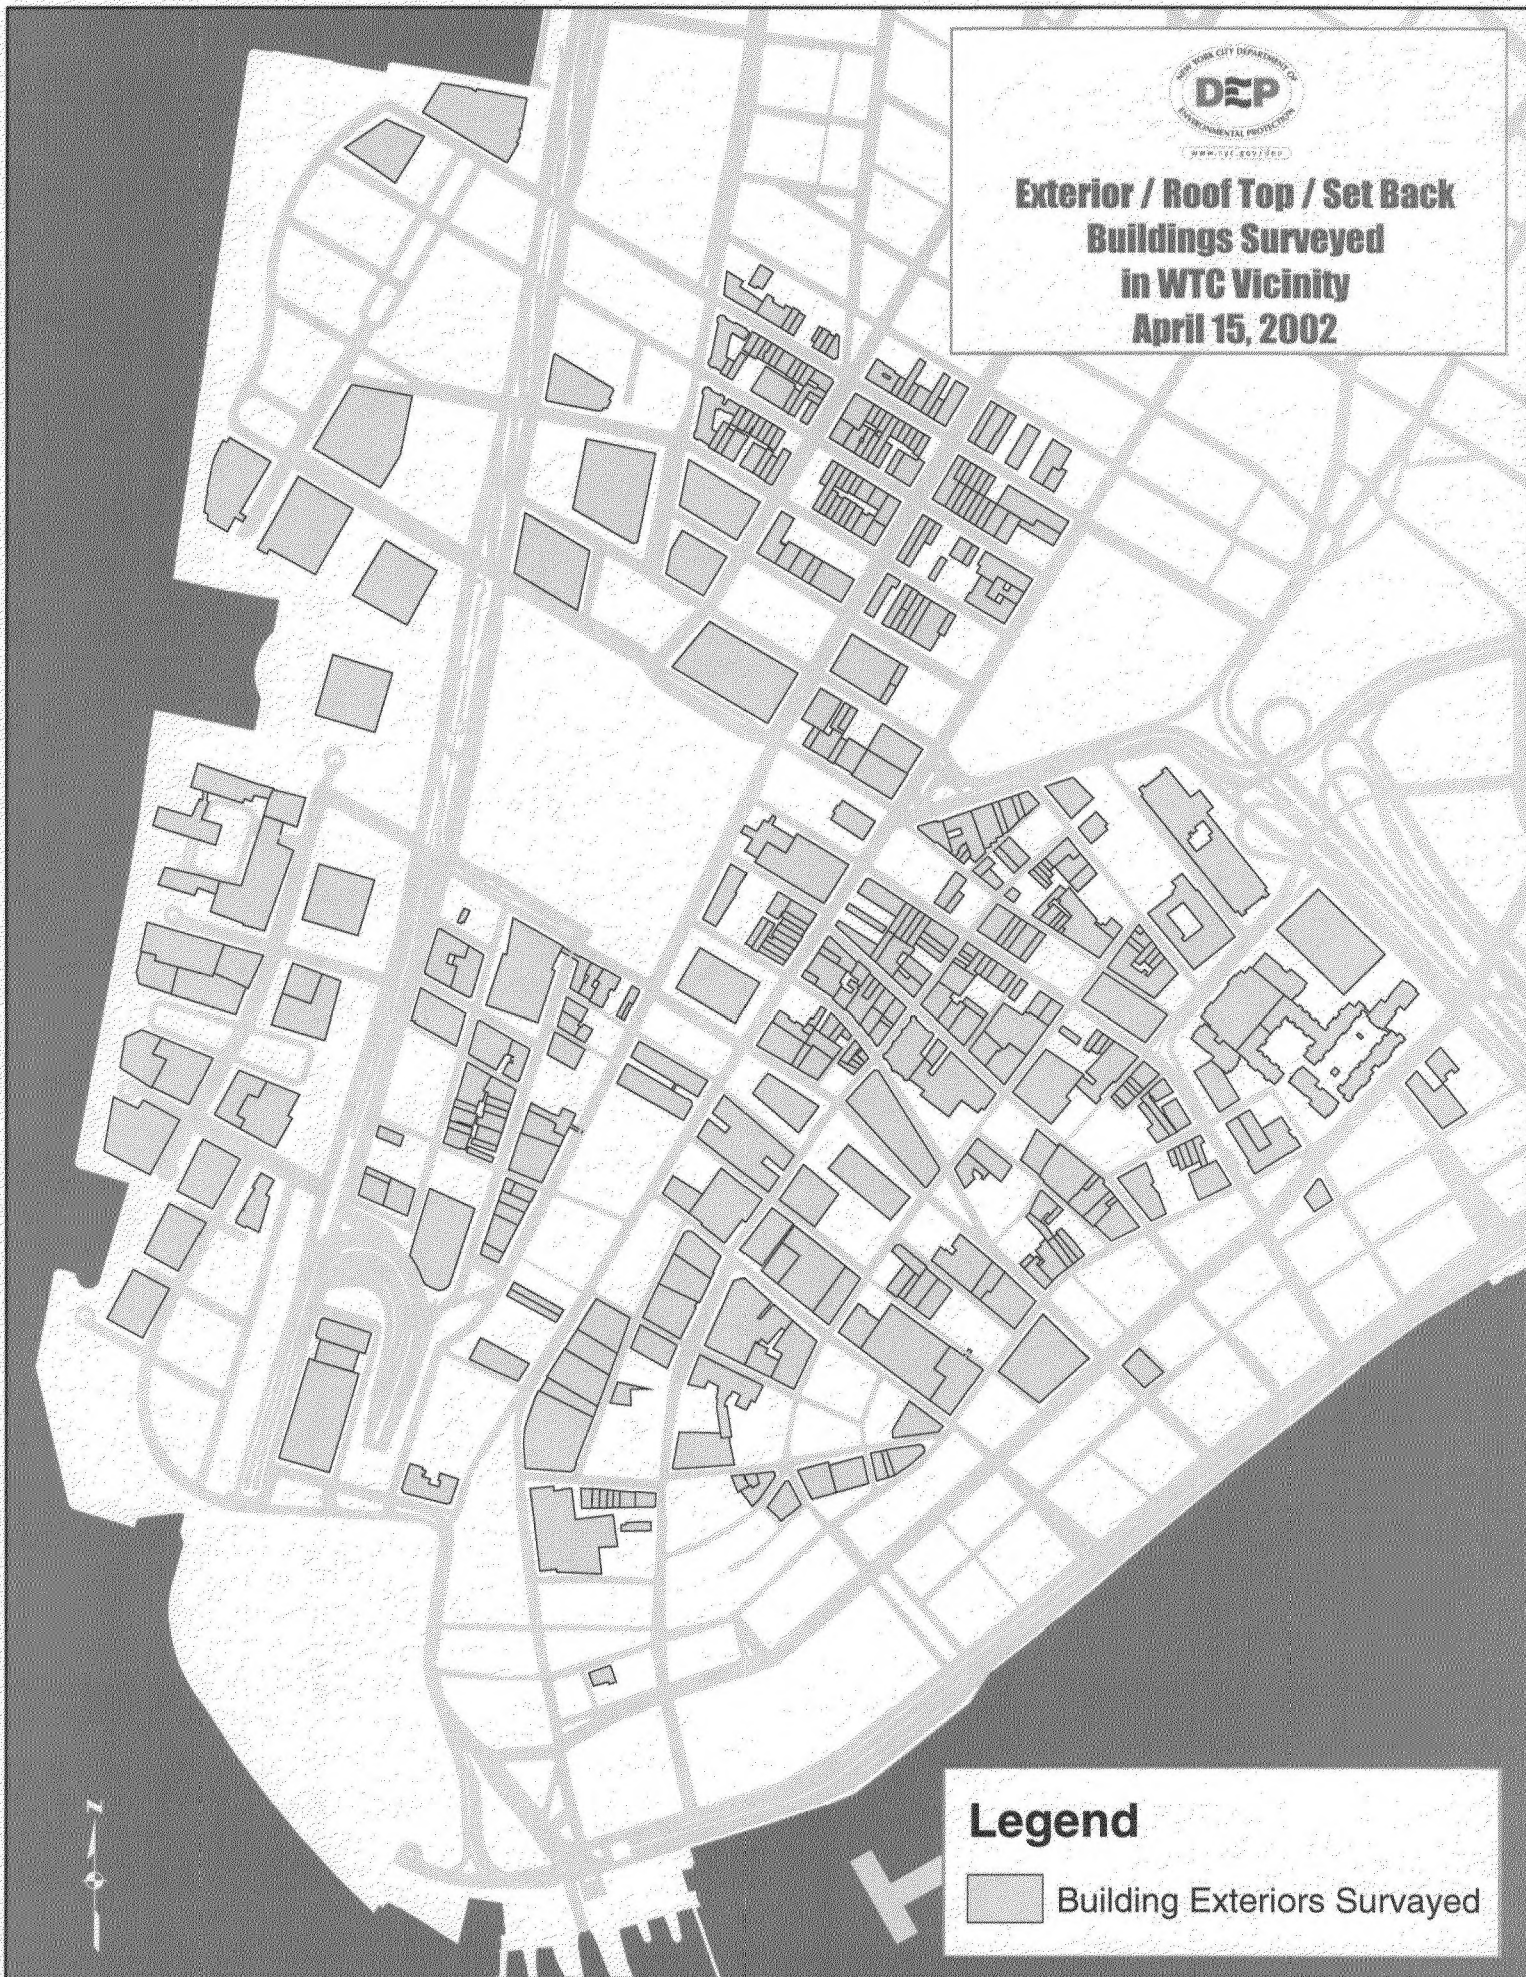

36 WEST BROADWAY
(Major damage)

VERIZON BUILDING
(Major damage)

3 WFC AMERICAN EXPRESS
(Major damage)

MERCANTILE EXCHANGE
(Damaged but stable)

4 WFC MERRILL LYNCH
(Damaged but stable)

WINTER GARDEN
(Major damage)

1 WFC OPPENHEIMER DOW JONES
(Damaged but stable)

2 WFC
(Major damage)

6 WORLD TRADE
(In danger of collapse)

MARRIOTT HOTEL
(Destroyed)

4 WORLD TRADE
(In danger of collapse)

90 WEST STREET
(Major damage)

1 BANKERS TRUST PLAZA
(Major damage)

TRINITY CHURCH
(Damaged but stable)

CENTURY 21
(Damaged but stable)

1 LIBERTY PLAZA
(Damaged but stable)

33 MAIDEN
(Damaged but stable)

22 CORTLANDT
(Damaged but stable)

MILLENNIUM HOTEL
(Damaged but stable)

2 WORLD TRADE
(Destroyed)

1 WORLD TRADE
(Destroyed)

7 WORLD TRADE
(Destroyed)

Asbestos Sampling Location

Location #	Sampling Date	PCM (f/cc)
1	9/12	0.010
2	9/12	0.010
3	9/15-9/18	<0.0043-0.0089
4	9/10	0.012
	9/20	<LOQ
	9/21	<LOQ
	9/22	0.008
	9/23	<LOQ
	9/24	0.008
5	9/12	0.080
6	9/17	0.007
7	9/18	0.008
	9/19	<LOQ
	9/20	<LOQ
	9/21	<LOQ
	9/22	0.008
	9/23	<LOQ
	9/24	<LOQ
8	9/19	0.008
	9/20	<LOQ
	9/21	0.010
	9/22	<LOQ
	9/23	0.008
9	9/19	<LOQ
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.012
10	9/19	<LOQ
	9/20	0.008
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
11	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.012
12	9/19	<LOQ
	9/20	0.008
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
13	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
14	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
15	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
16	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
17	9/19	0.010
	9/20	<LOQ
	9/21	<LOQ
	9/22	<LOQ
	9/23	<LOQ
	9/24	0.007
17A	9/19	0.010
18	9/15	<0.0048
19	9/16	0.0085
20	9/18	0.034
21	9/18	0.035
	9/17	0.024
	9/18	0.011
	9/19	0.007
	9/20	0.007
	9/21	0.007
	9/22	0.007
	9/23	0.007
	9/24	0.007
22	9/14	0.008
	9/15	0.008
	9/16	0.008
	9/17	0.007
	9/18	0.007
	9/19	0.007
	9/20	0.007
	9/21	0.007
	9/22	0.007
	9/23	0.007
	9/24	0.007
23	9/14	0.008
24	9/15	0.008
25	9/16	0.008
26	9/17	0.007
27	9/18	0.007
28	9/19	0.007
29	9/20	0.007
30	9/21	0.007
31	9/22	0.007
32	9/23	0.007
33	9/24	0.007
33A	9/19	0.008
	9/20	0.008
	9/21	0.008
	9/22	0.008
	9/23	0.008
	9/24	0.008
34	9/19	0.008
	9/20	0.008
	9/21	0.008
	9/22	0.008
	9/23	0.008
	9/24	0.008
35	9/19	0.008
36	9/20	0.008
37	9/21	0.008
	9/22	0.008
	9/23	0.008
	9/24	0.008

LOQ = Limit of Quantification

Revised 9/24/01 - 9:00 PM

DO NOT Restore at This Time


Can be Restored


Further Investigation Necessary


In Service


Closed Valve

Revised 9/24/01 - 8:00 AM

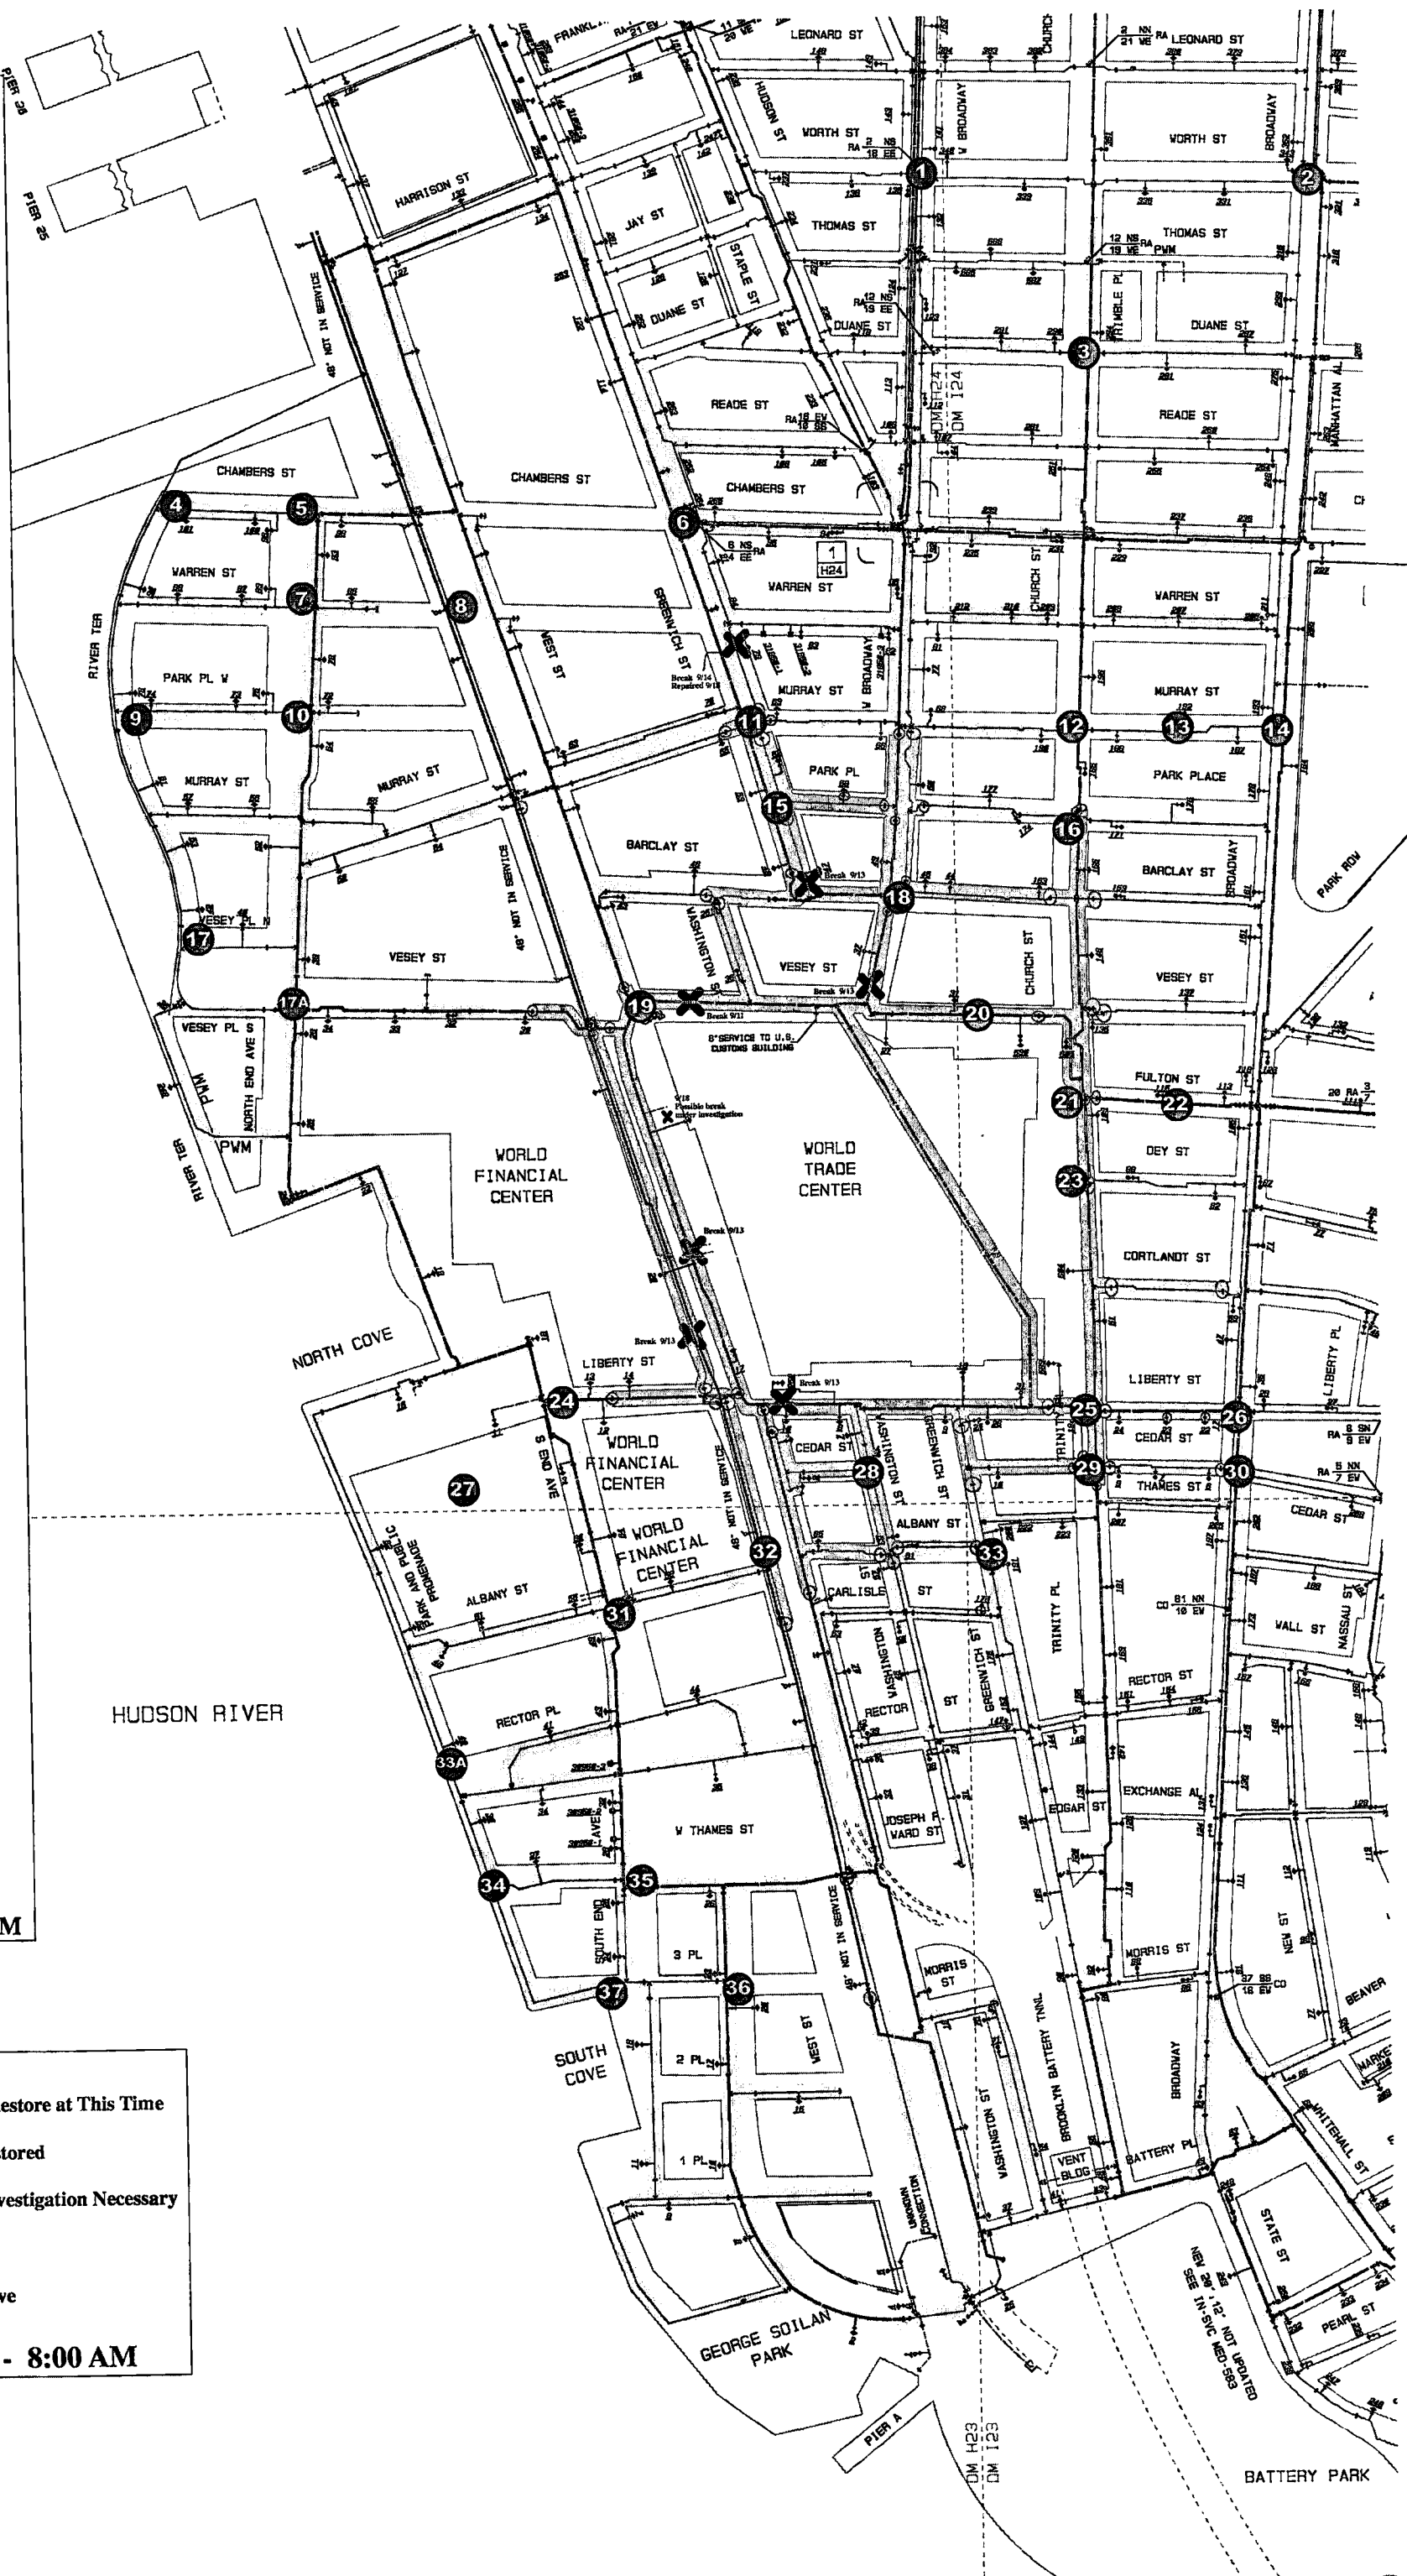



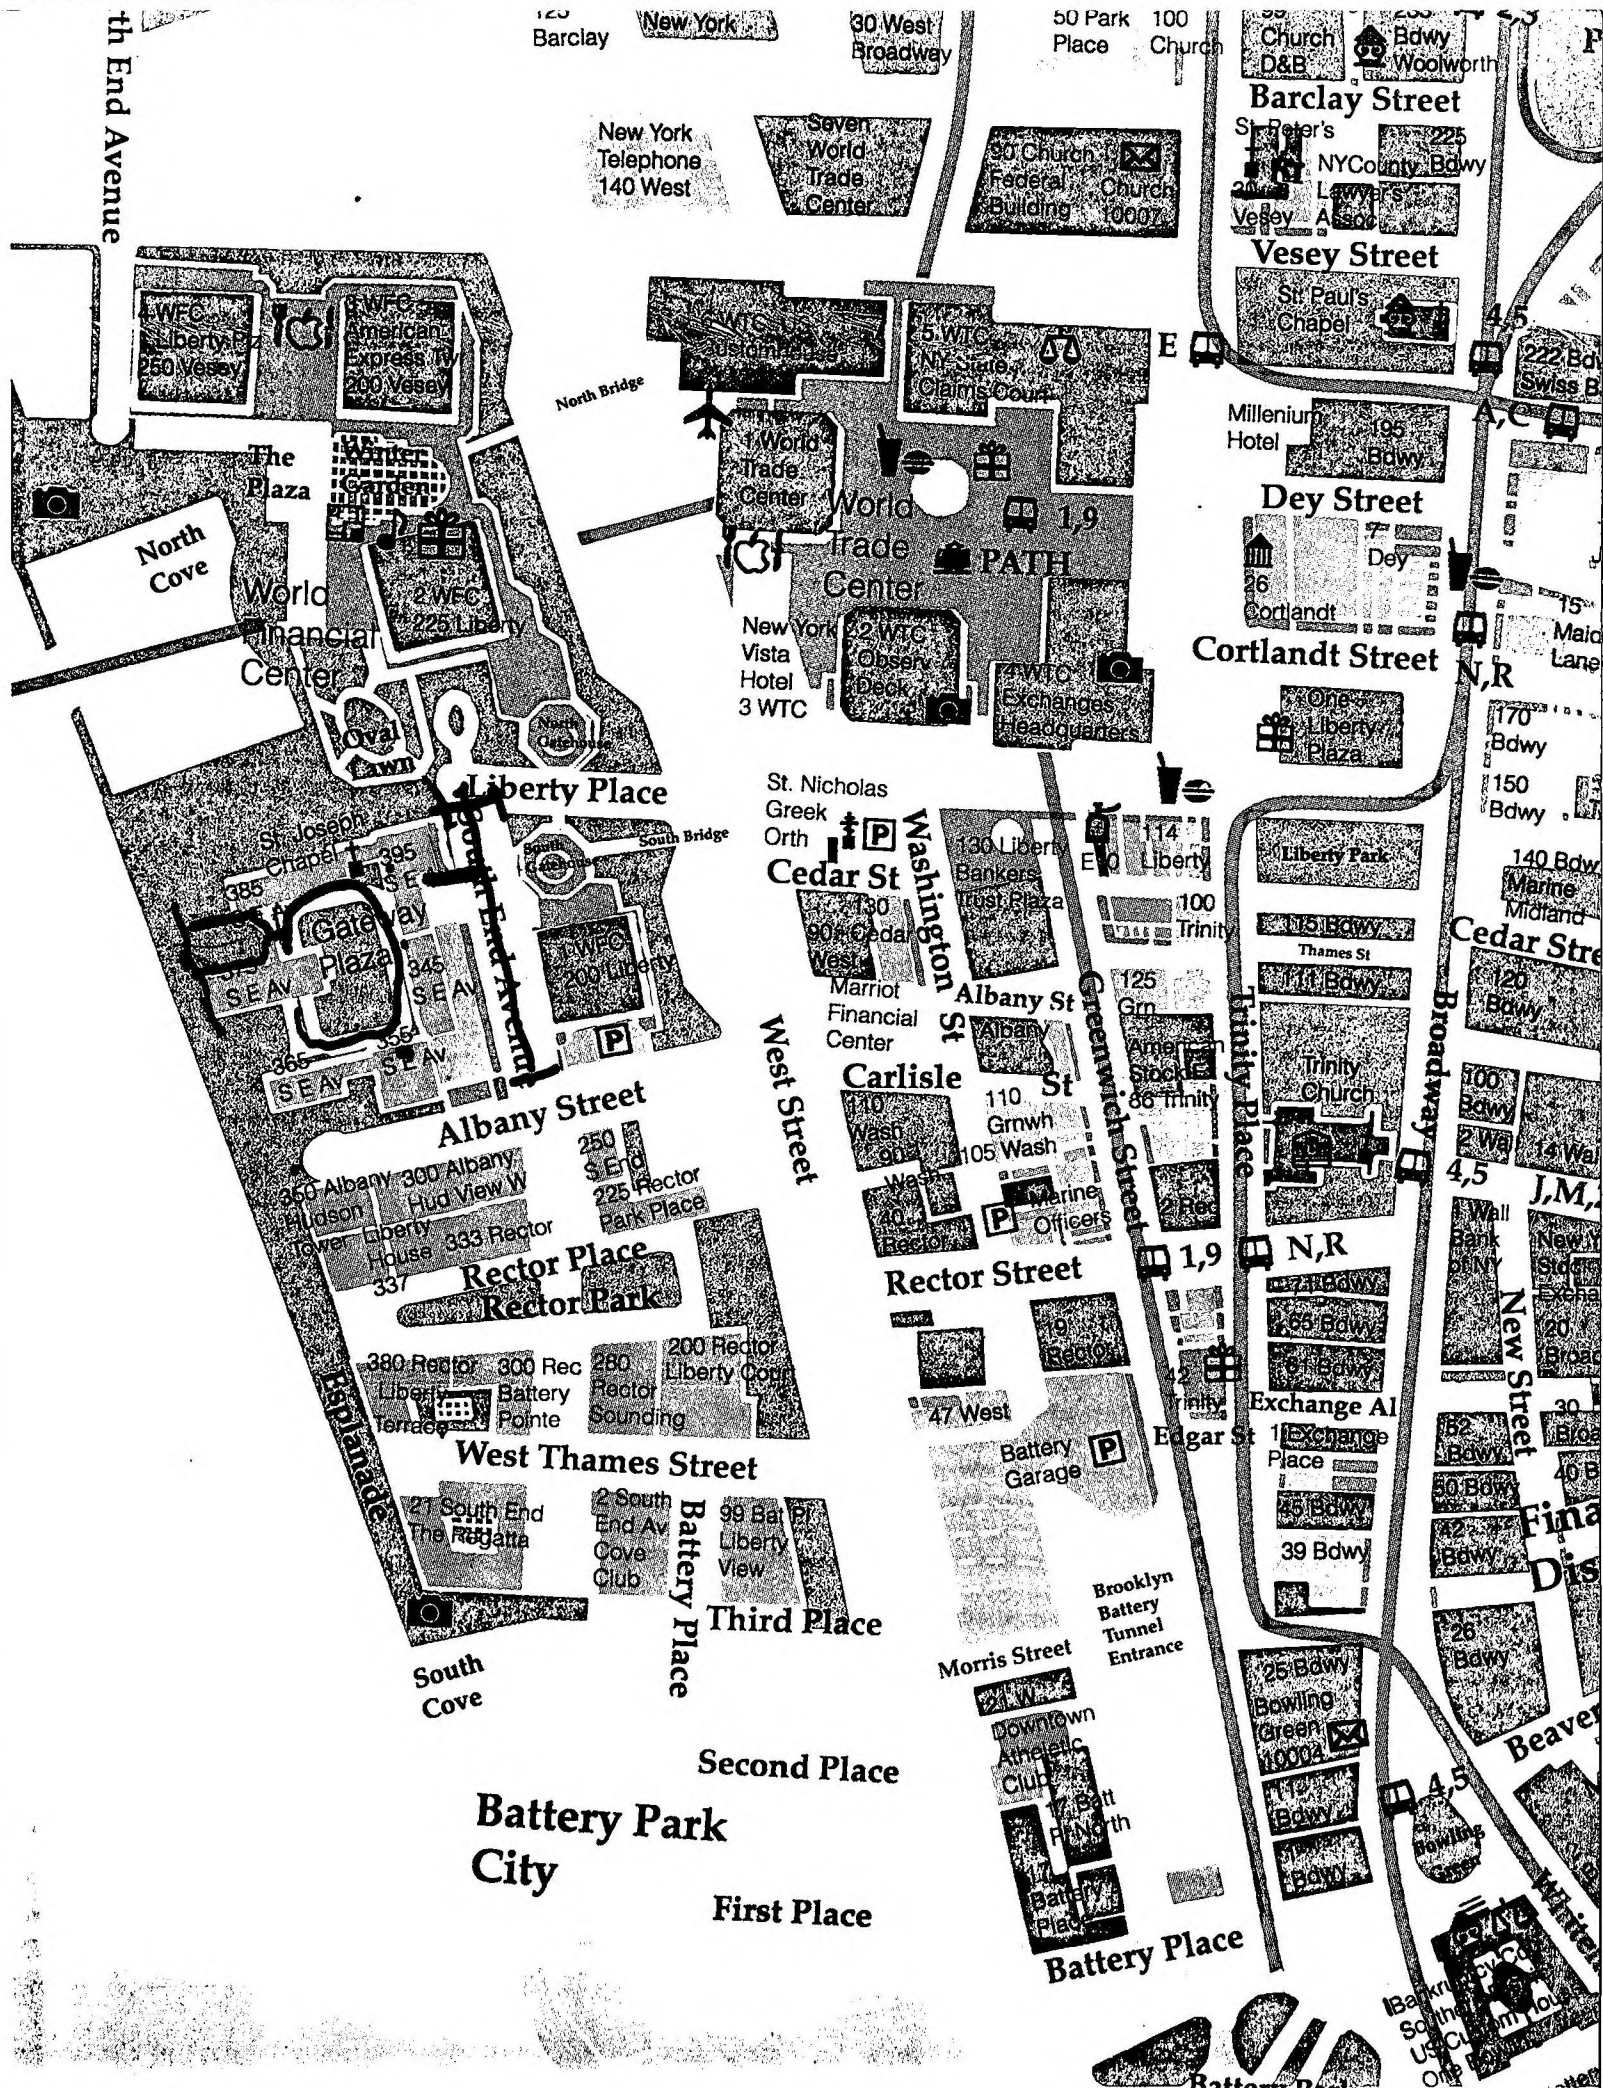

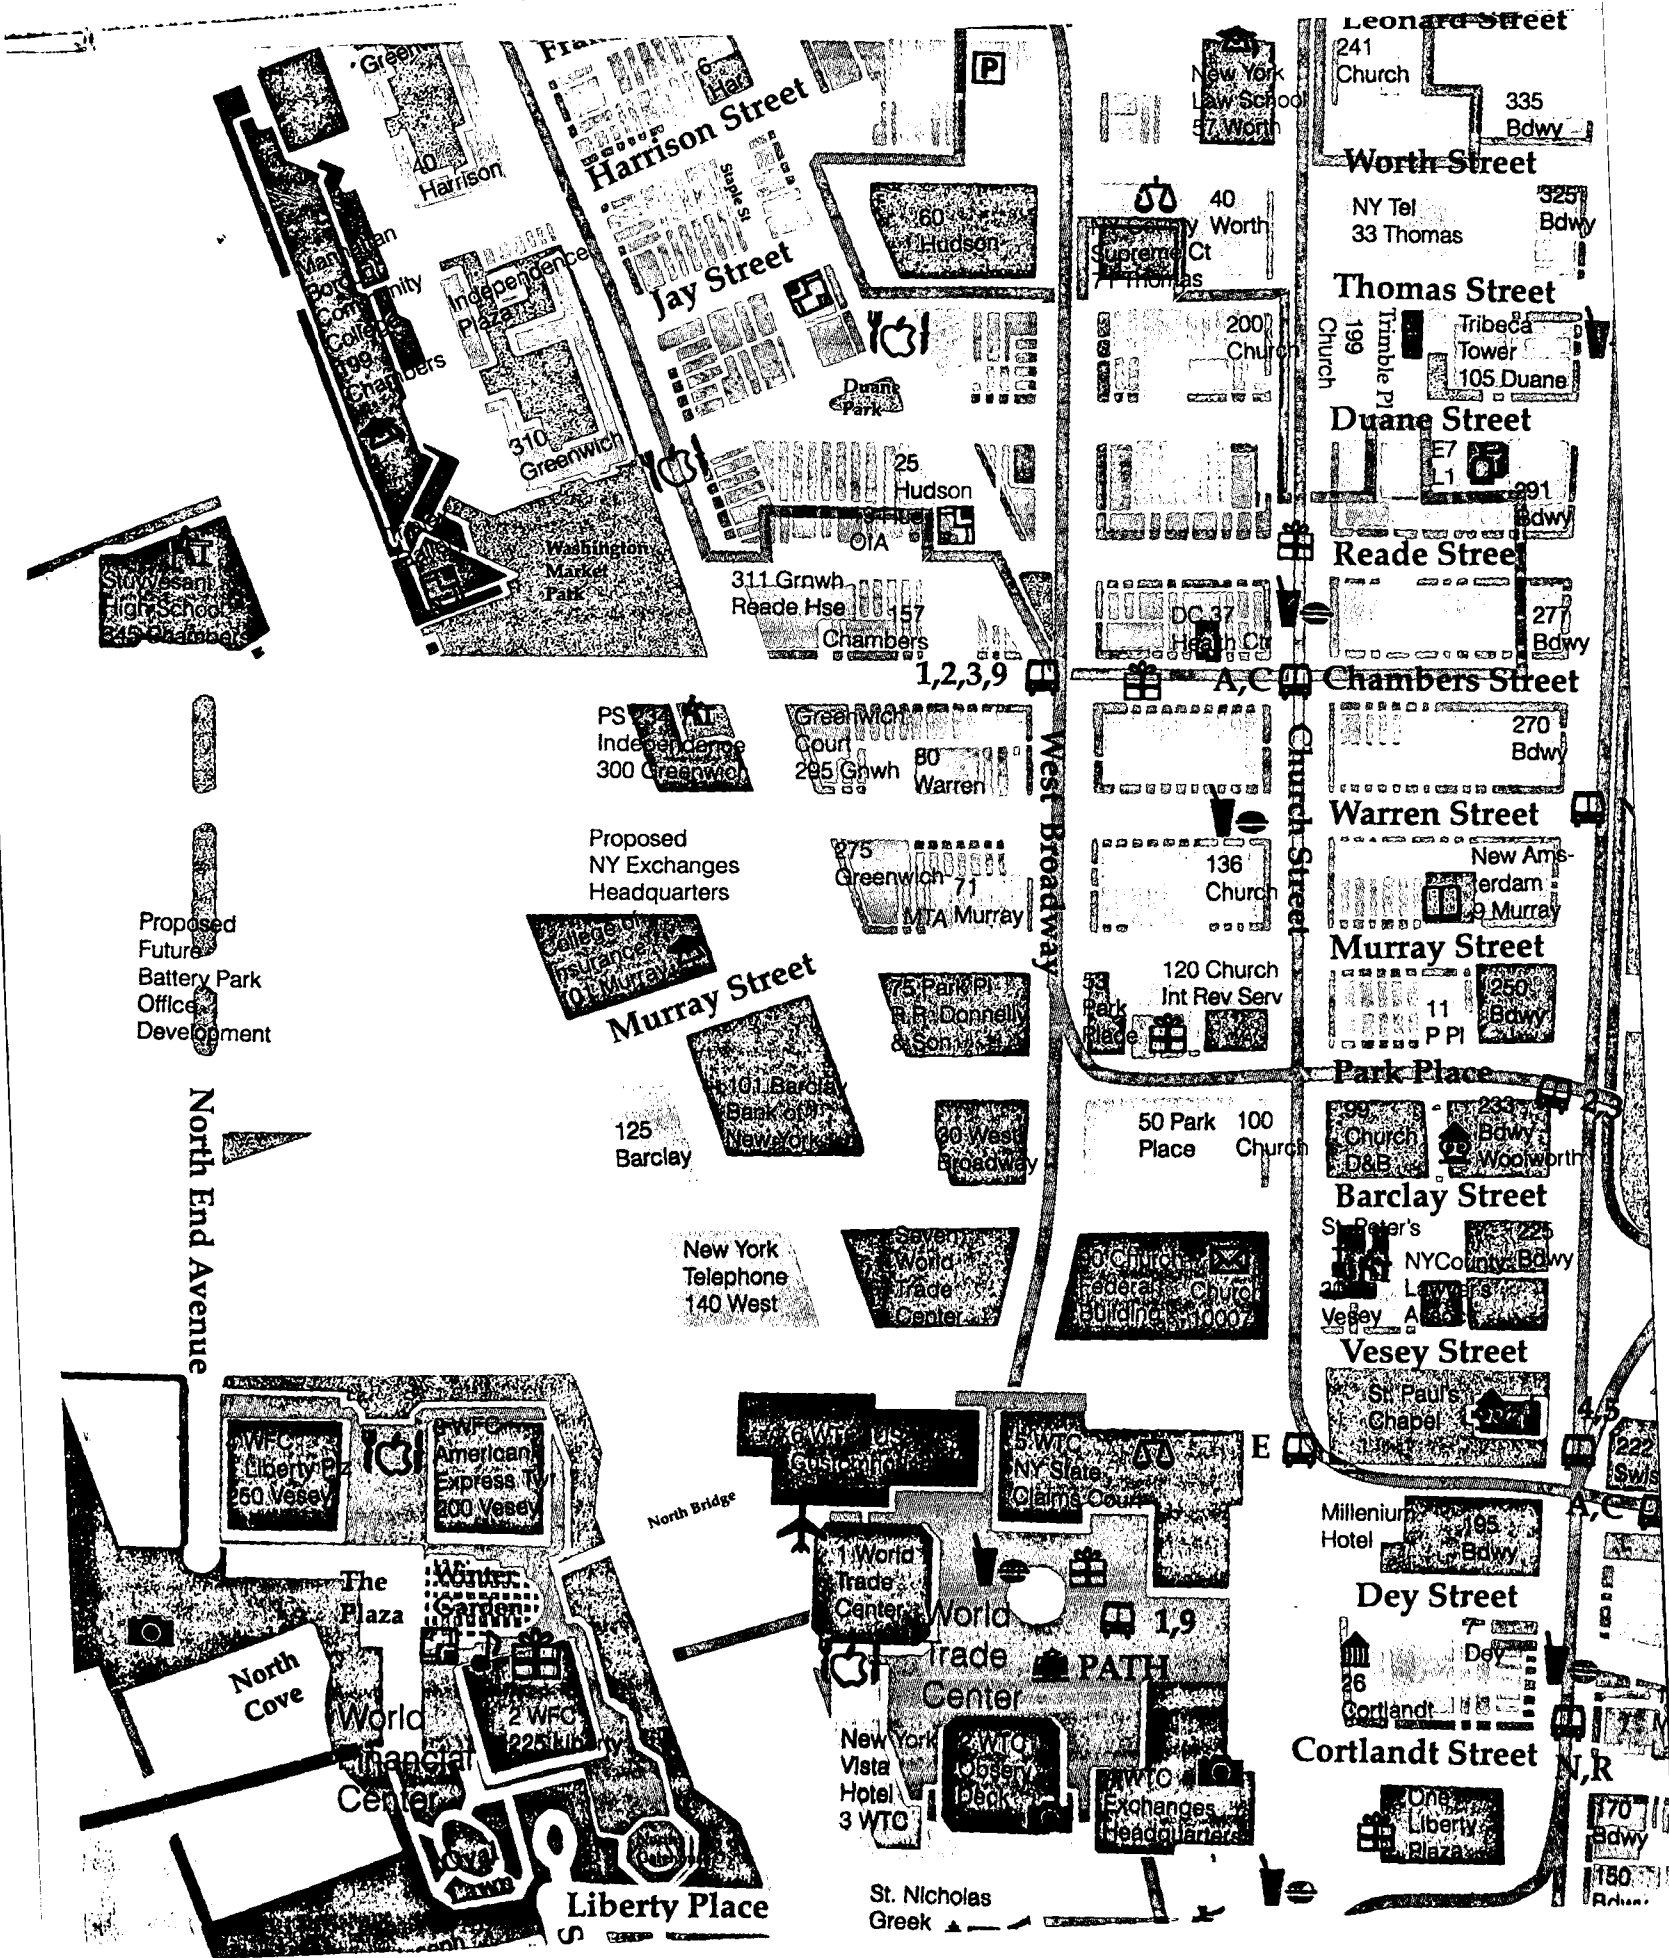

HazMat Air Sampling 9/13 - 9/21

