


JUL 18 20 17:55 PM 103 OPERATIONS

212 478 5647 TO 97882331


P.01/02

FRONT VIEW - Looking into Beam - W12

Example of beam
mounted antenna monopole
for multiple antennas

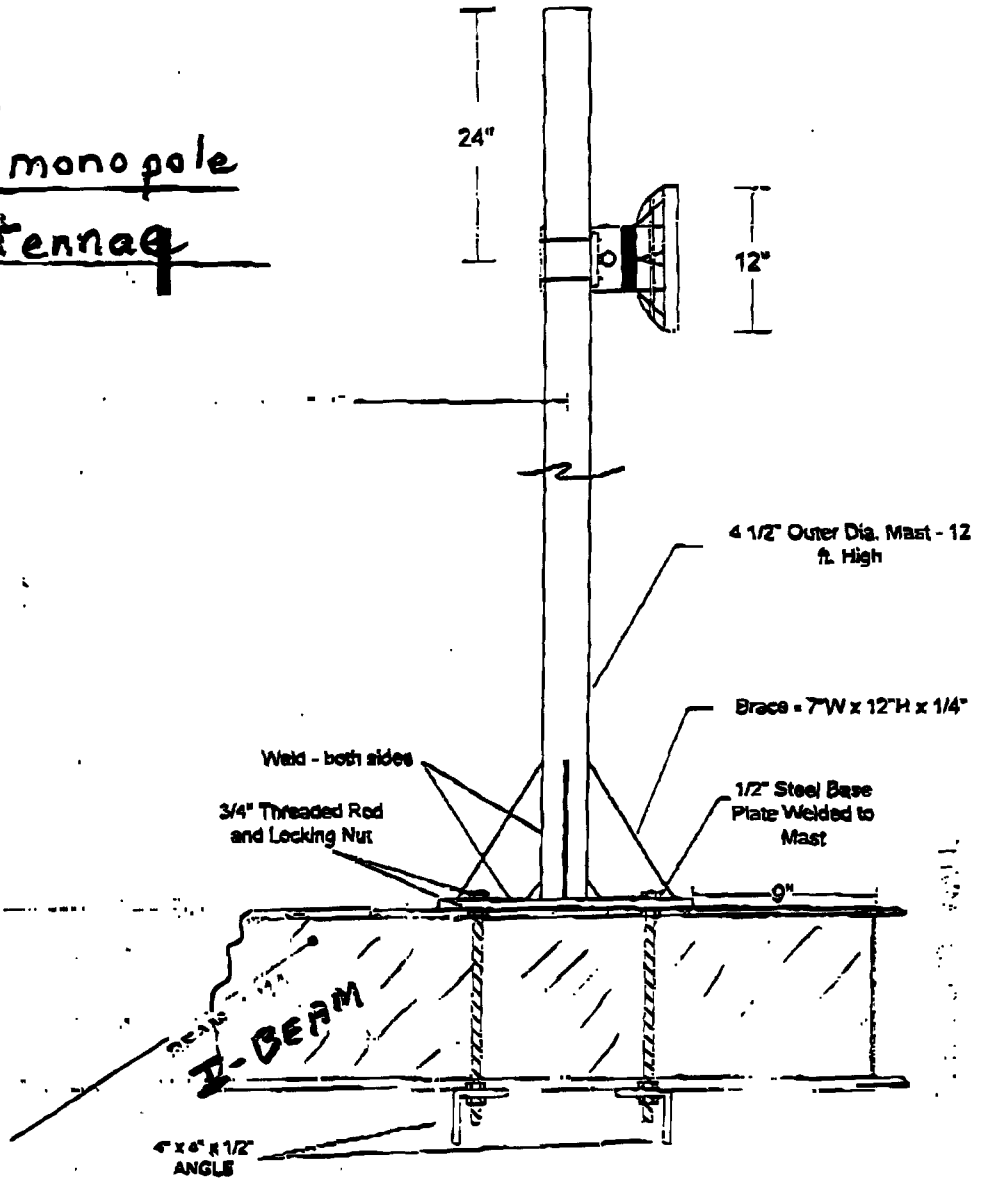

TOP VIEW - Looking Down on to the Roof

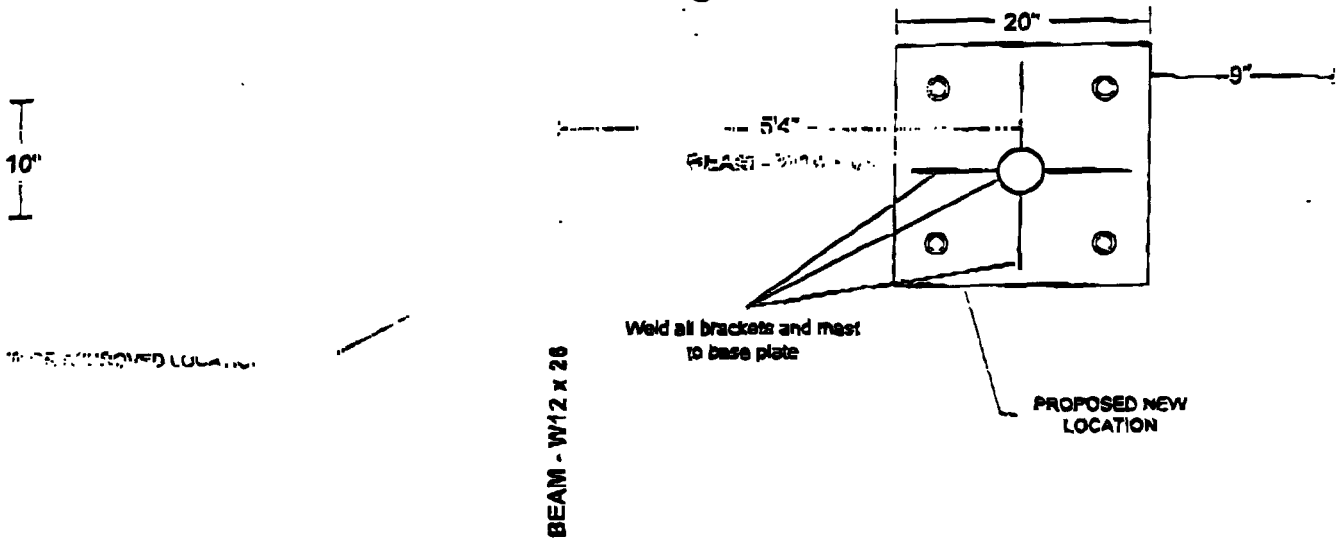


To use Motorola conduit to
the 23rd fl.


SENT BY:

9-28-98 ; 3:09PM ; CANTOR SEINUK GROUP-


2190059;# 2/ 2

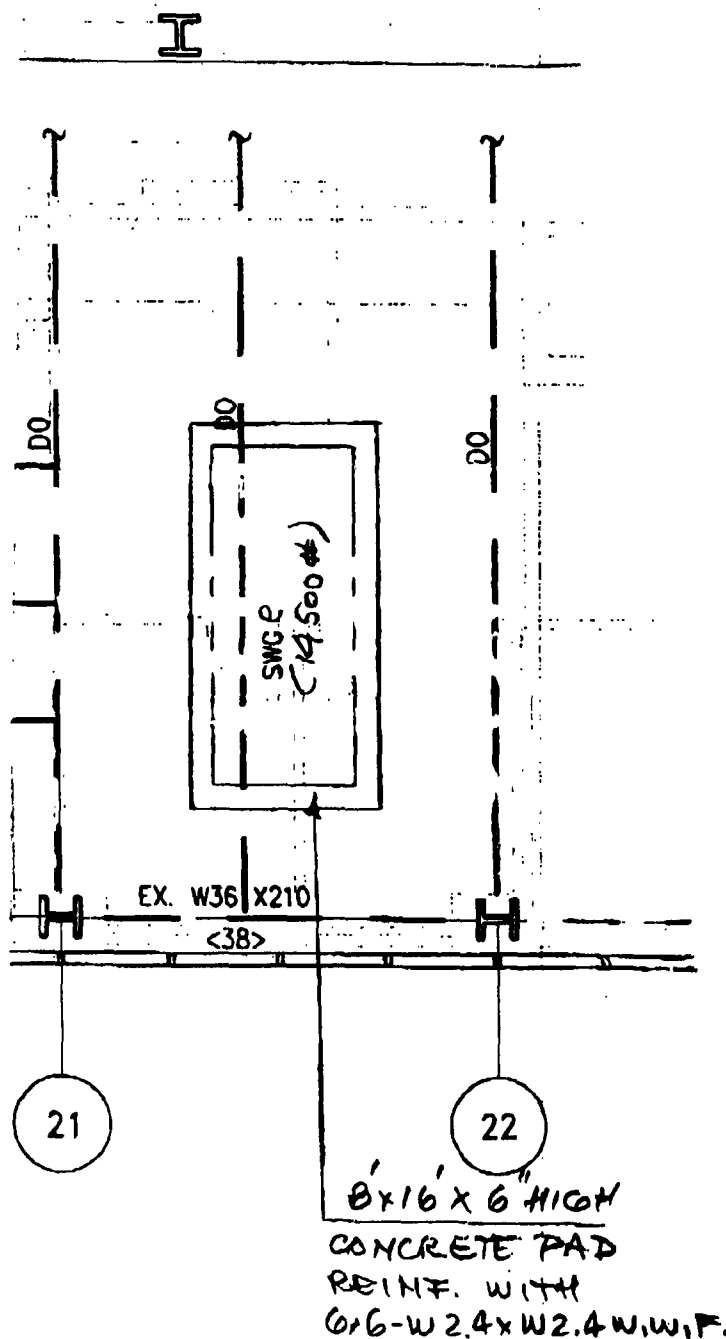

CANTOR SEINUK GROUP, PC CONSULTING ENGINEERS 600 MADISON AVENUE NEW YORK, NEW YORK 10022 	STRUCTURE OEM — 7 WTC —			
	SUBJECT 7TH FLOOR CONCRETE PAD AT SWITCHGEAR			
	ARCHITECT SHC		DATE 9/28/98	SK. S-7.2

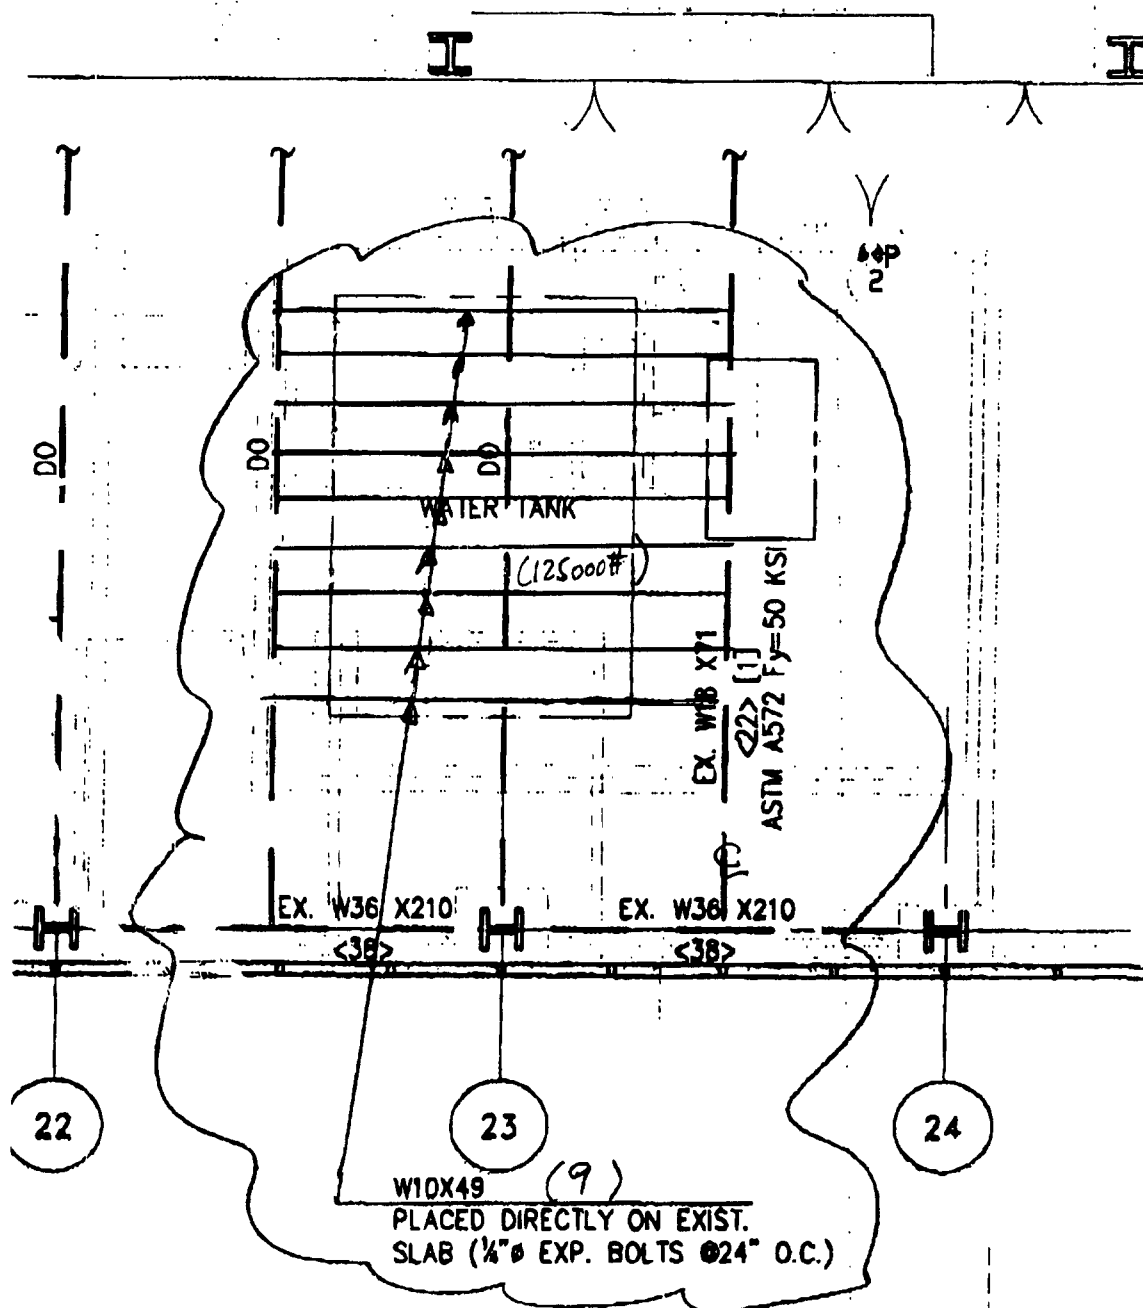

CANTOR SEINUK GROUP, PC CONSULTING ENGINEERS 600 MADISON AVENUE NEW YORK, NEW YORK 10022 	STRUCTURE OEM - 7WTC -	
	SUBJECT 7TH FLOOR NEW STEEL SUPPORT FOR WATER TANK	
	ARCHITECT SHC	DATE 9/28/98
	SK. S-7.1	

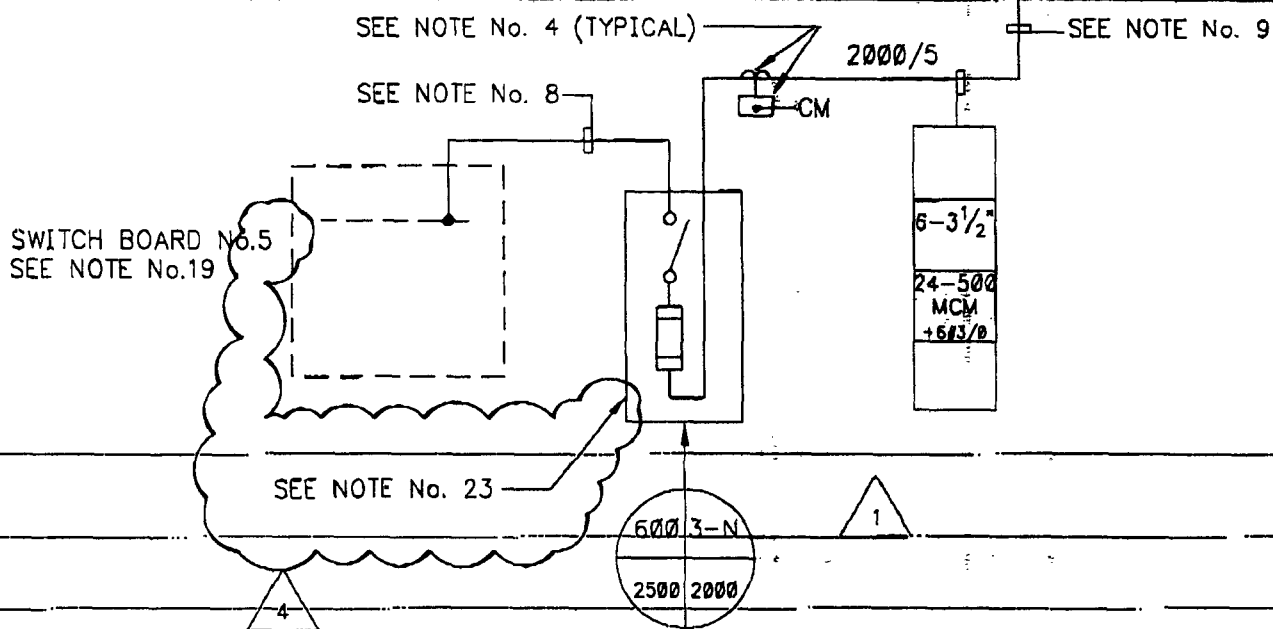

8. TAP EXISTING SERVICE TAKE-OFF TO FEED NEW SWITCH. EXACT LOCATION WILL BE DETERMINED IN FIELD. LENGTH OF RUN NOT TO EXCEED 25'.

21. PROVIDE SHUNT TRIP BREAKER

22. TAP TRANSFORMER SECONDARY TO FEED DISCONNECT SWITCH.

23. PROVIDE DIAL TYPE VOLTMETER AND AMMETER, VOLTMETER SWITCH, AMMETER SWITCH AND 2500/5 CURRENT TRANSFORMERS (TOTAL 3). COORDINATE CURRENT TRANSFORMER REQUIREMENT WITH SUBMETERING INSTALLATION.

				PROJECT:	
				7 WORLD TRADE CENTER	
△		REVISION NO.4			
NO.	BY	REVISION	DATE	REFERENCE DWG: E3.01	
<i>Cosentini Associates</i> CONSULTING ENGINEERS TWO PENNSYLVANIA PLAZA, NEW YORK, N.Y. 10121				DESCRIPTION MAYOR'S EMERGENCY OPERATION CENTER POWER RISER DIAGRAM	
DATE: 10/2/98 JOB NO.: 1854 DRAWN: SL CHECKED: SG				FSK-E5	