

09/11/98 FRI 14:58 FAX 2126458962

KABACK

001

45 W. 25TH St. New York, NY 10010
(212) 645-5101
Fax (212) 645- 862

**KABACK
ENTERPRISES, INC.**

Fax

To: GLEN
~~ALICE~~

From: DONALD

Fax: _____ **Pages:** _____

Phone: _____ **Date:** _____

Fax: _____ **CC:** _____

☐ Urgent ☐ For Review ☐ Please Comment ☐ Please Reply ☐ Please Recycle

Comments:

OEM 7WTC

Block B. by [signature]

Cosentini

ASSOCIATES LLP

CONSULTING ENGINEERS

TWO PENNSYLVANIA PLAZA + NEW YORK NY 10121

(212) 615-3600

FAX: (212) 615-3700

FAX COVER SHEET

Date: 9/11/98

From: SIVAM GOUNDER

To: JOE ALIOTTA

Company: SHCA

Fax No: 669-4107

Re: OEM

Total No. of Pages: 5

Job No: 1854

Comments:

1. PANEL DOES NOT CALL FOR SHORT CIRCUIT RATING. SPECIFICATION CALLS FOR SHORT CIRCUIT RATING. (SPECIFICATION PAGE 16400-6
2. BY CODE, THE PANEL IS TO BE USED AS #2. THE PANEL IS TO BE USED AS #2.

Original will be sent via:

☐ Mail☐ Fed Ex☐ Messenger☐ Original will not be sent


cc: Name:

Company

Fax No.

3

Owner
Silverstein Properties, Inc.
521 Fifth Avenue NY, NY 1017
Architects
Swanke Hayden Connell
205 Lafayette St. NY, NY 1001.
Mechanical Engineer
Cosentini Associates LLP
Two Pennsylvania Plaza NY, NY
Structural Engineer
The Cantor Seinuk Group, P.C.
600 Madison Avenue NY, NY 10
Construction Manager
Ambassador Construction Co., Inc.
317 Madison Avenue NY, NY 10

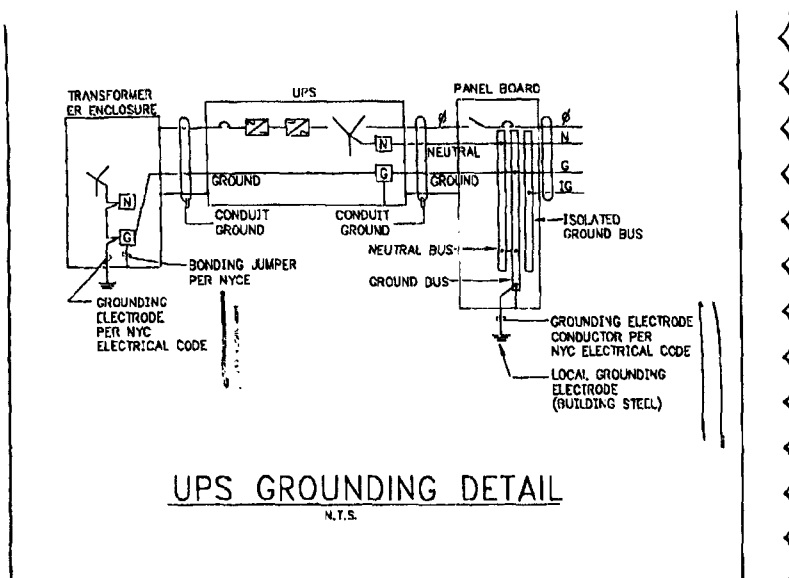

rev no	date	comment
1	1/26/98	OD ISSUANCE
2	4/6/98	ISSUED FOR REVIEW - 100% CD
3	5/13/98	ISSUED FOR P.A. REVIEW
4	5/15/98	ADDENDUM #1

DRAWING
NO. E4.03

④

ARTICLE 8

GROUNDING CONDUCTORS

3110

Table 1
System Ground Equipment Grounding
and Bonding Conductors

<i>Sizes of Largest Circuit Conductor or Equivalent for Multiple Conductors or Multiple Services</i>		<i>Size of Grounding Conductor (AWG)</i>	
<i>Copper</i>	<i>Aluminum</i>	<i>Copper</i>	<i>Aluminum</i>
12	12	16*	12*
10	8	14*	12*
8	6	12*	10*
6	4	10*	8*
4 to 2	0	8	6
1 or 0	2/0 or 3/0	6	4
2/0 or 3/0	4/0 or 250 MCM	4	2
Over 3/0 to 350 MCM	Over 250 MCM to 500 MCM	2	0
Over 350 MCM to 600 MCM	Over 500 MCM to 900 MCM	0	3/0
Over 600 MCM to 1100 MCM	Over 900 MCM to 1750 MCM	2/0	4/0
Over 1100 MCM	Over 1750 MCM	3/0	250 MCM

* Permissible for equipment grounding only but shall not be attached to a circuit conductor.
 No. 18 copper or No. 14 aluminum wire shall be minimum used for portable or pendant equipment
 grounding if the branch circuit over-current device does not exceed fifteen amperes.

h. The grounded circuit conductor and/or neutral conductor of an interior wiring system shall not be used for grounding conduit, armored cable, other raceways or equipment.

i. Lightning rods shall not be used as grounding conductors.

j. Grounding conductors of lightning arresters shall not be smaller than No. 6 and shall meet the same installation requirements as grounding conductors of interior wiring systems. They shall not be used as system or equipment grounding conductors.