


EMSL Analytical, Inc.

208 Stonehenge Lane

Carle Place, NY 11514

Phone: (516) 997-7251

Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410


**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ - < 5μ	$\geq 5\mu$ Non- Asbestos			(S/mm ²)	(S/cc)
284	1200.00	None Detected		0	0.0762	0.0042	<13.12	<0.0042
318	1350.00	None Detected		0	0.0635	0.0045	<15.75	<0.0045
319	1350.00	None Detected		0	0.0635	0.0045	<15.75	<0.0045
320	1350.00	None Detected		0	0.0635	0.0045	<15.75	<0.0045
321	1350.00	None Detected		0	0.0635	0.0045	<15.75	<0.0045
322	1320.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046

Michelle McGowan

Analyst


 Approved
 Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by the laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analyst accuracy and precision) is available upon request.

Accredited for NVLAP PLM/TEM #101048-10, NY LLAP 11469, CA ELAP 2339, CT PH4249

CITY_21MC100_012545262

EMSL Analytical, Inc.

208 Stonehenge Lane

Carle Place, NY 11514

Phone: (516) 997-7251

Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410


**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			≥ 0.5μ - < 5μ	Non- Asbestos ≥ 5μ			(S/mm ²)	(S/cc)
323	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
324	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
325	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
326	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
327	1310.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046
328	1330.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046

Daniel Clarke

Analyst


 Approved
Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

2

Accredited for NVLAP PLAN/TEM #101048-10, NY ELAP 1146-9, CA ELAP 2339, CT ELAP 0049

CITY_21MC100_012545263

EMSL Analytical, Inc.

208 Stonehenge Lane
 Carle Place, NY 11514
 Phone: (516) 997-7251 Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise
 270 Swinton Avenue
 Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410

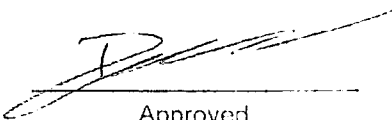
Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ - < 5μ	Non- Asbestos			(S/mm ²)	(S/cc)
329	1330.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046
330	1330.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046
331	1330.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046
332	1330.00	None Detected		0	0.0635	0.0046	<15.75	<0.0046
333	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
334	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043

Michelle McGowan

Analyst


 Approved
 Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel.
 This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL.
 This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples
 reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

Accredited for NVLAP P1M TEM #101048-10, NY ELAP 11469, CA ELAP 2339, CT PH 0249

CITY_21MC100_012545264

EMSL Analytical, Inc.

208 Stonehenge Lane

Carle Place, NY 11514

Phone: (516) 997-7251

Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410

**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES			Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			≥ 0.5μ - < 5μ	≥ 5μ	Non- Asbestos			(S/mm ²)	(S/cc)
335	1400.00	None Detected			0	0.0635	0.0043	<15.75	<0.0043
336	1400.00	None Detected			0	0.0635	0.0043	<15.75	<0.0043
337	1400.00	Chrysotile	3	0	0	0.0635	0.0043	47.24	0.0130
338	1450.00	None Detected			0	0.0635	0.0042	<15.75	<0.0042
339	1450.00	None Detected			0	0.0635	0.0042	<15.75	<0.0042
340	1450.00	None Detected			0	0.0635	0.0042	<15.75	<0.0042

Michelle McGowan

Analyst



Approved
Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

4

Accredited for NVLAP PLM/TEM #101048-10, NY ELAP 11469, CA ELAP 2320, CT PH 0241

CITY_21MC100_012545265

EMSL Analytical, Inc.

208 Stonelinge Lane

Carle Place, NY 11514

Phone: (516) 997-7251

Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410

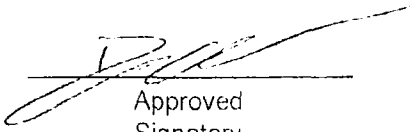
**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ < 5μ	$\geq 5\mu$ Non-Asbestos			(S/mm ²)	(S/cc)
341	1450.00	None Detected		0	0.0635	0.0042	<15.75	<0.0042
342	1450.00	None Detected		0	0.0635	0.0042	<15.75	<0.0042
343	1540.00	None Detected		0	0.0635	0.0039	<15.75	<0.0039
344	1540.00	None Detected		0	0.0508	0.0049	<19.69	<0.0049
345	1540.00	None Detected		0	0.0508	0.0049	<19.69	<0.0049
346	1550.00	None Detected		0	0.0508	0.0049	<19.69	<0.0049

Michelle McGowan

Analyst


 Approved
Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVEAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

5

Accredited for NVEAP P117/TEM #101048-10, NY FLAP 11464, CA FLAP 2339, CT P11-0249


CITY_21MC100_012545266

EMSL Analytical, Inc.

208 Stonehenge Lane

Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410

**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ - < 5μ	Non- Asbestos			(S/mm ²)	(S/cc)
347	1540.00	None Detected		0	0.0508	0.0049	<19.69	<0.0049
348	1250.00	None Detected		0	0.0635	0.0049	<15.75	<0.0049
349	1250.00	None Detected		0	0.0635	0.0049	<15.75	<0.0049
350	1250.00	None Detected		0	0.0635	0.0049	<15.75	<0.0049
351	1250.00	None Detected		0	0.0635	0.0049	<15.75	<0.0049
352	1250.00	None Detected		0	0.0635	0.0049	<15.75	<0.0049

Daniel Clarke

Analyst


 Approved
 Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced except in full without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

Accredited for NVLAP PLM TEM #101048-10, NY ELAP 11469, CA ELAP 2339, C.E. PHE 0249

CITY_21MC100_012545267

EMSL Analytical, Inc.208 Stonehinge Lane
Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise
270 Swinton Avenue
Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410


**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ - < 5μ	$\geq 5\mu$ Non-Asbestos			(S/mm ²)	(S/cc)
353	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
354	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
355	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
356	1660.00	None Detected		0	0.0635	0.0037	<15.75	<0.0037
357	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
358	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047

Daniel Clarke

Analyst


 Approved
Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

7

Accredited for NVLAP PLM/TEM #101048-10, NY LLAP 11492, CA ELAP 2339, CT PH-0242

CITY_21MC100_012545268

EMSL Analytical, Inc.

208 Stonehenge Lane

Carle Place, NY 11514

Phone: (516) 997-7251

Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise

270 Swinton Avenue

Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410


**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			≥ 0.5μ - < 5μ	Non- Asbestos			(S/mm ²)	(S/cc)
359	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
360	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
361	1300.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
362	1290.00	None Detected		0	0.0635	0.0047	<15.75	<0.0047
363	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
364	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043

Daniel Clarke

Analyst


 Approved
 Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysts' accuracy and precision) is available upon request.

8

Accredited for NVLAP PLM# EM #101048-10; NY ELAP 11465; CA ELAP 2539; CI PH 0249

CITY_21MC100_012545269

EMSL Analytical, Inc.208 Stonehinge Lane
Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528



Attn.:

Commercial Lab Enterprise
270 Swinton Avenue
Bronx, NY 10465

Tuesday, October 30, 2001

Ref Number: LI0116410

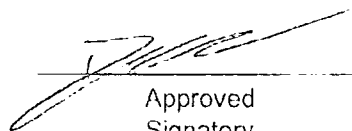
**Asbestos Fiber Analysis by Transmission Electron Microscopy (TEM)
Performed by EPA 40 CFR Part 763 Final Rule (AHERA)**

Project: BLDG #3 - 40 HARRISON ST NY, NY 25TH FLR - 01231

Sample ID	Volume (liters)	Asbestos Type(s)	# STRUCTURES		Area Analyzed (mm ²)	Analytical Sensitivity (S/cc)	Asbestos Concentration	
			$\geq 0.5\mu$ - < 5μ	$\geq 5\mu$ Non- Asbestos			(S/mm ²)	(S/cc)
365	1400.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
366	1410.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
367	1420.00	None Detected		0	0.0635	0.0043	<15.75	<0.0043
368	0.00	None Detected		0	0.0635		<15.75	
369	0.00	None Detected		0	0.0635		<15.75	
370	0.00	None Detected		0	0.0635		<15.75	

Daniel Clarke

Analyst


 Approved
Signatory

Disclaimers: This laboratory is not responsible for data reported in structures/cc, which is dependent on volume collected by non-laboratory personnel. This laboratory is only responsible for data reported in structures/mm². This report may not be reproduced, except in full, without written approval by EMSL. This report must not be used to claim product endorsement by NVLAP or any agency of the U.S. Government. This report relates only to the samples reported above. Quality control data (including 95% confidence limits and laboratory and analysis accuracy and precision) is available upon request.

9

Accredited for NVLAP PLM/TEM #101049-10, NY E1AP 11469, CA E1AP 2339, CT PH-0245

CITY_21MC100_012545270