

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 1 of 1

TIME 809

LOCATION 100 Verity

DATE 4-16/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
Exit MAIN Entry		80.6	54.2	820	3	21	00
Exit MAIN Entry ^{SOUTH}		81.4	54.6	824	2	22	00
Exit MAIN Entry ^{NORTH}		82.3	52.7	862	2	22	00
10th Hallway	2	81.6	51.9	861	2	21	00
Library	4	82.7	52.4	818	2	21	00
RM 1006	5	81.6	52.7	725	2	21	00
Staircase A 9th fl	6	80.4	51.9	811	2	21	00
9th fl Hallway	1	82.6	53.2	724	2	21	00
RM 915	8	80.2	52.6	7126	2	22	00
RM 933	4	81.3	50.2	748	2	21	00
Guideline levels ASHRAE/AIHA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☐ Does ☒ Does not meet established indoor air quality guidelines.

Signature:

[Handwritten Signature]

Date:

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL

CITY_21MC100_003462272

ATC ASSOCIATES, INC.

Page 2 of 2

TIME 821

INDOOR AIR QUALITY FIELD REPORT

LOCATION 100 Trinity pl. DATE 4-16-02 PROJECT NO. 19/25-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOC's (ppm)
RM 903	3	78.9	55.7	1321	4	27	00
Staircase B 8th fl.	0	79.8	49.4	940	3	33	00
8th fl. Hallway	0	80.1	49.1	831	3	30	00
* Kitchen	3	80.2	55.2	1222	4	32	00
Cafeteria	1	80.1	50.5	882	3	31	00
Staircase A 7th fl.	0	79.1	51.4	1412	3	31	00
7th fl. Hallway	0	80.6	49.7	918	3	30	00
RM 706	21	80.9	49.0	823	3	31	00
RM 705	18	80.1	48.2	822	3	32	00
RM 704	24	80.1	48.7	825	3	30	00
Guideline levels ASHRAE/AIHA/EPA		68 - 75°F/winter 73 - 79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.

Signature: _____

Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462273

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 3 of 3

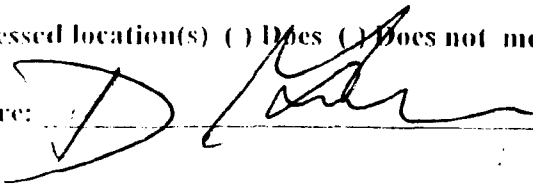
TIME 9:00

LOCATION 100 Trinity

DATE 4-16-02 PROJECT NO. 19125-02 91

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	VOCs (ppm)
RM 703	19	80.2	47.9	862	3	32	00
Staircase 6th fl.	0	80.1	48.2	821	3	31	00
6th Hallway	0	80.2	58.4	832	3	31	00
RM 606	25	81.0	57.2	761	3	30	00
RM 607	14	80.6	52.6	860	3	30	00
RM 605	12	80.2	51.2	742	3	28	00
Staircase 5th fl.	0	80.0	50.1	748	3	28	00
5th Hallway	6	80.1	51.6	1121	3	26	00
RM 509	13	80.4	50.8	792	3	24	00
RM 510							
Guideline levels ASHRAE/AHIA/EPA		68 - 75°F/winter 73 - 79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☐ Does ☒ Does not meet established indoor air quality guidelines.Signature: 

Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462274

ATC ASSOCIATES, INC.

Page A of 1TIME 925

INDOOR AIR QUALITY FIELD REPORT

LOCATION 100 County St DATE 4-16/02 PROJECT NO. 19/25-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
RM 504	9	80.2	55.2	942	3	28	00
Stair case B 4th fl	0	80.4	54.4	941	3	26	00
4th fl Hallway	0	81.3	51.6	821	3	22	00
RM 405	12	80.7	51.8	816	3	21	00
RM 406	10	80.6	52.6	822	3	21	00
RM 410	14	80.1	51.9	814	3	21	00
Stair case 3rd fl.	0	81.2	52.4	792	3	22	00
3rd fl Hallway	0	80.4	51.0	716	3	21	00
RM 308	11	80.8	50.4	820	3	22	00
RM 309	10	81.4	52.9	921	3	22	00
Guideline levels ASHRAE/AIHA/EPA		68 - 75°F/winter 73 - 79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.Signature: D. [Signature]

Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462275

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 5 of 5

TIME 9:49

LOCATION 100 Trinity PL

DATE 3/16/02

PROJECT NO. 19125-0294

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
RM 207	19	80.1	51.6	942	2	21	00
RM 206	16	80.4	52.4	811	2	21	00
Pharmacy	0	80.3	52.6	816	2	21	00
BSM Hallway	0	80.6	52.9	821	2	20	00
5th Fl	0	81.4	51.8	814	2	22	00
Auditorium	6	80.2	52.9	818	2	22	00
1st Fl Lobby	8	80.5	52.0	804	2	22	00
Exit Main Entry		81.7	50.7	819	2	22	00
Exit Main Entry South		81.6	50.8	840	2	22	00
Exit Main Entry North		81.8	51.6	833	2	21	00
Guideline levels ASHRAE 62.1-1999		68-75°F/winter 73-79°F/summer		Outdoor level + 700 ppm		65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☐ Does ☒ Does not meet established indoor air quality guidelines.

Signature

T. [Signature]

Date:

CONFIDENTIAL, SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008 CITY_21MC100_003462276

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 6 of 6

TIME 10:00

LOCATION 100 Trinity Pl

DATE 8/16/02

PROJECT NO. 19125-029

Location	Occupancy	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
Exit Main Entrance		81.6	51.9	899	2	24	00
Exit Main Entrance South		81.7	52.3	798	2	22	00
Exit Main Entrance North		81.3	51.6	842	2	22	00
1 st fl. RM 102	1	81.6	52.6	892	2	22	00
1 st fl. RM 105	1	81.2	52.8	794	2	22	00
Guideline levels ASHRAE 62.1-2001		68-75°F/winter 74-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The above locations () Do () Do not meet established indoor air quality guidelines.

Date:

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462277

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 7 of 7

TIME 230

LOCATION 100 Trinity

DATE 11-16-02

PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
Exit Main Entry		82.6	54.3	821	3	22	00
Exit Main Entry South		81.5	56.2	816	3	21	00
Exit Main Entry North		81.2	51.6	862	3	21	00
10th Hallway		79.5	50.8	732	3	21	00
Library		79.4	51.6	794	3	21	00
RM 1006 N		79.4	48.1	948	2	21	00
Staircase A 9th fl		79.0	47.0	748	3	25	00
9th fl Hallway		78.6	47.6	752	3	27	00
RM 915		79.9	49.2	755	3	27	00
RM 933		79.5	50.3	825	3	23	00
Guideline levels ASHRAE/AHIA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature:

Date:

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462278

ATC ASSOCIATES, INC.

Page 8 of

TIME 1500

INDOOR AIR QUALITY FIELD REPORT

LOCATION 100 Liberty pl DATE 4-16-02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates(µg/m³)	TVOCs (ppm)
RM 903	3	78.8	58.6	1214	2	28	00
Staircase B 8th fl.	0	80.2	51.9	412	4	24	00
8th fl. Hallway	0	79.3	48.6	832	3	21	00
Kitchen	3	81.6	55.2	1021	3	29	00
Cafeteria	4	80.1	51.4	816	3	30	00
Staircase A 7th fl.	0	80.2	52.4	811	3	22	00
7th fl. Hallway	0	80.6	49.9	918	3	29	00
RM 706	21	80.2	49.7	862	3	30	00
RM 705	18	80.9	52.6	813	3	28	00
RM 704	20	80.4	51.5	917	3	27	00
Guideline levels ASHRAE/AIHA/EPA		68 -75°F/winter 73 -79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.

Signature: _____ Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462279

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 9 of 9

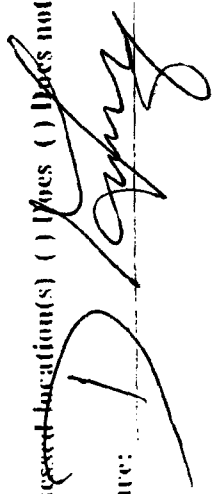
TIME: 1530

LOCATION: 100 Family P. DATE: 4-16/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	VOCs (ppm)
RM 703	21	81.0	49.4	873	3	35	00
Staircase 6th fl.	0	80.5	49.1	764	3	32	00
Hallway	0	80.2	58.0	822	3	31	00
RM 606	26	79.9	57.9	76.8	3	30	00
RM 605	12	80.0	50.5	72.6	3	26	00
RM 604	18	79.8	52.1	887	3	30	00
Staircase 5th fl.	0	79.6	51.8	1150	3	32	00
6th fl. Hallway	12	79.6	52.6	1076	3	30	00
RM 509	18	79.8	51.7	1021	3	31	00
RM 510	18	80.0	53.0	1127	3	30	00
Guideline levels ASHRAE/IAQ/IEPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: 

Date:

CONFIDENTIAL,

CITY_21MC100_003462280

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

TIME ~~(0500)~~ 16:00ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 1 of 1

LOCATION 100 Trinity St DATE 4-16-02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
RM 504	7	81.3	53.4	811	2	24	00
3 rd floor core B	0	80.2	52.6	749	2	24	00
4 th fl	2	80.0	51.9	789	2	21	00
Hallway	11	80.1	52.6	794	3	22	00
RM 405	10	80.2	52.7	798	3	22	00
RM 406	12	81.4	50.2	714	3	22	00
RM 410	2	80.1	51.4	821	2	21	00
Stair case 3 rd fl.	0	80.0	50.6	814	2	22	00
3 rd fl Hallway	11	79.4	51.3	842	2	21	00
RM 308	9	80.2	50.9	912	2	21	00
RM 309							
Guideline levels ASHRAE/AIHA/EPA		68 - 75°F/winter 73 - 79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: _____ Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462281

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 1 of 1TIME 1630LOCATION 100 Trinity PlDATE 3-02 PROJECT NO. 19125-0290

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOC (ppm)
RM 207	16	80.7	52.9	821	4	21	00
RM 206	12	81.2	52.4	842	3	22	60
Stair case	0	81.6	52.8	843	2	22	60
B SM Hallway	0	81.0	52.0	823	2	22	00
LYM	0	81.8	50.6	796	2	22	60
Auditorium	12	80.3	51.6	749	2	22	00
1 st Fl Lobby	0	80.4	52.3	798	2	22	00
Exit Main Entry		81.6	54.6	796	2	21	00
Exit Main Entry South		81.9	53.9	713	2	21	00
Exit Main Entry North		81.8	52.7	832	2	21	00
Guideline levels ASHRAE/NIHA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.

Signature _____

Date: _____

SUBJECT TO PROTECTIVE ORDER NO. 2, SEPT. 2008

CONFIDENTIAL,

CITY_21MC100_003462282