Asbestos Air Monitoring Data Summary for Staten Island Landfill WTC Sampling
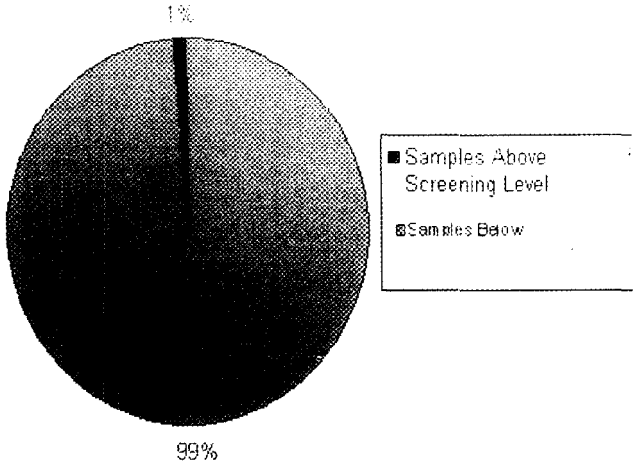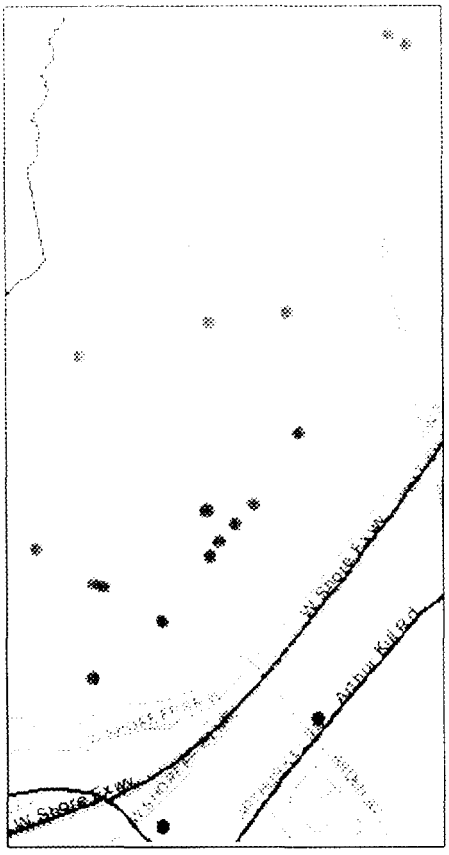
Totals (for sampling through 01/29/02, in s/mm2)	
Total Samples	3318
Samples Above Screening	39
% Above	1.17 %
Samples Below	3279
Maximum Value (11/05/01):	275.56
Minimum Value:	Not Detected
Screening Level*:	70
Average All:	11.40