NYC 9/11 Public Portal Document

ATTACHMENT 1

DUST TRAK® DATA GRAPHS & SUMMARIES

NYC 9/11 Public Portal Document

P.S. 150 M - Main Lobby

Current Test:	001
Start Time:	10:29:55 02/11/2002
Stop Time:	10:29:55 02/12/2002
Logging Interval:	60 seconds
Serial Number:	22813
Sensor:	Aerosol
Cal. Date:	06/22/2001
Channel:	Aerosol
(Units)	mg/m^3
Average:	0.009
Minimum:	0.006
Time	14:18:55
Date	02/11/2002
Maximum:	0.020
Time	12:10:55
Date	02/11/2002

CITY_21MC100_001062530

NYC-WTC_000194776

NYC 9/11 Public Portal Document

Main Lobby

Feb.; 11-12, 2002

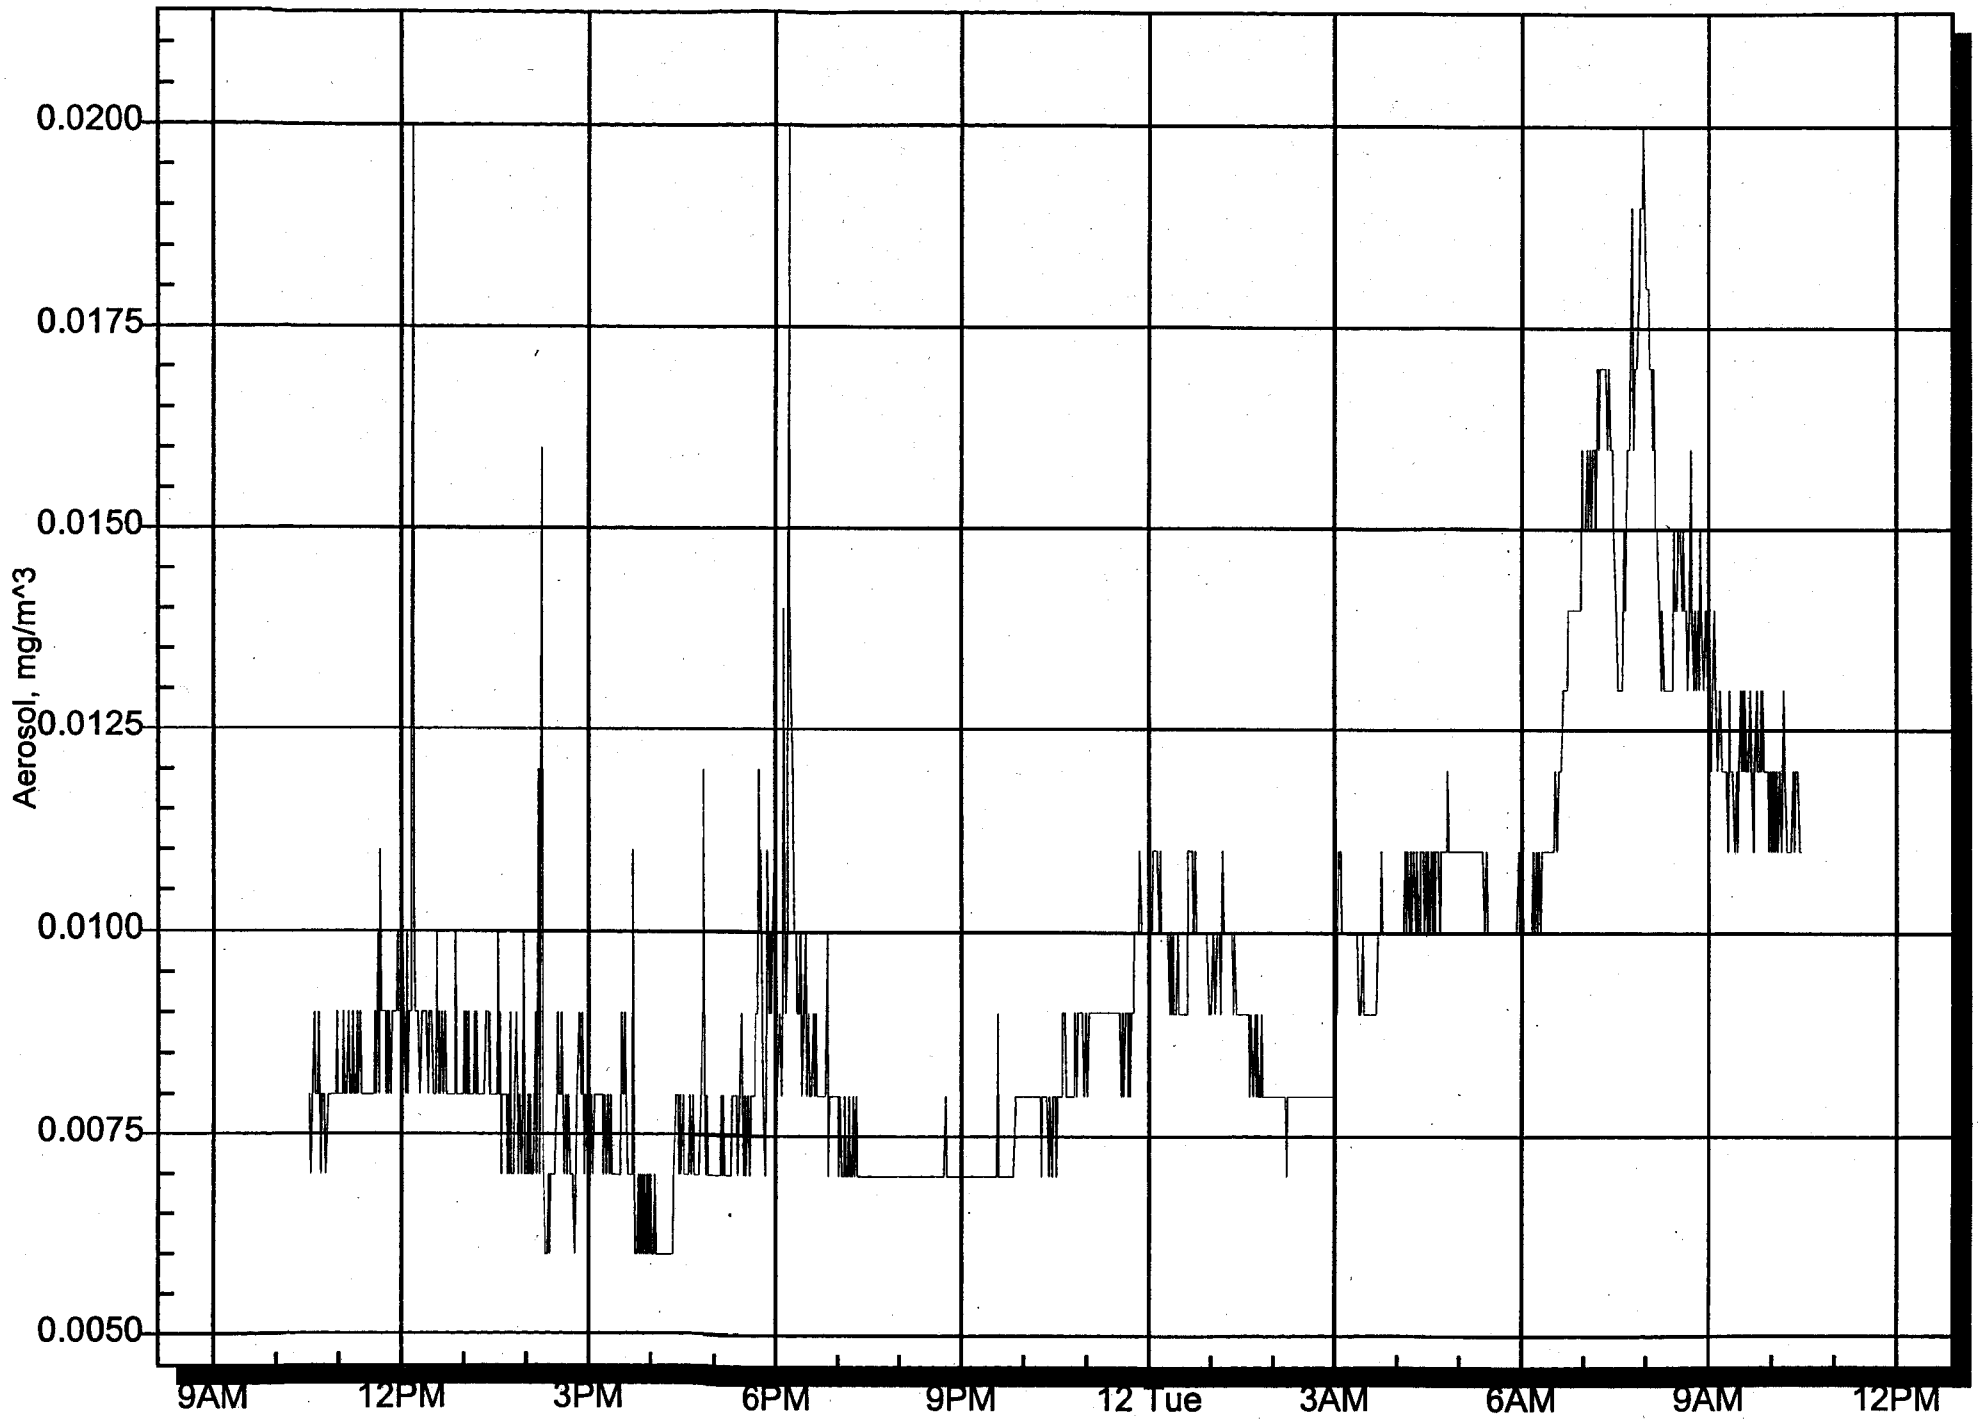

CITY_21MC100_001062531

NYC 9/11 Public Portal Document

P.S. 150M 3rd floor hallway

Current Test:	001
Start Time:	09:42:34 02/11/2002
Stop Time:	09:42:34 02/12/2002
Logging Interval:	60 seconds
Serial Number:	22998
Sensor:	Aerosol
Cal. Date:	11/07/2001
Channel:	Aerosol
(Units)	mg/m^3
Average:	0.005
Minimum:	0.001
Time	14:53:34
Date	02/11/2002
Maximum:	0.023
Time	08:42:34
Date	02/12/2002

CITY_21MC100_001062532

NYC 9/11 Public Portal Document

3rd Floor Hallway

Feb. 11-12, 2002

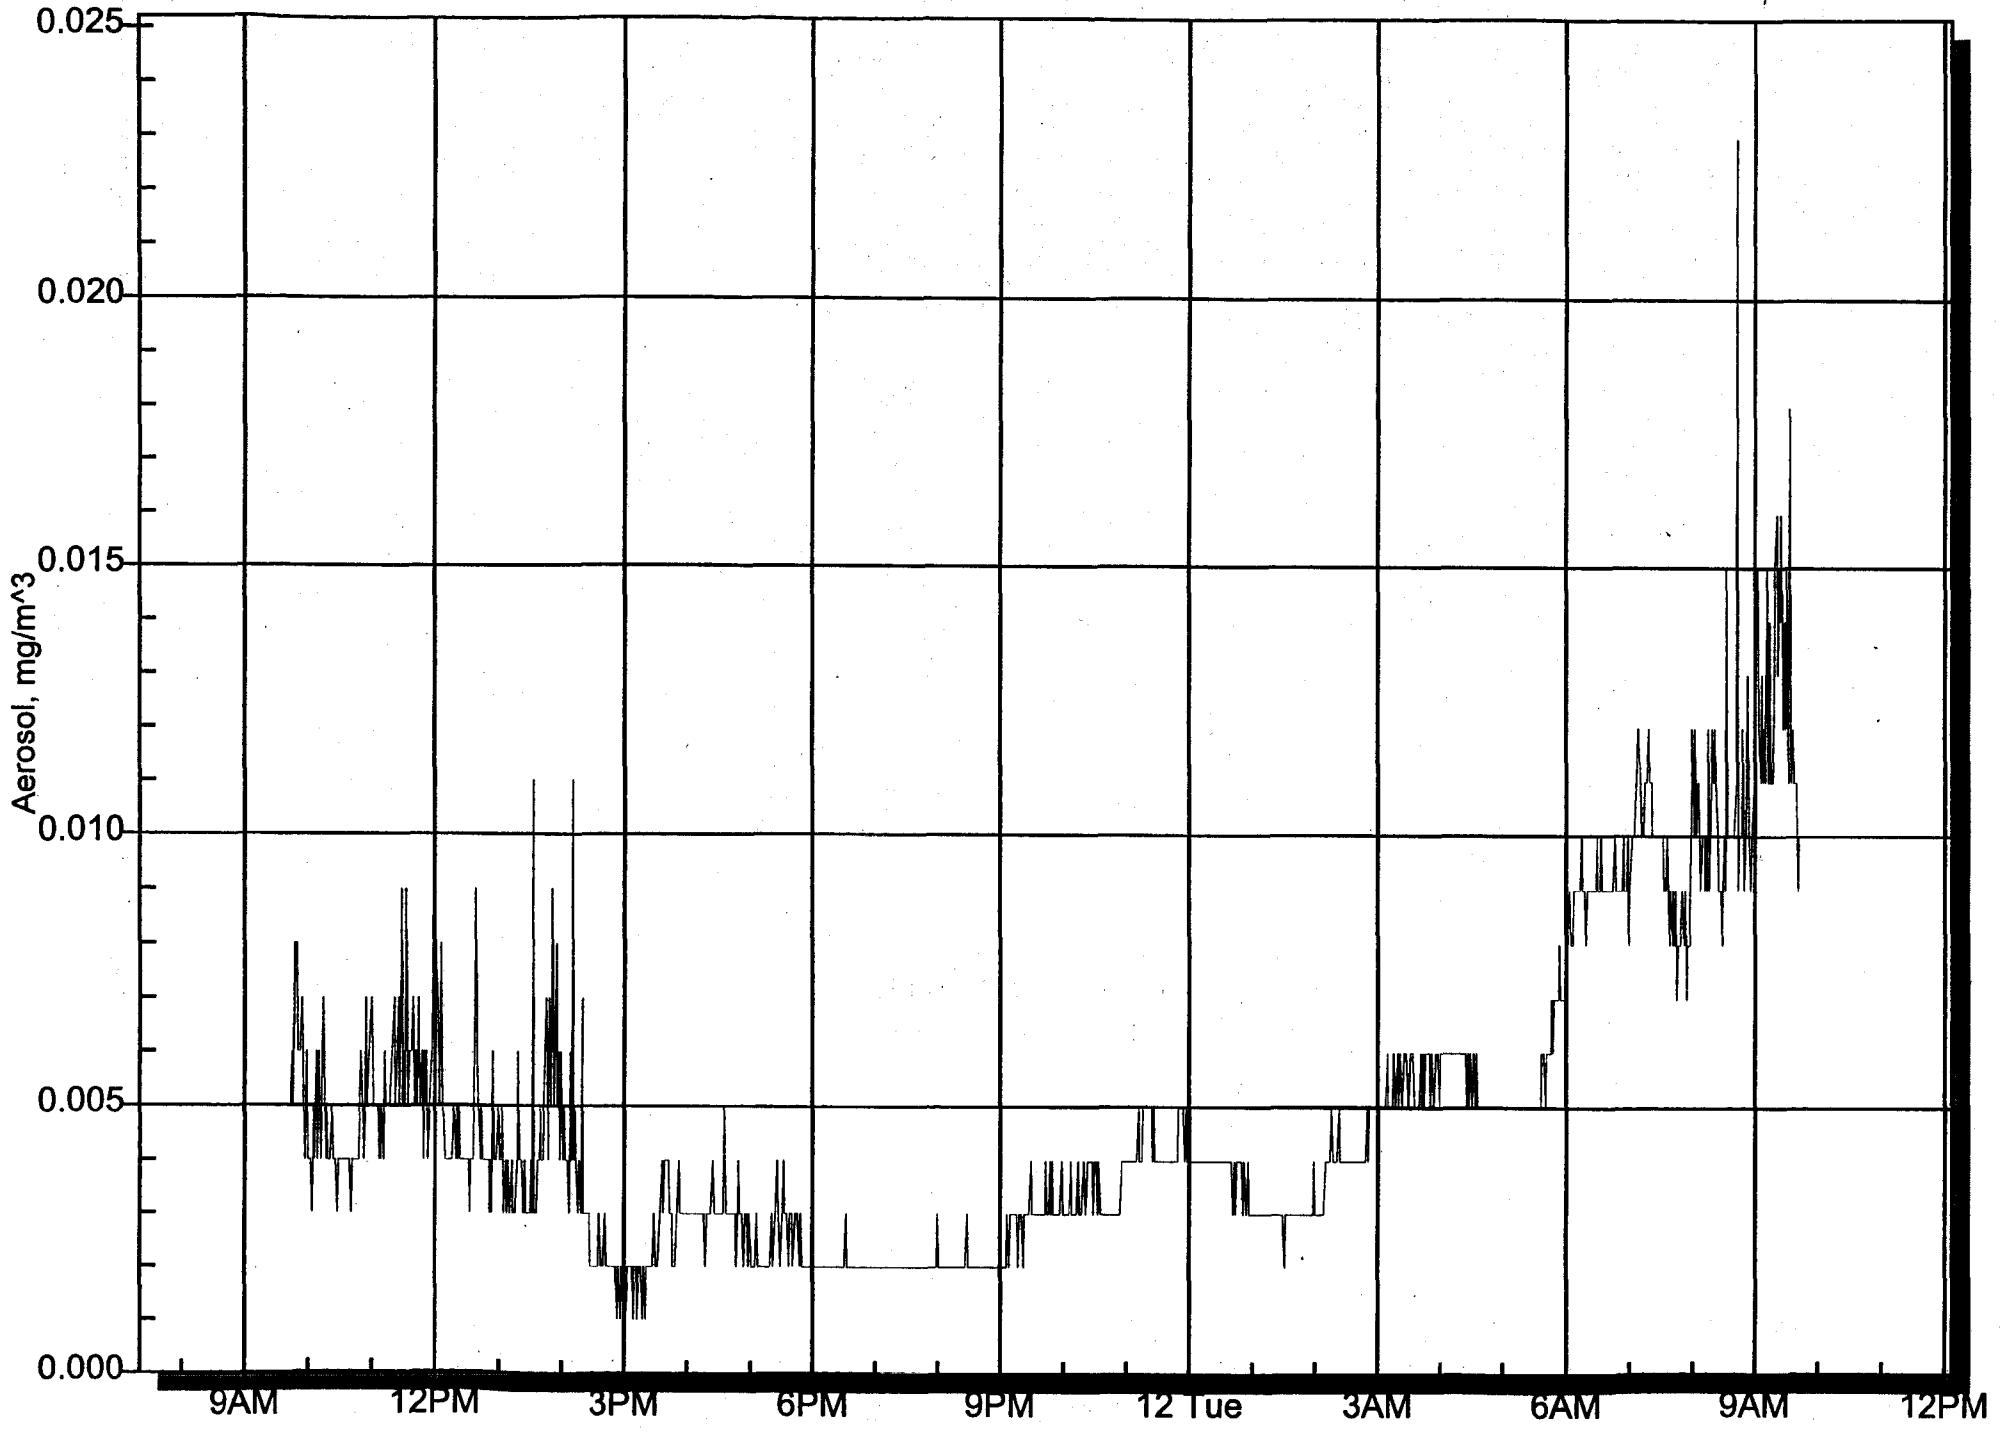

CITY_21MC100_001062533

NYC-WTC_000194779