

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 1 of 8

LOCATION PS 84M DATE 4-25-02 PROJECT NO. 19125-297

2009

✓

○

○

○

○

○

○

○

○

○

○

○

Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
OUTSIDE						
SOUTH EXIT	53.1	33.9	454	1	22	○
PLAYGROUND N	53.1	33.9	452	1	23	○
PLAYGROUND S	53.1	33.7	456	1	21	○
SE CORNER	53.2	33.9	459	1	21	○
EAST SIDE	53.2	33.9	460	1	21	○
N/W CORNER	53.4	33.6	460	1	22	○
NORTH EXIT	53.5	33.6	459	1	22	○
S/W CORNER	53.1	33.7	459	1	22	○
INTAKE NEXT TO AIR	53.2	33.9	457	1	23	○
NORTH CORNER	53.1	33.9	461	1	21	○
Guideline levels ASHRAE/AIHA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~20~~ ug/m ³ 24-hour average	1 ppm

Comments: NAThe assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.Signature: Ken F. [Signature] Date: 4-25-02

CITY_21MC100_006739483

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 2 of 8LOCATION PS. 89 MDATE 4-25-02 PROJECT NO. 14125-297


Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
26 Hall Next to Cafeteria	64.3	38.6	982	1	14	0
North Exit	64.4	38.7	610	1	14	0
Panel Room	70.1	35.2	603	1	15	0
Cafeteria	70.9	35.6	609	1	14	0
Hall By 12C	76.1	35.9	599	1	14	0
132 A	70.2	35.9	591	1	14	0
132 B	70.6	36.1	586	1	16	0
132 C	69.9	36.2	572	1	17	0
132 D	69.6	36.8	626	1	14	0
South Exit	71.3	35.3	617	1	13	0
Guideline levels ASHRAE/AHIA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~10~~ ug/m ³ 24-hour average	1 ppm

Comments:

N/A

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature:

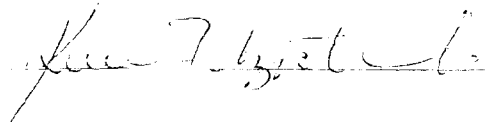

Date:

4-25-02

CITY_21MC100_006739484

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 3 of 8

LOCATION PS 891 F1 DATE 4-25-02 PROJECT NO. 19125-294

	Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
✓	NEXT TO STAIR 3 HALLWAY	70.1	36.4	601	1	15	0
✓	OUTSIDE COR FM 501	70.1	36.5	602	1	16	0
31	502	69.9	36.9	1010	1	14	0
✓	504 HALLWAY	70.2	36.9	556	1	14	0
✓	NEXT TO ELEVATOR BANK	70.3	36.7	549	1	15	0
✓	506	70.2	36.2	555	1	15	0
6	515 HALLWAY	70.9	36.2	801	1	15	0
33	505	70.9	36.4	1101	1	15	0
29	510	70.1	36.3	986	1	15	0
✓	512 HALLWAY	71.8	36.1	559	1	15	0
	Guideline levels ASHRAE/AIHA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~15~~ ug/m ³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.Signature: *John E. Hynes*Date: 4-25-02

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 4 of 8LOCATION PS 89 MDATE 4-25-02 PROJECT NO. 19125-247

	Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates(ug/m ³)	TVOCs (ppm)
✓	NEXT TO STAIR 2 Hallway	70.1	34.9	551	1	15	○
33	526	69.9	34.6	891	1	16	○
30	528	69.6	34.6	996	1	15	○
2	517	69.5	35.9	710	1	15	○
6	530 Hallway	69.6	35.6	982	1	15	○
27	532	70.3	35.9	810	1	16	○
10	514	70.2	36.1	796	1	16	○
3	419	69.5	36.2	660	1	16	○
✓	419 Hallway	69.7	36.3	541	1	16	○
✓	432	69.6	35.8	536	1	15	○
	Guideline levels ASHRAE/AIHA	69 – 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~20~~ ug/m ³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: [Signature] Date: 4-25-02

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 5 of 8

LOCATION PS 89M DATE 4-25-02 PROJECT NO. 19125-297

	Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
5	430	69.9	35.5	721	1	21	0
C	425 Highway	70.2	35.5	555	1	20	0
27	426	70.3	35.6	1021	1	19	0
C	Highway by Stair #2	70.2	35.7	610	1	18	0
C	410 Highway	70.1	35.6	606	1	21	0
C	408 Highway	70.6	36.1	598	1	21	0
C	Next to elevator bank	69.9	36.2	591	1	19	0
52	404	69.8	36.3	991	1	19	0
C	401 Highway	69.9	35.9	593	1	19	0
C	402	69.7	35.8	626	1	19	0
	Guideline levels ASHRAE/AIHA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~10~~ ug/m ³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: _____

Date: _____

4-25-02

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 6 of 8LOCATION PS 89 MDATE 4-25-02PROJECT NO. 19125-277

	Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
0004							
✓							
C	301	71.2	36.1	591	1	19	0
C	301 Hall	71.1	36.4	587	1	18	0
C	302	70.9	36.4	581	1	19	0
C	Hallway next to St-Hall 3	70.8	36.9	561	1	19	0
IS	304	70.9	36.1	581	1	19	0
C	Hallway next to kitchen & DWK	70.1	36.3	571	1	19	0
IS	306	70.2	36.1	710	1	15	0
C	308 Hall	70.3	35.9	610	1	15	0
C	315 Gym	71.6	35.8	619	1	17	0
33	315 Hall	71.7	36.1	1012	1	16	0
	Guideline levels ASHRAE/AIHA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level 1 700 ppm	9 ppm	~~10~~ ug/m ³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: _____

Date: 4-25-02

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 7 of 8

LOCATION PS 8901 DATE 4-25-02 PROJECT NO. 19125 - 297

Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (ug/m ³)	TVOCs (ppm)
308	69.1	35.1	510	1	19	0
310	69.2	35.6	540	1	18	0
314 Hallway	69.3	35.6	596	1	17	0
316	69.3	35.1	586	1	19	0
Hallway By Elevator #2	69.6	35.6	521	1	20	0
326	69.1	35.3	899	1	19	0
328	70.1	35.3	710	1	19	0
330	70.1	36.1	741	1	19	0
332	70.3	36.3	733	1	19	0
344	69.6	35.9	516	1	17	0
Guideline levels ASHRAE/AIHA	69 - 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~10~~ ug/m ³ 24-hour average	1 ppm

Comments: _____

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.

Signature: _____

Date: _____

4-25-02

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT


Page 8 of 8

LOCATION PS 89th DATE 4-25-02 PROJECT NO. 19125-297

	Location	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates(ug/m ³)	TVOCs (ppm)
copy ✓ 0	NEXT TO STAIR 4	70.1	34.1	510	1	19	0
1	219	70.3	34.3	567	1	19	0
16	232	70.6	34.6	828	1	20	0
11	230	70.1	35.9	810	1	19	0
0	217 Hall	69.8	35.6	541	1	19	0
13	228	69.8	35.6	826	1	19	0
13	226	69.9	35.6	810	1	19	0
3	Hallway 210W1	69.9	35.9	709	1	20	0
24	204	68.1	36.1	1112	1	16	0
25	202	69.9	34.9	1021	1	17	0
	Guideline levels ASHRAE/AIHA	69 – 76°F/winter 73-78.5°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	~~20~~ ug/m ³ 24-hour average	1 ppm

Comments:

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

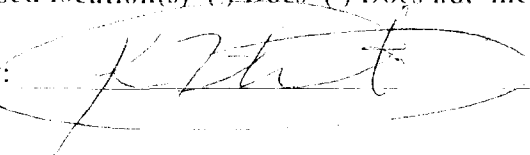Signature: 

Date:

4-25-02

CITY_21MC100_006739490