NYC 9/11 Public Portal Document

Lower Manhattan Testing

Collection Date: 10/9/01

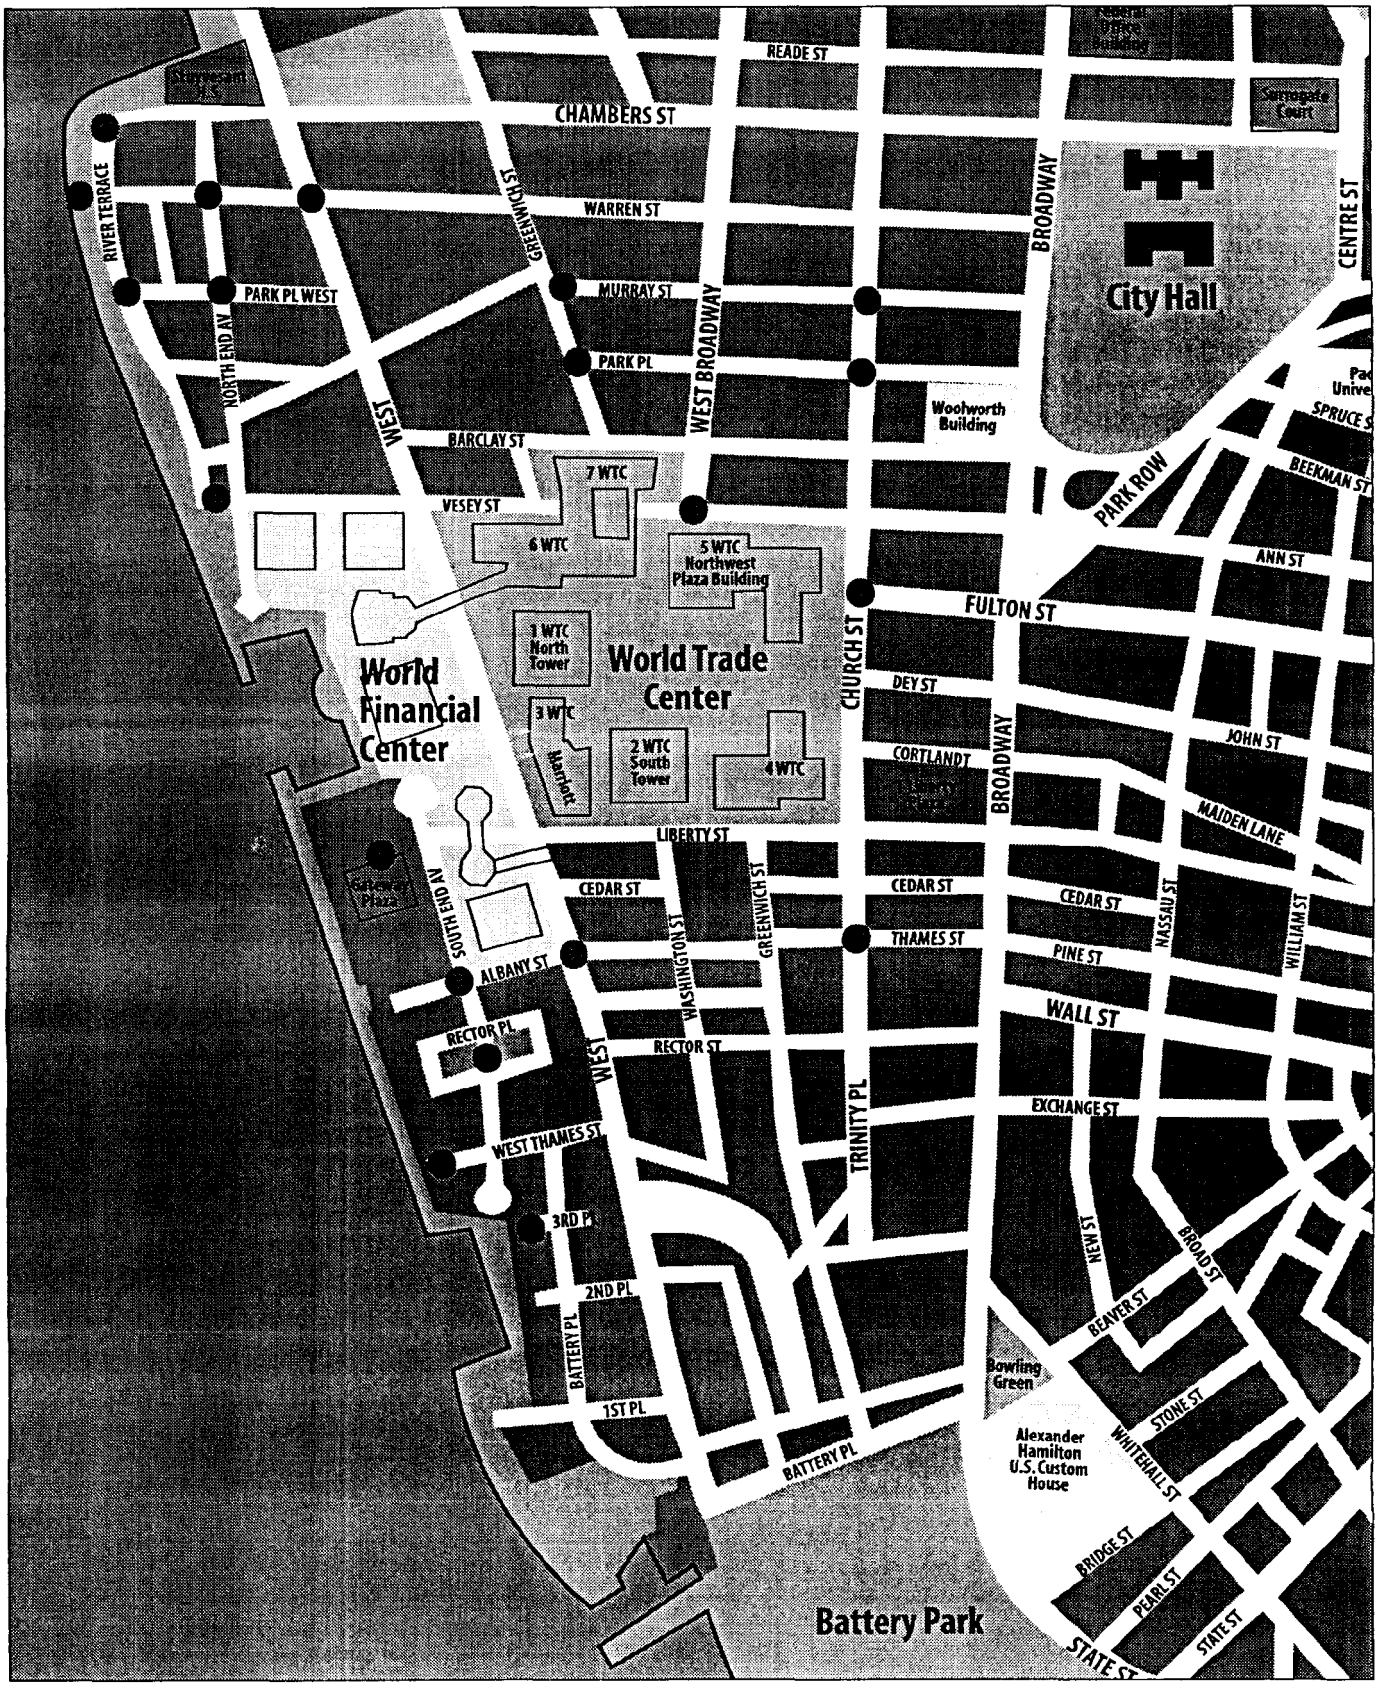

B55

CITY_21MC100_002468214

NYC-WTC_000203223

NYC 9/11 Public Portal Document

Lower Manhattan Testing

Collection Date: 10/9/01

Air Monitoring Table

Location Sampled	Ambient/Indoor	Fiber Conc. PCM (f/cc)	Asbestos Conc. TEM (struc./mm2)
Park Pl & Church St	Ambient	0.011	17.83
Park Pl & Greenwich St	Ambient	0.013	21.66
Murray St & Church St	Ambient	0.005	7.64
Murray St & Greenwich St	Ambient	0.006	10.83
Fulton St & Church St	Ambient	0.007	12.74
Warren St & North End Av	Ambient	0.005	8.92
West St & Warren St	Ambient	0.004	7.64
Gateway Plaza	Ambient	0.004	7.01
South End Av & Albany St	Ambient	0.006	11.46
West St & Albany	Ambient	<LOD	5.10
Rector Pl, by the Park	Ambient	<LOD	3.62
Third Pl & West End, Waterside	Ambient	0.004	7.64
West Thames St, Waterfront	Ambient	<LOD	6.37
River Terrace & Park Pl West	Ambient	<LOD	5.10
River Terrace & Chambers St	Ambient	0.004	7.64
River Terrace & Warren St	Ambient	<LOD	3.82
North End Av & Park Pl West	Ambient	<LOD	2.55
River Terrace & Vesey St	Ambient	0.006	9.55
Trinity Pl & Thames St	Ambient	<LOD	5.10
Vesey St & West Broadway	Ambient	0.023	29.94

Daily Field Survey

Instrument			Levels Found
Foxboro TVA 1000 *Flame-Ionization/Photo-Ionizaton Detector* *Detection of volatile photo ionizable and flammable compounds*			ND
Gastech GT 402 *Combustible Gas Indicator*	Detection of:	*Hydrodgen Sulfide*	ND
		Oxygen	20.9%
		CarbonMonoxide	2-8 P.M.
		Lower Explosive Limit	ND
Crown Triple Plus *Specialized Detectors*	Detection of:	*Hydrodgen Cyamide*	ND
		Chlorine	ND
		Ammonia	ND
		Carbon Monoxide	2-8 P.M.
RKI Freon Detector *Specialized Instrument for Detection of Freons*	Detection of:	*R-22*	ND

CITY_21MC100_002468215

NYC-WTC_000203224