Lower Manhattan Testing

Collection Date: 10/10/01

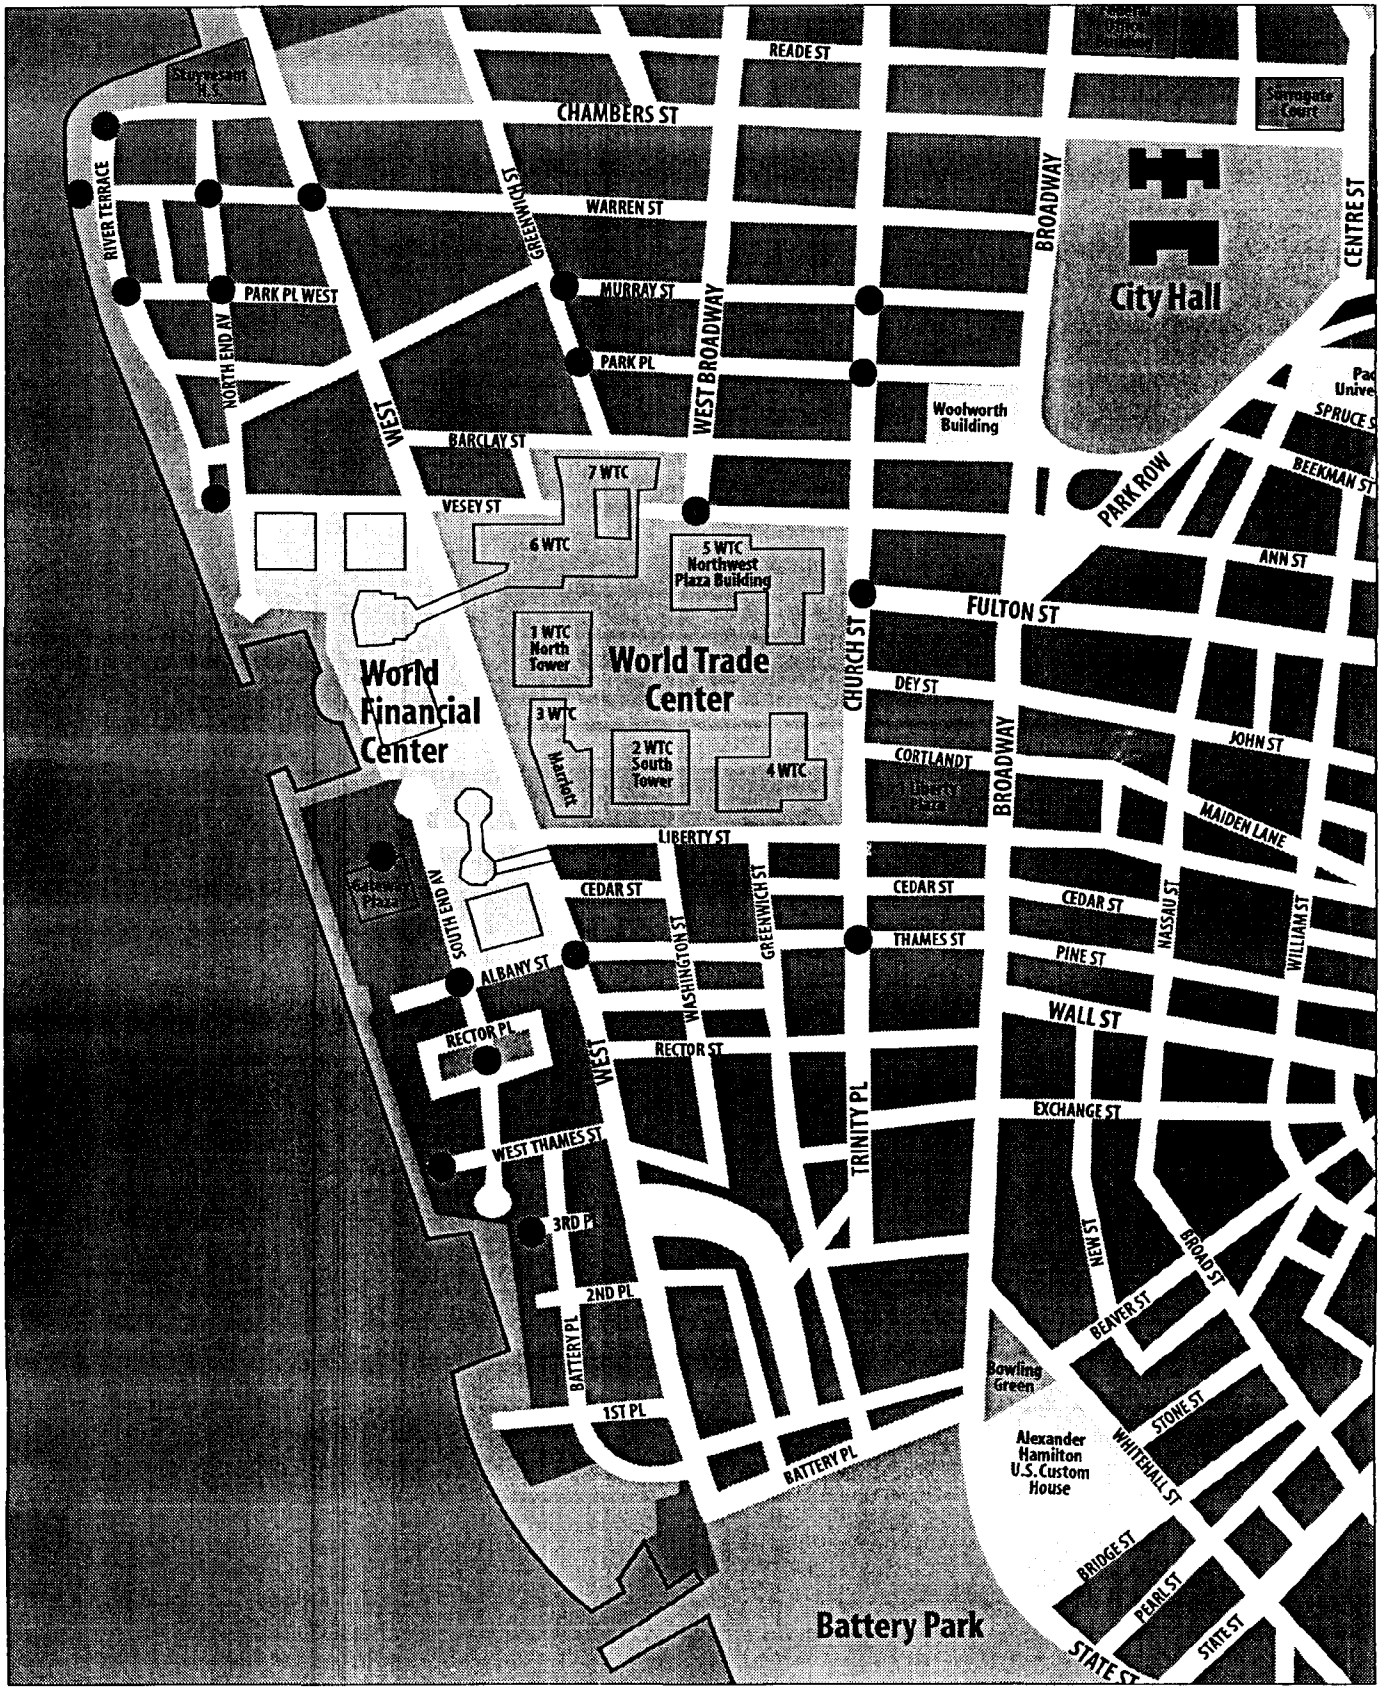

B57

NYC 9/11 Public Portal Document

Lower Manhattan Testing

Collection Date: 10/10/01

Air Monitoring Table

Location Sampled	Ambient/Indoor	Fiber Conc. PCM (f/cc)	Asbestos Conc. TEM (struc./mm2)
Park Pl & Church St	Ambient	0.006	10.19
Park Pl & Greenwich St	Ambient	0.006	9.55
Murray St & Church St	Ambient	<LOD	3.82
Murray St & Greenwich St	Ambient	0.005	7.64
Fulton St & Church St	Ambient	<LOD	3.82
Warren St & North End Av	Ambient	0.005	7.64
West St & Warren St	Ambient	<LOD	6.37
Gateway Plaza	Ambient	<LOD	6.37
South End Av & Albany St	Ambient	0.006	12.10
West St & Albany	Ambient	<LOD	3.82
Rector Pl, by the Park	Ambient	0.005	9.55
Third Pl & West End, Waterside	Ambient	<LOD	3.82
West Thames St, Waterfront	Ambient	<LOD	2.55
River Terrace & Park Pl West	Ambient	<LOD	6.37
River Terrace & Chambers St	Ambient	<LOD	1.91
River Terrace & Warren St	Ambient	<LOD	5.73
North End Av & Park Pl West	Ambient	<LOD	5.10
River Terrace & Vesey St	Ambient	<LOD	2.55
Trinity Pl & Thames St	Ambient	<LOD	3.82
Vesey St & West Broadway	Ambient	<LOD	3.82

Daily Field Survey

Instrument			Levels Found
Foxboro TVA 1000 *Flame-Ionization/Photo-Ionizaton Detector* *Detection of volatile photo ionizable and flammable compounds*			ND
Gastech GT 402 *Combustible Gas Indicator*	Detection of:	*Hydrodgen Sulfide* *Oxygen* *CarbonMonoxide* *Lower Explosive Limit*	ND 20.9% 2-8 P.M. ND
Crown Triple Plus *Specialized Detectors*	Detection of:	*Hydrodgen Cyamide* *Chlorine* *Ammonia* *Carbon Monoxide*	ND ND ND 2-8 P.M.
RKI Freon Detector *Specialized Instrument for Detection of Freons*	Detection of:	*R-22*	ND

CITY_21MC100_003070647

NYC-WTC_000203226