

DEP**ASBESTOS ANALYTICAL REPORT**

ASBESTOS CONTROL PROGRAM LABORATORY
96-05 HORACE HARDING EXPRESSWAY
CORONA, NEW YORK 11368
(718) 595-6309 FAX# (718) 595-6307

ELAP # 11045

TEST METHODS : 1) 40 CFR Part 763, Subpart F, App. A
2) Polarized Light Microscopy plus Stratified Point-Counting Method
3) EPA/600/R-93/116

Incident #: WTC122302
Inspector : R. RAMMOHAN
Premise : 139 FULTON STREET
Boro : Manhattan
Analyst : G. FRUCHTMAN

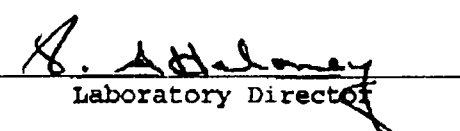
Date Collected: 12/23/02
Received: 12/23/02
Analyzed: 12/25/02

Client #:

DEP Sample #:	21223/A078017	21223/A078019	21223/A078020
Laboratory #:	21223/135	21223/137	21223/138
Location Sampled:	403 S. WINDOW	315 S. WINDOW	312 N. WINDOW
Color:	GREY	GREY	GREY
Homogenous:	Yes	Yes	Yes
Asbestos Present:	Yes	Yes	Yes

Results (%)

Chrysotile	<1	Chrysotile	trace	Chrysotile	1.1
Cellulose	1	Cellulose	2	Cellulose	2.0
Fibrous glass	49	Fibrous glass	25	Fibrous glass	51.9
Matrix	50	Matrix	73	Matrix	45

Comments:**Reviewed by:**
Laboratory Director

This test report may not be reproduced except with the written approval of this laboratory. The test report relates only to the item(s) listed and does not represent a product endorsement by NVLAP or any other U.S. Government agency.

TOTAL P.01

CITY_21MC100_002841548