

LINE 935

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 2 of 2


LOCATION 100 Chrissy

DATE 4-15/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOC (ppm)
RM 903	1	77.6	52.3	524	2	16	00
RM 903 ¹⁰ Case 87	0	78.2	51.2	621	2	14	00
6th Hallway	3	77.0	47.9	714	2	12	00
Kitchen	3	78.9	52.8	812	2	14	00
Cafeteria	18	78.0	51.6	619	2	12	00
Stair Case 7th Fl	0	77.6	49.2	718	2	12	00
7th Hallway	0	78.5	43.7	612	2	12	00
RM 706	3	77.2	54.2	711	2	10	00
RM 705	2	76.9	51.3	613	2	12	60
Guideline Levels ASHRAE/ANSI 62-1989		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed locations () does () does not meet established indoor air quality guidelines.

Signature:  Date:

ATC ASSOCIATES, INC.

Page 3 of 3

TIME 10:05

INDOOR AIR QUALITY FIELD REPORT

LOCATION 100. Trinity Pl. DATE 4-15/02 PROJECT NO. 19125.0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TV (µg/m³)
RM 703	12	76.9	61.4	521	2	12	00
Staircase 6 th fl	0	77.2	52.3	614	2	14	00
6 th fl Hallway	0	78.2	55.4	607	2	12	00
RM 606	18	76.2	52.4	602	2	10	00
RM 607	4	78.0	51.6	548	2	12	00
RM 605	3	77.6	47.8	612	2	14	00
Staircase A 5 th fl	0	78.7	43.6	610	2	12	00
5 th fl Hallway	0	76.9	52.4	711	2	12	00
Guideline levels ASHRAE/AIA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	11

Comments:

The assessed location(s) ☒ Does ☐ Does not meet established indoor air quality guidelines.

Signature:

Date:

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 4 of 4

TIME 1021

LOCATION 100 Family


DATE 4-15/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	VOCs (ppm)
RM 503	10	75.9	57.8	988	2	9	00
RM 506	02	76.1	57.6	712	2	10	00
RM 515	7	77.8	57.0	667	2	12	00
4 th Fl Hallway	1	78.2	51.6	552	2	12	00
RM 403	2	77.4	52.3	521	2	12	00
RM 404	0	75.6	51.4	532	2	11	00
RM 415	0	77.5	50.2	569	2	12	00
Staircase 3 rd Fl	0	77.2	52.3	506	2	12	00
3 rd Fl Hallway	0	78.1	48.6	544	2	12	00
Guideline levels ASHRAE/AMH/EPA		68 - 75°F/winter 73 - 79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☒ Does ☐ Does not meet established indoor air quality guidelines.

Signature:

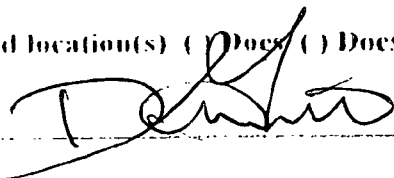

Date:

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 5 of

TIME 11:00

LOCATION

100 Drury Pl. NYC

DATE 4-15-02


PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	VOCs (ppm)
2nd Flr. Hallway	0	79.1	46.1	641	2	19	00
RM 207	10	78.2	45.7	680	2	18	00
RM 206	12	79.1	45.9	638	2	17	00
BSM. Hallway	0	79.2	45.6	627	2	18	00
LYM	18	79.1	46.7	624	2	18	00
Auditorium	8	70.2	45.6	655	2	17	00
1st Lobby	4	74.2	45.2	615	2	16	00
Exit Main Entrance South		79.1	46.1	584	2	17	00
Exit Main Entrance		79.3	45.2	627	2	18	00
Exit Main Entrance North		79.2	44.9	597	2	18	00
Guideline levels ASHRAE/AIHA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level 1 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature:

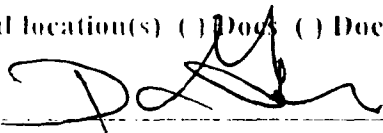

Date:

CITY_21MC100_002879838

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 6 of 6

FID 1500

LOCATION

100. Fraternity pt

DATE

4-15/02

PROJECT NO.


19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TV (cp)
Exit Main Entry		77.8	52.2	581	2	13	00
Exit Main Entry South		77.9	51.8	571	2	12	00
Exit Main Entry North		77.6	52.9	562	2	13	00
10th Fl. Hallway	2	77.9	51.5	564	2	12	00
Library	4	78.2	51.2	560	2	12	00
RM. 1006	2	73.4	52.0	542	2	11	00
Stair Case 9th fl.	0	77.4	53.4	581	2	12	00
9th Hallway	2	59.1	51.0	551	2	13	00
RM. 915	0	77.9	59.2	558	2	12	00
Guideline levels ASHRAE/AHIA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	11

Comments:

The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.

Signature:



Date:

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 7 of 7

TIME 1528

LOCATION 100 ~~Locality~~ PL. DATE 4-15/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOC's (ppm)
RM 903	1	78.6	51.6	506	2	16	00
Stair core B 8th fl	0	76.0	52.1	711	2	12	00
8th fl. Hallway	3	75.2	47.9	615	2	12	00
Kitchen	2	78.4	52.6	562	2	12	00
Cape train.	14	77.9	51.9	580	2	12	00
Stair core A 7th fl	0	76.2	49.1	612	2	12	00
7th fl. Hallway	0	78.5	43.7	610	2	12	00
RM 706	4	76.8	49.2	513	2	12	00
RM 705	3	78.3	52.7	738	2	14	00
Guideline levels ASHRAE/AHIA/EPA		68 -75°F/winter 73 -79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) ☒ Does ☐ Does not meet established indoor air quality guidelines.

Signature: 

Date: _____

CITY_21MC100_002879840

ATC ASSOCIATES, INC.

Page 8 of


TIME 16 00

INDOOR AIR QUALITY FIELD REPORT

LOCATION 100 Trinity Place DATE 4-15/02 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOC (ppb)
RM. 703	16	78.4	62.1	618	2	12	00
Staircase ^B	0	77.0	55.2	612	2	10	00
6th fl. Hallway	0	78.2	53.4	526	2	12	00
RM 606	8	77.6	52.1	504	2	12	00
RM 607	6	78.3	51.2	472	2	10	00
RM 605	3	77.2	47.3	52.8	2	12	00
Staircase A	0	77.9	52.6	411	2	12	00
5th fl. Hallway	0	78.4	50.1	677	2	12	00
RM 509	2	77.5	47.6	587	2	12	00
RM 510		76.9	47.9	690	2	12	00
Guideline levels ASHRAE/AHIA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	11

Comments:

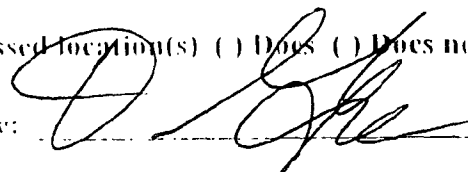The assessed location(s) ☐ Does ☐ Does not meet established indoor air quality guidelines.Signature: 

Date:

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 9 of 9

TIME 1631

LOCATION 100 Trinity Pl

DATE 4-15-02

PROJECT NO. 19125-0290

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	TVOCs (ppm)
Staircase	0	75.5	55.7	984	2	8	00
5th fl. Hallway	17	75.6	56.1	988	2	9	00
RM 503	12	75.7	57.6	1302	2	7	00
RM 506	04	76.1	54.5	816	2	8	00
RM 515	02	76.4	53.6	729	2	7	00
4th fl. Hallway	0	76.2	53.3	668	2	6	00
RM 403	0	76.8	53.8	938	2	7	00
RM 404	0	75.6	53.1	558	2	7	00
RM 415	0	75.8	52.8	521	2	7	00
Guideline levels ASHRAE/ATIA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	1 ppm

Comments:

The assessed location(s) () Do(es) not meet established indoor air quality guidelines.

Signature

Date:

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 10 of 11

TIME 1700

LOCATION 100 Trinity

DATE 4-15/02 PROJECT NO.

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	Other (ppm)
RM 308	21	77.9	47.1	711	2	14	00
RM 307	12	76.8	51.6	618	2	12	00
2nd fl Hallway	0	78.6	47.9	628	2	14	00
RM 206	10	79.1	46.6	581	2	12	00
RM 207	7	78.4	52.3	721	2	12	00
BSM Hallway	0	78.0	47.6	621	2	14	00
LYM	21	78.9	47.9	618	2	12	00
Auditorium	12	76.8	49.6	579	2	12	00
1st Lobby	3	76.5	46.3	512	2	12	00
Exit Main Entrance		78.1	47.6	518	2	11	00
Guideline levels ASHRAE 62.1-2001		68-75°F/winter 73-79°F/summer	30-60%	Guideline level: 700 ppm	9 ppm	0.5 µg/m³ 2.0-10.0 µg/m³ for 100 ppm	1 ppm

Comments:

For assessed locations: () Does () Does not meet established indoor air quality guidelines.

Signature:

Date:

CITY_21MC100_002879843

ATC ASSOCIATES, INC.
INDOOR AIR QUALITY FIELD REPORT

Page 11 of 11

TIME _____

LOCATION 100 Spring DATE 4-15-00 PROJECT NO. 19125-0291

Location	Occup.	Temperature (°F)	Relative Humidity (%)	Carbon Dioxide (ppm)	Carbon Monoxide (ppm)	Respirable Particulates (µg/m³)	PM10 (µg/m³)
Exit Main Entrance South.	7	78.6	49.8	637	2	14	00
Exit Main Entrance North	7	78.9	52.9	639	2	14	00
Guideline levels ASHRAE/AIHA/EPA		68-75°F/winter 73-79°F/summer	30-60%	Outdoor level + 700 ppm	9 ppm	65 µg/m³ 24-hour average	150 µg/m³

Comments: _____

The assessed location(s) () Does () Does not meet established indoor air quality guidelines.

Signature: [Signature] Date: _____

CITY_21MC100_002879844