WTC EMERGENCY PROJECT

Personal (worker) Exposure Monitoring Results

Period Covered: 10/3/01 - 10/13/01

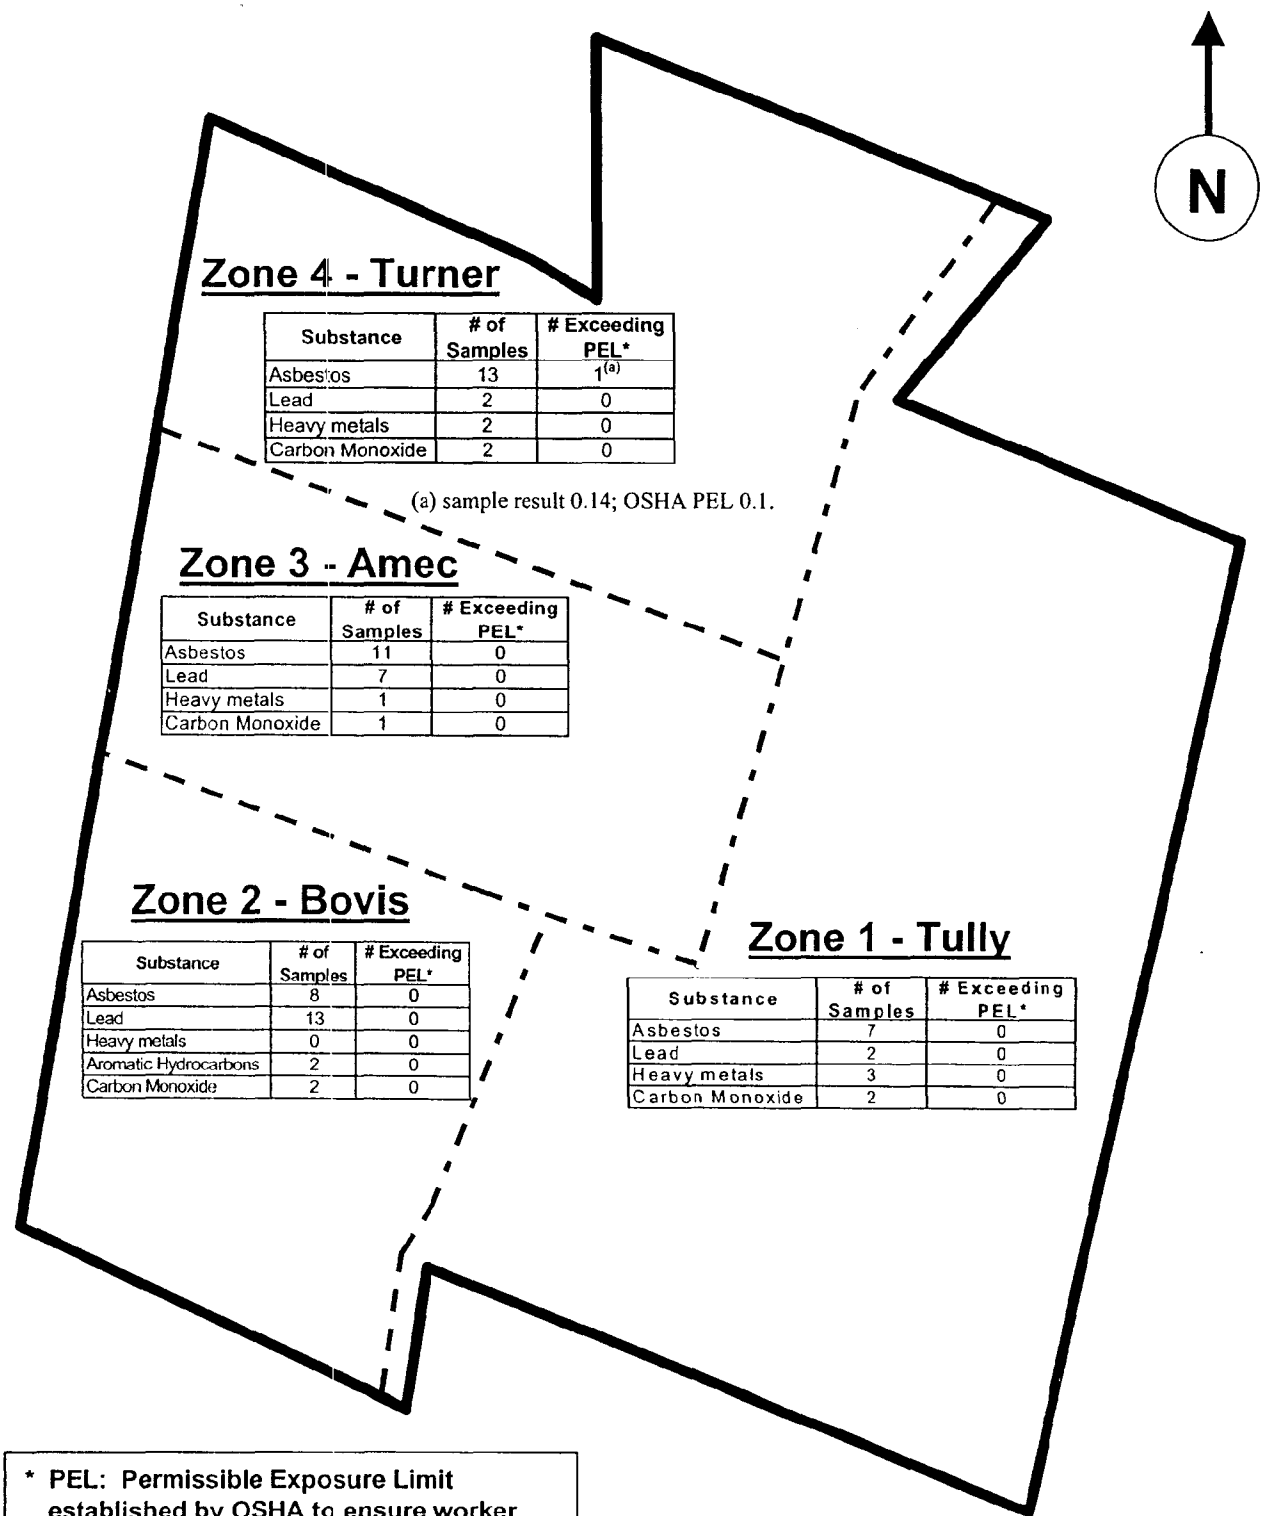

Zone 4 - Turner

Substance	# of Samples	# Exceeding PEL*
Asbestos	13	1[(a)]
Lead	2	0
Heavy metals	2	0
Carbon Monoxide	2	0

(a) sample result 0.14; OSHA PEL 0.1.

Zone 3 - Amec

Substance	# of Samples	# Exceeding PEL*
Asbestos	11	0
Lead	7	0
Heavy metals	1	0
Carbon Monoxide	1	0

Zone 2 - Bovis

Substance	# of Samples	# Exceeding PEL*
Asbestos	8	0
Lead	13	0
Heavy metals	0	0
Aromatic Hydrocarbons	2	0
Carbon Monoxide	2	0

Zone 1 - Tully

Substance	# of Samples	# Exceeding PEL*
Asbestos	7	0
Lead	2	0
Heavy metals	3	0
Carbon Monoxide	2	0

* **PEL: Permissible Exposure Limit established by OSHA to ensure worker protection.**

CITY_21MC100_002465973